



Ralph S. Northam
Governor

R. Brian Ball
Secretary of
Commerce and Trade

COMMONWEALTH of VIRGINIA

Erik C. Johnston
Director

DEPARTMENT OF HOUSING AND COMMUNITY DEVELOPMENT

January 15, 2021 (Updated 1/18/2021)

MEMORANDUM

TO: Board of Housing and Community Development Members

FROM: Kyle Flanders

SUBJECT: January 25, 2021 Board of Housing and Community Development Meeting

Enclosed is the agenda and information package for the Board of Housing and Community Development meeting to be held on Monday, January 25. The Housing and Community Development Committee will meet at 10:00 a.m. followed by the regular Board meeting.

The Board meeting will be held electronically via Google Meet in accordance with the Appropriations Act. The electronic meeting details are included below. Additional details and guidance regarding Google Meet is included within the email accompanying the Board package.

If you will not be able to attend the Board meeting, please contact me as soon as possible. I can be reached by e-mail at kyle.flanders@dhcd.virginia.gov or by telephone at 804-786-6761. Please let me know if you have any questions or if I can be of assistance.

Meeting Details

Meeting ID

meet.google.com/vvd-hwzz-ezn

Phone Numbers

[\(US\)+1 252-701-1130](tel:+12527011130)

PIN: 102 787 864#

Enclosure

Electronic Meeting/Google Meet Information

Meeting Access

Meeting ID

meet.google.com/vvd-hwzz-ezn

Phone Numbers

[\(US\)+1 252-701-1130](tel:+12527011130)

PIN: 102 787 864#

Functions

Google Meet allows for video meeting functionality. The microphone and camera buttons at the bottom center (page 2) allow for muting and camera off/on. There is also a chat bar on the right side of the screen.

We encourage Board members to utilize the online platform but you can also dial in to the meeting.

Tips/Tricks

- Please note, the meeting is being recorded.
- Enter the meeting early to check your connections; if you haven't used the platform it may ask you to enable your mic and camera as you enter the meeting
- Please say your name before speaking
- Mute if not speaking (staff will monitor phones for mute if there is feedback)
- If using dial-in, *6 mutes and unmutes your phone
- You can utilize the chat to ask questions. Please note, the chat is visible to all participants
- All votes will be roll call votes. You will need to unmute before being called on for each vote.

The image shows a Google Meet interface with several callouts explaining features:

- REC**: Recording Note (meeting will be recorded)
- Participant List**: A list of participants in the meeting.
- Microphone button**: A red button with a line through it, indicating the microphone is muted.
- Camera button**: A red button with a line through it, indicating the camera is off.
- Turn on to use captions**: A button to enable captions.
- Present now**: A button to start a presentation.
- More Options**: A three-dot menu icon for additional settings.
- Meeting details**: A sidebar on the right showing meeting information, including the number of people (2) and a chat window.

The interface also shows a large blue circle with the letter 'K' in the center, representing a participant's video feed. The bottom of the screen displays the Windows taskbar with various application icons and the system clock showing 7:58 AM on 9/14/2020.

***Some features may appear differently depending on your browser.**

AGENDA

BOARD OF HOUSING and COMMUNITY DEVELOPMENT

Housing and Community Development Committee

Monday, January 25, 2021

10:00 a.m.

Electronic meeting only

Meeting Access - meet.google.com/vvd-hwzz-ezn

Phone Number - (US) +1 252-701-1130 PIN: 102 787 864#

- | | | |
|------|---|---------------|
| I. | OPENING | |
| | a. Call to Order | Chair |
| | b. Roll Call | Kyle Flanders |
| II. | CONSENT AGENDA | Chair |
| | o <i>Approval of Minutes</i> : September 28, 2020 | |
| III. | INDUSTRIAL REVITALIZATION FUND GUIDELINES | DHCD Staff |
| | o <i>Action Item</i> | |
| IV. | NEW BUSINESS | Board members |
| V. | ADJOURNMENT | Chair |

AGENDA

BOARD OF HOUSING and COMMUNITY DEVELOPMENT

Monday, January 25, 2021

To begin at the conclusion of the Housing and Community Development Committee
Electronic Meeting only

Meeting Access - meet.google.com/vvd-hwzz-ezn

Phone Number - (US) +1 252-701-1130 PIN: 102 787 864#

Registration to speak is not required though it is requested that you contact kyle.flanders@dncd.virginia.gov if you wish to speak during the public comment period.

- | | | |
|-------|---|-----------------|
| I. | OPENING | |
| | a. Call to Order | Chairman |
| | b. Roll Call | Kyle Flanders |
| | c. Public Comment | Chairman |
| II. | CONSENT AGENDA | Chairman |
| | o <i>Approval of Minutes</i> : December 14, 2020 | |
| III. | REPORT of the HOUSING and COMMUNITY DEVELOPMENT COMMITTEE | Committee Chair |
| | <i>Action Items</i> | |
| | o Industrial Revitalization Fund Guidelines | |
| IV. | CODE UPDATE CYCLE | DHCD Staff |
| V. | REPORTS AND INFORMATION | |
| | a. Virginia Housing Report | Susan Dewey |
| | b. Report of the Virginia Fire Services Board | Richard Gregory |
| | c. Report of the Director | Erik Johnston |
| VI. | UNFINISHED BUSINESS | Board members |
| VII. | NEW BUSINESS | Board members |
| VIII. | BOARD MATTERS | Board members |
| IX. | FUTURE BOARD MEETING DATES | Erik Johnston |
| | o March 15, 2021 | |
| X. | ADJOURNMENT | Chairman |

**BOARD OF HOUSING AND COMMUNITY DEVELOPMENT
Housing and Community Development Committee
MEETING**

10:10 A.M., September 28, 2020

Digital Meeting Only

Due to the COVID-19 pandemic and public health emergency and the need to provide social distancing and prohibit large gatherings, the meeting was held electronically in accordance with the State of Emergency Declared by the Governor and the 2020 amendments to the Appropriations Act. The meeting was held via Google Meet.

Members Present

Sonny Abbasi
Claudia Cotton
Susan Dewey
Andrew Friedman
Richard Gregory
Sylvia Hallock
Mark Jackson
Abby Johnson
Keith Johnson
Monique Johnson
Brett Meringoff

Members Absent

Mimi Elrod
Patty Shields

Call to Order

Mr. Andrew Friedman, Vice-Chair of the Housing and Community Development Committee, called the meeting to order at 10:10 a.m.

Roll Call

The roll was called by Mr. Kyle Flanders of the Department of Housing and Community Development's (DHCD) Policy Office. Mr. Flanders reported that a quorum was present.

Approval of Minutes

A motion was made by Mr. Abbasi and properly seconded by Ms. Abby Johnson to approve the minutes of the June 26, 2020, meeting of the Committee; the motion passed. (Yeas: Abbasi, Dewey, Friedman, Gregory, A. Johnson, K. Johnson, Meringoff; Abstentions: Cotton, Hallock, Jackson, M. Johnson; No-Votes: None)

Enterprise Zone Regulations

Ms. Rebecca Rowe, Associate Director of the Community Revitalization Office at DHCD gave an overview of a proposed change to Enterprise Zone regulations which would allow applications to be received digitally as opposed to as a hard copy. A motion was made by Mr. Abbasi and properly seconded by Mr. Jackson to approve the proposed change. The motion passed. (Yeas:

Abbasi, Cotton, Dewey, Friedman, Gregory, Hallock, Jackson, A. Johnson, K. Johnson, M. Johnson, Meringoff; No-Votes: None)

New Business

Mr. Erik Johnston, Director of DHCD, gave an overview of the Annual Action Plan updates and focused on proposed uses of CDBG CARES Act funding to bolster rent and mortgage relief assistance. Director Johnston received input from the Board on the proposed use of funding.

Adjournment

Upon a motion duly made and seconded, the meeting was adjourned.

**BOARD OF HOUSING AND COMMUNITY DEVELOPMENT
MEETING**

10:02 A.M., December 14, 2020

Digital Meeting Only

Due to the COVID-19 pandemic and public health emergency and the need to provide social distancing and prohibit large gatherings, the meeting was held electronically in accordance with the State of Emergency Declared by the Governor and the 2020 amendments to the Appropriations Act. The meeting was held via Google Meet.

Members Present

Sonny Abbasi
Claudia Cotton
Susan Dewey
Sean Farrell
Andrew Friedman
Richard Gregory
Sylvia Hallock
Mark Jackson
Abigail Johnson
Keith Johnson
Monique Johnson
Brett Meringoff
Patricia “Patty” Shields

Members Absent

Call to Order

Mr. Sonny Abbasi, Chair of the Board of Housing and Community Development, called the meeting of the Board to order at 10:02 a.m. Mr. Kyle Flanders of the Department of Housing and Community Development’s (DHCD) Policy Office read a brief statement.

Roll Call

The roll was called by Mr. Flanders. Mr. Flanders reported that a quorum was present.

Public Comment

Mr. Abbasi noted procedures for offering public comment and recognized Mr. Flanders to call the speakers.

JM Snell spoke in opposition to the proposed inclusion of sprinklers in new townhomes noting concerns in rural areas.

Dan Sandoval spoke in opposition to the proposed inclusion of sprinklers in new townhomes noting the need for additional stakeholder deliberation.

Susan Stillman spoke in favor of adopting the 2018 International Energy Conservation Code (IECC).

Eric Goplerud, Board Chair of Faith Alliance for Climate Solutions, spoke in favor of adopting the 2018 IECC standards without exception, noting social and moral obligations.

Judy Gayer spoke in favor of adoption of the 2018 IECC without amendment as well as proposals that support electric vehicle readiness.

Ivy Main spoke in favor of adoption of the 2018 IECC, noting the entire life of a dwelling should be considered.

Craig Toalson, of the Homebuilders Association of Virginia spoke in opposition to the proposed inclusion of requiring sprinklers in new townhomes noting the need for additional stakeholder deliberation.

William Penniman of the Sierra Club spoke in favor of adopting the 2018 IECC, noting the Board's statutory requirements.

Judy Gayer noted statutory requirements of the Building Code and the necessity to adopt the full 2018 IECC without exceptions.

Joy Loving of the Climate Action Alliance of the Valley spoke in favor of adoption of the 2018 IECC, specifically noting the importance of proposals regarding EV readiness.

Glenn Dean spoke in favor of requiring sprinklers in new townhomes.

Elizabeth Greenfield of the Home Builders Association of Richmond spoke in opposition to the proposed inclusion of requiring sprinklers in new townhomes noting the need for additional stakeholder deliberation.

Ross Shearer spoke in favor of adopting the 2018 IECC standards for wall and ceiling insulation, noting the return on investment by adding additional insulation.

David Radford spoke in opposition to the proposed inclusion of requiring sprinklers in new townhomes noting the need for additional stakeholder deliberation particularly among different regions and from local governments.

Soledad Portilla spoke in opposition to the proposed inclusion of requiring sprinklers in new townhomes noting the need for additional stakeholder deliberation and affordability concerns.

Patrick McCarthy spoke in opposition to the proposed inclusion of requiring sprinklers in townhomes noting the need for additional stakeholder deliberation.

Tom Schoedel, President of Atlantic Builders, spoke in opposition to the proposed inclusion of requiring sprinklers in new townhomes noting the need for additional stakeholder input.

Bob Shippee spoke in favor of adoption of the 2018 IECC noting Commonwealth Energy Policy and statutory requirements of the Board.

John Oliveri spoke in opposition to the proposed inclusion of requiring sprinklers in new townhomes noting costs and the need for additional stakeholder deliberation.

Chris Mowry of Longmeadows Incorporated spoke in opposition to the proposed inclusion of requiring sprinklers in new townhomes noting costs and the need for additional stakeholder deliberation.

David Hutcheson, President of the Virginia Fire Chiefs Association spoke in favor of adopting the requirement for sprinklers in new townhomes noting enhanced safety for townhome residents.

Robby Dawson of the National Fire Protection Association spoke in favor of new townhome sprinklers noting the consumer demand for such sprinklers.

Andrew Milliken, Chairman of the Fire Services Board Codes and Standards Committee, spoke in favor of adopting the requirement

for sprinklers in new townhomes noting enhanced safety for townhome residents.

Jeff Shapiro, Executive Director of the IRC Sprinkler Coalition, spoke in favor of adopting the requirement for sprinklers in new townhomes as well a proposal (RB325.1-18) he submitted, that was not approved at the October meeting for inclusion in the final regulations, to require sprinklers in some three-story dwellings with habitable attics.

David Beahm spoke in opposition to the proposed inclusion of requiring sprinklers in new townhomes noting the need for additional stakeholder input.

James Demmel offered support of comments previously submitted by Scott Hultstrom regarding elevators.

Tony Fleming spoke in favor of adopting the requirement for sprinklers in new townhomes noting the affordability of such systems.

Andrew Grigsby spoke in favor of adoption of the 2018 IECC noting statutory requirements of the Board.

Linda Hale spoke in favor of adopting the requirement for sprinklers in new townhomes noting enhanced safety for townhome residents.

Robert Glass commented on the need to update to 2019 UL and ASHRAE standards in order to address A2L refrigerants, the primary new refrigerants with lower GWP (global warming potential). He indicated willingness to work with the committee to ensure the correct standards are incorporated.

John Catlett spoke in favor of adopting the requirement for sprinklers in new townhomes noting enhanced safety for townhome residents.

James Moss, President of the Virginia Building and Code Officials Association, commended stakeholders for their work and recommended the Board oppose non-consensus proposals.

Richard Witt commended stakeholders for their work and recommended the Board defer action on including the proposal regarding sprinklers in new townhomes.

A motion was made by Mr. K. Johnson and properly second by Ms. A. Johnson to adjourn until after the committees. The motion passed.

Call to Order

Mr. Abbasi called the meeting of the Board of Housing and Community Development back to order at approximately 1:15.

Consent Agenda

A motion was made by Mr. Meringoff and properly seconded by Mr. Farrell to approve the minutes of the October 19th, 2020 Board of Housing and Community Development meeting. The motion passed. (Yeas: Abbasi, Cotton, Dewey, Farrell, Friedman, Gregory, Jackson, A. Johnson, K. Johnson, M. Johnson, Meringoff, Shields; Nays: None; Abstentions: Hallock)

Report of the Codes and Standards Committee and the Joint meeting with the Virginia Fire Services Board

Mr. Meringoff provided a report of the Codes and Standards Committee noting recommendations regarding the Statewide Fire Prevention Code, Uniform Statewide Building Code, Industrialized Building Safety Regulations, Virginia Amusement Device Regulations, Virginia Certification Standards, and the Manufactured Home Safety Regulations. Mr. Abbasi reported on the recommendation of the joint meeting of the Board of Housing and Community Development and the Virginia Fire Services Board.

The recommendation of the committees and the joint board to adopt the final regulations for the Statewide Fire Prevention Code was presented as a standing motion. The motion was seconded by Mr. K. Johnson. The motion passed. (Yeas: Abbasi, Cotton, Dewey, Farrell, Friedman, Gregory, Hallock, Jackson, A. Johnson, K. Johnson, M. Johnson, Meringoff, Shields; Nays: None; Abstentions: None.)

The recommendation of the committee to adopt the final regulations for the Uniform Statewide Building Code with an amendment to remove the requirement for fire sprinklers in townhomes and also directing staff to convene a subworkgroup and act with diligence to resolve the matter was presented as a standing motion. The motion was seconded by Mr. Farrell. Mr. K.

Johnson offered an amendment to the motion to make sprinklers required for buildings including only four or more townhomes. Ms. A. Johnson seconded the amendment. After discussion, the amendment failed. (Yeas: K. Johnson, Jackson Nays: Abbasi, Cotton, Dewey, Farrell, Friedman, Gregory, Hallock, A. Johnson, M. Johnson, Meringoff, Shields; Abstentions: None.)

A vote was called on the main motion and the motion passed. (Yeas: Abbasi, Cotton, Dewey, Farrell, Friedman, Gregory, Hallock, Jackson, Meringoff, A. Johnson, M. Johnson, Shields; Nays: K. Johnson; Abstentions: None.)

The recommendation of the committee to adopt the final regulations for the Industrialized Building Safety Regulations was presented as a standing motion. The motion was seconded by Mr. Farrell. The motion passed. (Yeas: Abbasi, Cotton, Dewey, Farrell, Friedman, Gregory, Hallock, Jackson, A. Johnson, K. Johnson, M. Johnson, Meringoff, Jackson; Nays: None; Abstentions: None.)

The recommendation of the committee to adopt the final regulations for the Virginia Amusement Device Regulations was presented as a standing motion. The motion was seconded by Mr. Farrell. The motion passed. (Yeas: Abbasi, Cotton, Dewey, Farrell, Friedman, Gregory, Hallock, Jackson, A. Johnson, K. Johnson, M. Johnson, Meringoff, Shields; Nays: None; Abstentions: None.)

The recommendation of the committee to adopt the final regulations for the Manufactured Home Safety Regulations was presented as a standing motion. The motion was seconded by Mr. Farrell. The motion passed. (Yeas: Abbasi, Cotton, Dewey, Farrell, Friedman, Gregory, Hallock, Jackson, A. Johnson, K. Johnson, M. Johnson, Meringoff, Shields; Nays: None; Abstentions: None.)

The recommendation of the committee to adopt the final regulations for the Virginia Certification Standards was presented as a standing motion. The motion was seconded by Mr. Jackson. The motion passed. (Yeas: Abbasi, Cotton, Dewey, Farrell, Friedman, Gregory, Hallock, Jackson, A. Johnson, K. Johnson, M. Johnson, Meringoff, Shields; Nays: None; Abstentions: None.)

Mr. Flanders and Ms. Cindy Davis, Deputy Director of the Division of Building and Fire Regulations at DHCD, provided information on the next steps in the Code Adoption process.

Housing Trust Fund Update	Mr. Erik Johnston, Director of DHCD, provided an update on the Virginia Housing Trust Fund noting final funding levels in the recently adopted biennium budget. He provided an overview of the memorandum in the board packet on the matter which included information on the set aside for Rent and Mortgage Relief.
Resolutions	Mr. Abbasi presented resolutions commending former Board members for their service. A motion was made by Mr. Meringoff to adopt the resolutions. The motion was seconded by Mr. K. Johnson. The motion passed. (Yeas: Abbasi, Cotton, Dewey, Farrell, Friedman, Gregory, Hallock, Jackson, A. Johnson, K. Johnson, M. Johnson, Meringoff, Shields; Nays: None; Abstentions: None.)
Reports and Information	<p>Ms. Susan Dewey, Chief Executive Officer of Virginia Housing, gave updates on the upcoming Qualified Allocation Plan update for the Low Income Housing Tax Credit program and the Rent and Mortgage Relief efforts through the landlord application approach.</p> <p>Mr. K. Johnson provided an update from the Virginia Fire Services Board (VFSB). He also commended DHCD and Fire Services Board staff for facilitating a process that led to consensus on nearly all areas of the Fire Code update process.</p> <p>Mr. Johnston thanked the staff, Board and stakeholders for their engagement in the Code Development Process. Mr. Johnston also provided a presentation regarding Community Development Block Grant (CDBG) projects responsive to the pandemic.</p>
Unfinished Business	There was no unfinished business.
New Business	There was no new business.
Board Matters	There were no additional Board matters.
COIA Items	Mr. Flanders reminded Board members of COIA requirements and their upcoming January filing.

Future Board Meeting
Dates

Mr. Johnston noted that the tentative 2021 meeting schedule was included in the Board Packet.

Adjournment

Upon a motion duly made and seconded, the meeting was adjourned.



Ralph S. Northam
Governor

R. Brian Ball
Secretary of
Commerce and Trade

COMMONWEALTH of VIRGINIA

Erik C. Johnston
Director

DEPARTMENT OF
HOUSING AND COMMUNITY DEVELOPMENT

Memorandum

To: Board of Housing Community Development Members

From: Erik Johnston, DHCD Director

Subject: Industrial Revitalization Fund (IRF) Guidelines, Proposed Changes

Date: January 15, 2021

As directed by state statute, the Department of Housing and Community Development (DHCD) administers the [Virginia Removal or Rehabilitation of Derelict Structures Fund](#), also known as the Industrial Revitalization Fund (IRF). The Fund receives state appropriations and is intended for use by local governments and their partners to assist in revitalizing vacant and deteriorated industrial and commercial properties. These revitalization goals are accomplished by leveraging state funds with matching local and/or private funds. The goals of the program include the following:

1. Removal of blight which inhibits other investment in the locality
2. Returning properties to the tax rolls
3. Developing end uses that create additional investment and economic activity in the locality/area

The legislation which enables the creation of the Fund directs the Board of Housing and Community Development to develop guidelines by which the Fund will be administered. As a best practice, the guidelines require periodic review and updates. DHCD is proposing changes regarding distress scoring. In particular, the draft changes consider four distress categories (as opposed to six). This will make IRF more consistent with other determinations of distress used by the agency. Input was solicited on the change at recent how-to-apply workshops.

Staff requests approval of the amended guidelines (changes highlighted on pages 23 and 24).

Enclosure

INTRODUCTION

The base budget of \$1.5 million for Fiscal Year 2022 (FY '22) is available for the strategic redevelopment of vacant and deteriorated industrial properties across the Commonwealth. The General Assembly will finalize the total funding available in the spring of 2021. For the purposes of this program, the term “industrial” will be considered to mean any non-residential structure significant to the community due to size, location, and/or economic importance. Remnants of past economic vibrancy and local economies in transition, these structures are no longer suited for their former purpose, and in their current deteriorated condition, stand as a substantial deterrent for future economic opportunity in the surrounding area and region.

Financial barriers typically block the timely redevelopment of these structures and often require more than local resources to attract private sector investment in order to make a deal cash flow. This is especially true in distressed areas. Therefore, the allocation is meant to leverage local and private resources to achieve market-driven redevelopment of these structures, creating a catalyst for long-term employment opportunities and on-going physical and economic revitalization. Eligible properties and structures must be vacant and deteriorated and may be redeveloped for any market-driven purpose including mixed-use, regardless of the original use. For purposes of IRF, market-driven purpose is defined as guided by market trends and consumer needs based on market research where there is an actual need to be fulfilled or a market problem to solve.

Availability of Funds

The funding available in FY 2022 is a one-time allocation to replenish the Virginia Derelict Structures Fund (DSF) established under §36-152 of the Code of Virginia. The Virginia Department of Housing & Community Development administers these funds under the Industrial Revitalization Fund (IRF) Program.

Award Amounts

The maximum IRF award is \$600,000 per project; however, an applicant may apply for less. IRF awards may not be used as a substitute for other funds the applicant has already committed to a project. IRF awards require at least a 1:1 match.

ELIGIBILITY

Eligible Applicants

Only local governments (cities, counties, or towns), and regional or local economic or industrial development authorities may submit applications for funding. A unit of local government may apply directly for funding to use on publicly owned property **OR** on behalf of a for-profit or non-profit entity for privately owned property. Localities may designate a redevelopment authority or another similar organization as an agent for project implementation and administration.

Award Funding Structures

While applicants should indicate whether funds are requested as a loan or a grant, DHCD reserves the right to award funding in the manner most appropriate to the project, and to recommend alternative structures as necessary.

DHCD will issue an **IRF GRANT** under the following conditions:

- The property is publicly owned;
- The privately owned property has an option agreement/contract in place for purchase by a local government at the time of the application; or
- The private property is owned by a not-for-profit, tax-exempt entity.
- Financing to complete the entire project as specified in the IRF application has been secured as evidenced by formal letters of interest, term sheets, or commitment letters.

In cases where the local government intends to lease the property to a private, for-profit entity, a market rate lease is required; **upon resale of the property to a private, for-profit entity, DHCD may require repayment of a prorated grant amount.**

DHCD will issue an **IRF GRANT/LOAN** under the following conditions:

- The property is owned by a private, for-profit entity and the end-use will be owned by a private, for-profit business.
- Financing to complete the entire project as specified in the IRF application has been secured as evidenced by formal letters of interest, term sheets, or commitment letters.
- IRF Grant/Loans may be funded as a grant to the applicant local government (or local Development Authority), who will in turn make a loan to the for-profit entity. The following standard terms and conditions will apply to all projects unless DHCD determines that a regionally significant project requires more favorable terms. The terms of the loan must be agreed to by DHCD.
 - Interest Rate: 2.5%
 - Amortization: 10 Years
 - Environmental Review
 - DHCD will require an executed performance agreement with the developer
- If the locality is unwilling to manage the loan, or, by DHCD's determination, unable to manage the loan, the loan may be underwritten by Virginia Community Capital (VCC). In this case, VCC will require a commitment fee of 1% (50% due within 14 days of execution of IRF loan performance agreement and the remainder at IRF closing).

All projects, regardless of award structure, must be ready to execute a contract or performance agreement for the IRF funds by **January 1, 2022**.

- Agreements may be executed simultaneously to the closing of the first trust lender for primary financing or after; however, IRF grant/loans **will not close before** all other sources of primary financing are closed or commitment letters with a closing date have been issued.
- Failure to execute the contract or performance agreement within 6 months of award may result in the IRF funds being reprogrammed to another project. The applicant will be given the opportunity to apply again once the project is more prepared for IRF loan closing. DHCD has the discretion to offer an extension beyond six months where delays are caused by circumstances beyond the control of the developer.

All projects, regardless of award structure, will be required to have a deed covenant/restriction or a lien for a period of 10-years that requires DHCD approval prior to any sale or change in end-use for the property. In

the case of a sale to private sector entity and/or a change of use during the 10-year period, DHCD may require a pro-rated repayment of the IRF funds based on the number of years of the deed restriction remaining.

Match

To demonstrate project viability and the applicant's commitment, applicants are required to provide a 100 percent (1:1) local match from private or public sources. The match must either be cash or documented costs that are directly associated with the improvements to the property where IRF funds are expended. Local match may include federal (CDBG or other), state, local, and private funds spent on activities directly related to the targeted project within the last **full** fiscal year (on or after July 1, 2020).

A locality may use documented administrative costs as up to five percent (5%) of the local match. The use of administrative costs as local match must be outlined in the application and will need to be documented through invoices or payroll records. The locality must provide a description of specific in-kind resources committed, including methods used to determine their value.

***Example:** An applicant that is seeking a \$300,000 IRF grant must provide a match of at least \$300,000 (100% match). Local match in excess of \$300,000 will increase the application's score. This applicant could include up to \$15,000 in documented administrative costs in their \$300,000 match.*

IRF funds may not be used as a substitute for other funds the applicant or end-user has already committed to a project. If the project proposes a for-profit, private end-use, DHCD considers an equity investment by that entity into the IRF project as an indication of long-term commitment to the project.

Eligible Match:

- Acquisition costs - include current property appraisal as documentation of value or documentation of purchase price (HUD-1 Settlement statement, bill of sale or deed), whichever is less;
- Documented costs **directly** associated with **physical activities** on the IRF project site;
- Construction-related soft costs such as engineering, design or architectural activities (must be specifically identified in the application);
- Investments into Machinery & Tools, taxable by the locality;
- Public notices, permit or dumping fees and inspections costs (or waivers of such) directly related to physical activities (must be specifically identified in the application);
- No more than five percent (5%) local match will be accepted as in-kind or cash for out-of-pocket administrative costs.

Ineligible Match:

- State or local taxes;
- Site remediation;
- Interest or principal payments on current debt on the property;
- Investments in Business Personal/Tangible Property (Furniture, Fixtures, and Equipment).

Eligible Use of Funds

The IRF program is flexibly designed so that funds can be used for a wide variety of revitalization and redevelopment activities such as **acquisition, rehabilitation, or repair** (including securing and stabilizing for subsequent reuse) of specific structures, as well as **demolition, removal,** and other **physical activities**. Grant administration is **not** an eligible activity for IRF.

In the case of acquisition, DHCD will limit its financial participation to the property's fair market value and the associated legal costs of acquisition. Fair market value is considered to be the lesser of the property's documented acquisition costs or appraised value. IRF funds may also be used for the legal costs associated with demolition. However, funds may not be used **solely** for acquisition or demolition unless it can be demonstrated that the locality has committed other redevelopment funds to the property, and there is a market-based redevelopment plan outlining reuse options, target markets/niches, and a property marketing strategy including the entity responsible for implementation. Generally, demolition should be used only in circumstances where the size or location of a building precludes any significant redevelopment potential or in cases where there is an imminent safety threat.

Site remediation is **not** an eligible activity for IRF. Virginia's Department of Environmental Quality offers several programs to assist with remediation and environmental assessment including the Voluntary Remediation & Brownfields/Land Renewal Programs. Visit <http://www.deq.virginia.gov> for more information.

It is **not the intent** of the IRF Program to fund the relocation of existing Virginia businesses into a redeveloped structure, particularly if the relocation or expansion occurs simultaneously with the closure or significant reduction of operations in another Virginia locality. If this type of project is proposed as part of a significant expansion, the applicant must demonstrate that it is clearly part of the community or region's economic development strategy and how business relocation has a quantifiable impact on that strategy.

Eligible Properties

According to the Code of Virginia § 36-3, a "blighted property" means any individual commercial, industrial, or residential structure or improvement that endangers the public's health, safety, or welfare because the structure or improvement upon the property is dilapidated, deteriorated, or violates minimum health and safety standards, or any structure or improvement previously designated as blighted pursuant to § 36-49.1:1, under the process for determination of "spot blight."

The program is targeted toward (functionally) **vacant and deteriorated** properties whose poor condition creates a notion of physical and economic blight in the surrounding area, and often is a deterrent to surrounding development. Projects may consist of multiple properties provided they are adjacent and/or adjoining and are related in either their negative impact (e.g., three adjacent severely deteriorated downtown buildings that create a negative impact on the remainder of the block) or end use (e.g., rehabilitation of an abandoned warehouse into a shell building with purchase of adjacent property for parking.)

Eligible properties and structures may be redeveloped for any market-driven purpose including mixed-use, regardless of the original use. For purposes of IRF, mixed-use is defined as "a building incorporating residential uses in which a minimum of **30 percent of the useable floor space** will be devoted to commercial, office, or industrial use or in which **30 percent of the projected project revenue** is derived from the commercial space."

It is **not the intent** of the IRF Program to fund new construction or the development of greenfield properties, unless done in coordination with the redevelopment of an eligible vacant or deteriorated property.

Former Property Uses		
Eligible		Ineligible
<ul style="list-style-type: none"> • Manufacturing • Warehousing • Mining • Transportation • Power Production 	<ul style="list-style-type: none"> • Department stores • Theaters • Hotels • Shopping Centers • School Buildings 	<ul style="list-style-type: none"> • Solely residential • Scattered site projects • Greenfield sites

FUND ACCESS

In the case of **GRANTS**, a contract between DHCD and the grantee outlining end products, conditions, fund disbursement and termination must be executed **before any funds are disbursed**. Funds may only be used for **expenses incurred after the signing of the contract, unless otherwise negotiated with DHCD**. IRF grant funds are available on a **reimbursement basis only**, for costs the applicant has incurred and paid for.

In the case of **GRANT/LOANS**, IRF funding will be released as a grant to the applicant local government entity (or approved Economic Development Authority), or Virginia Community Capital, at DHCD’s sole discretion, who will then make a loan to the private developer pro-rata with other funders or once other sources are expended. This will be determined in discussion with developers upon DHCD’s award notification.

Funding Priorities

The ultimate intent of the IRF program is to fund **shovel-ready** projects that will act as a catalyst to spark additional private investment and job creation in distressed areas that have been targeted for economic development and community revitalization as part of a larger economic restructuring or economic development strategy. Based on that intent, DHCD has established the following funding priorities:

1. Clear relationship to a local or regional economic development strategy.

Applicants must identify the economic development strategy that the proposed project will support. This strategy should be an element of an existing redevelopment, blight removal, or economic development plan, and applicants should cite the specific documents that substantiate the goals of project. Applicants must explain what is currently being done in the community and how the IRF funds will accelerate and expand those economic restructuring and development activities. Additionally, the application should identify why the proposed project is being prioritized for IRF funds over other projects in the locality.

2. High degree of blight and deterioration to be addressed.

Applicants must describe the extent of the physical deterioration and identify the negative impact the property is having in the community. DHCD is seeking to invest in projects that will address the negative impact the property has on the community’s ability to attract private investment and job creation. Applicants must demonstrate that addressing the property is a local priority, and projects that seek to repurpose a property will be given more consideration than projects that focus only on demolition/site clearance. Higher priority will be given to projects involving blight abatement and elimination, than those proposing blight prevention.

3. Project readiness.

DHCD will give higher priority to shovel-ready projects that will lead to the efficient and **immediate** redevelopment of blighted properties. **Readiness scores will be reviewed first by DHCD and a minimum score will be required to be considered for funding.** Projects that can demonstrate “readiness to proceed” will be given the greatest consideration. Readiness to proceed is demonstrated by having **finalized plans** and **primary financing in place** (formal letters of interest, term sheets or letters of commitment) for an identified **end-use/user**. Capacity for project implementation by the locality or developer will also be a consideration in project readiness. For applications requesting grant funding, readiness to proceed should be demonstrated by community support for the project, and the receipt of public input where appropriate. **NOTE:** Any developers, contractors, and professional services funded by an IRF grant must be procured in accordance with the [Virginia Procurement Act \(VPPA\)](#). Applicants should submit documentation to detail that procurement requirements have been met for any professional services contracted to date. Grantees will be required to submit documentation to detail that procurement requirements have been met, prior to any execution of contracts that obligate IRF funds.

Projects that can show the ability to close on the IRF loan or go under contract with DHCD within six months of an IRF award notification will be the most competitive for funding. DHCD reserves the right to withdraw funding should the applicant not be under contract/close the IRF loan in a reasonable amount of time. DHCD also reserves the right to withdraw funding if there are substantial or significant changes to the development team, scope of work or community economic benefit.

4. Project with a clear end use.

Successful applicants will be able to identify a tangible end-use to be completed in a reasonable amount of time, typically an 18-month timeframe. Successful projects will have executed development agreements, commitment letters from non-profit partners, operations/management agreements, leases for space, and detailed operations plans. Projects that have speculative or undetermined end uses will be considered a lower priority. If the application proposes a non-profit end use, the applicant or end user must demonstrate long-term sustainability by providing a 10-year operating pro forma and other documentation of financial solvency.

5. End use will have a clear and significant community economic impact.

Applicants must describe how the project will have a clear positive impact on the community. This includes both the economic impact of the construction process and the end use. Applicants should demonstrate a commitment to ensuring IRF projects seek outreach opportunities for local developers and subcontractors and SWAM certified businesses to participate in the development. Projects should also demonstrate significant private investment when the end user is a private business. Applicants must demonstrate how the completion of the IRF project will be a catalyst to larger economic revitalization efforts in the locality and region and will spark additional investment in the surrounding area. Applicants should include quantified expectations for primary impact (such as net new jobs, new businesses, and leveraged private investment) and any secondary impact (such as increased local sales, meals, or lodging tax revenue, increased export or non-export (tourism) revenues, increased daily and/or overnight visitors, and availability of commercial square footage.) In addition, applicants should describe how the project may be catalytic to the community in non-economic terms (such as access to services or resources, workforce development, and quality of life improvements). Projects that show significant community economic impact will be given higher priority; whereas projects with a public sector end-use will be lower priority. For IRF purposes, a full-time equivalent job is defined as

employment of, at a minimum, 35 hours per week. Existing employees or unpaid volunteer positions should not be included in job creation projections and will not be considered in application scoring.

6. High Economic Distress in project locality.

Extra consideration will be given to projects located in communities that are experiencing higher degrees of distress. However, it is not intended to compensate for poorly conceived projects that do not score well on the other funding priorities. The Industrial Revitalization Fund (IRF) distress index is comprised of three factors: unemployment, fiscal stress, and poverty. From these statistics, individual distressed scores are computed. Finally, the three component scores are averaged together to form a composite score. The composite score is then broken down into four categories based on standard deviations from the average score.

Unemployment

Unemployment adversely affects the disposable income of families, erodes purchasing power, diminishes employee morale, and reduces economy's output. The unemployment index score depends on localities' unemployment rates. The unemployment rate also reflects the local economic conditions as well as localities' ability to generate revenue to provide critical services to its citizens. A higher unemployment rate means less economic activity and reduced revenue sources for the local government.

Fiscal Stress

The ability for a locality to provide services to their citizens depends on their capability to generate revenue from their own sources. A lack of revenue-generating capacity will lead to either a shrinking budget or a gap between revenues and expenditures, which is considered fiscal stress. The fiscal stress index is comprised of three factors: revenue capacity per capita, revenue effort, and median household income. From these statistics, individual stress scores are computed. Finally, the three component stress scores are averaged together to form a composite.

Poverty

Poverty can negatively affect economic growth by affecting the accumulation of human capital and rates of crime and social unrest. Human capital--that is, the education, work experience, training, and health of the workforce--is considered one of the fundamental drivers of economic growth. Also, areas with higher poverty rates experience, on average, slower per capita income growth rates than low-poverty areas.

See Appendix D in the Industrial Revitalization Fund Application Instruction Manual for pre-calculated scores for all cities and counties. Towns may use the distress score of the county, or they may calculate their own based on a calculator provided by DHCD, upon request.

~~Extra consideration will be given to projects located in communities that are experiencing higher degrees of distress. However, it is not intended to compensate for poorly conceived projects that do not score well on the other funding priorities. Distress will be based on three measures below, using data from the U.S. Census Bureau and the Virginia Employment Commission. Scoring will be weighted based on the number of distress measures the locality is experiencing.~~

- ~~a. **Poverty rate** of at least 150 percent of the state average (16.5%);~~
- ~~b. **Median household income** of 70 percent of the state average (\$46,304); and~~
- ~~c. **Unemployment rate** of at least 150 percent of the state average (5.1%)~~

~~See Appendix A for pre-calculated scores for all cities and counties. Towns may use the distress score of the county, or they may calculate their own based on the town's Census tracts, whichever method provides the higher distress score. Guidance on where to find the necessary data is provided on page 16 of the IRF Application Instruction Manual. (Please note DHCD will also be receiving input regarding utilizing the Commission on Local Government's Fiscal Distress analysis to calculate distress)~~

Other Considerations

DHCD encourages localities to apply for projects that will have a strong significance to the broader community and region, in areas of ongoing or identified redevelopment/revitalization. Applicants will receive **bonus points** for projects that meet the following characteristics:

- Part of a significant **regional focus**. This includes projects located in an area covered by a revenue sharing agreement or projects cited in a formal regional economic development plan.
- Eligibility for local real property tax abatements (§58.1-3221) or other **local incentives** to encourage investment.
- Location in an **Enterprise Zone** and ability to qualify for the state and local incentives. **IRF loans** may be included in the Enterprise Zone Real Property Investment Grant schedule of Qualified Real Property investments, while **IRF grants** must be excluded.
- Location in a designated **Virginia Main Street** community, an **Opportunity Zone**, a local, state or federal **historic district**, a **redevelopment or blight removal district**, a **Technology Zone**; or other similar district.
- Location in a current **CDBG project area**.
- Committed project leverage exceeds 1:1 match.
- Commitment to including **SWAM certified** contractors/sub-contractors through solicitation during the bidding and procurement process.

Prioritization

A locality may only submit one application per funding round; therefore, localities must identify and authorize the project that will have the most meaningful impact on local community revitalization and economic development efforts. As such, a resolution from the local governing body authorizing the request for funding is an application requirement. If the locality is applying on behalf of a non-profit or private for-profit, the resolution should indicate the specific match amount and identify the entity that will be responsible for providing the matching funds.

SUBMISSION REQUIREMENTS

Applications for IRF funding must be submitted through DHCD's Centralized Application Management System (CAMS). You can access CAMS using the following link:

<https://dmz1.dhcd.virginia.gov/camsportal/Login.aspx>

SCORING

Funds will be allocated through a competitive process that will give greater priority to projects leading to the efficient and immediate redevelopment and/or reuse of abandoned "industrial" structures. Applications will be evaluated according to a scoring system and projects will be selected for funding on the basis of the

higher scores in descending order until all funds are allocated. Scoring criteria and point allocation will be as follows:

Relationship to Economic Development Strategy	10%
Readiness	30%
End Use Plans	15%
Economic Impact	25%
Distress	15%
Match	5%
TOTAL	100%

A strong application will be able to document that the project is **ready-to-go, but could not be finished without the injection of the IRF funds.**

PERFORMANCE AGREEMENTS & CONTRACTUAL OBLIGATIONS

Successful applicants will be required to sign a contract/performance agreement committing them to the economic outcomes, property use, fund use and match outlined in approved application and any pre-contract/performance agreement negotiations.

All applications, contracts and performance agreements are subject to negotiation with DHCD. All projects will be required to have a deed covenant/restriction or a lien for a period of 10-years that requires DHCD approval prior to any sale or change in end-use for the property. In the case of a sale to private sector entity and/or a change of use during the 10-year period, DHCD may require a pro-rated repayment of the IRF funds based on the number of years of the deed restriction remaining.

All approved projects will be committed to a project completion date of 18 months from contract execution/loan closing, by which all activities must be completed and drawdown requests/loan disbursements submitted to DHCD/VCC. Any project that receives funding and does not use all of its designated funds by the project completion date specified in its contract/loan award may lose the remaining fund balance.

SUBSTANTIAL PROJECT CHANGES AFTER APPLICATION SUBMITTAL

DHCD reserves the right to rescind the funding offer if substantial changes to the project scope and/or financing needs occur after application submittal. DHCD will be concerned of the impact of such on project cash flow, project timing, need for IRF funding, intent of the IRF program, and projected outcomes as outlined in the original application. To maintain consideration for IRF funding, substantial changes to project scope and/or budget will require applicants to provide DHCD with an updated description of the project.

CONTACT INFORMATION

For more information on the IRF program, please contact:



Virginia Department of Housing and Community Development
600 East Main Street, Suite 300
Richmond, Virginia 23219
(804) 371-7171

2018 CODE UPDATE CYCLE – SIGNIFICANT CHANGES

VIRGINIA CONSTRUCTION CODE (VCC)

- **[P] School barricade devices.** Adds language to both the Uniform Statewide Building Code (USBC) and the Statewide Fire Prevention Code (SFPC) that would allow limited use of special barricade devices in schools (Group E and Group B educational occupancies) only in the event of an active shooter or hostile threat situation. Conditions were added to ensure the door can be released from the outside, the inability to move devices from door to door, notification and consultation requirements and the requirement to only use one type of device per school.
- **[P] Nationally recognized guidelines.** Adds provisions to allow the use of nationally recognized guidelines under the modification or alternative methods and materials Sections of Ch. 1. Guidelines such as CC G5-2019 "Guideline for the Safe Use of ISO Intermodal Shipping Containers Repurposed as Buildings and Building Components", can be useful tools in substantiating a modification or approving an alternative method or material where the code is silent.
- **[P] Elevator testing.** Adds a requirement for the name and certification number of the elevator mechanic performing the test to be included on the inspection report, when the test is being witnessed by a third-party inspector. Also added to Virginia Maintenance Code (VMC).
- **[P] Energy certificate.** Brings in International Residential Code (IRC) and International Energy Conservation Code (IECC) requirement for residential buildings that a certificate listing key building efficiency information to be posted in an approved location. This requirement has been in the International Codes (I-Codes) for the last few editions and provides useful information to current and future owners of residential buildings.
- **[P] Blower door testing.** Removes the visual option for verifying building envelope air tightness, requiring blower door testing for residential buildings. Maintains the 2015 leakage rate of 5 Air Changes per Hour (ACH).
- **[P] Sewer relining.** Adds a new section for relining existing sewers and drains in the Virginia Residential Code (VRC) and Virginia Plumbing Code (VPC). Adds references to ASTM F1871 and F1504 for specifications.
- **[P] Rainwater harvesting.** Brings in CSA B805/ICC 805 Standard as an alternative compliance path for rainwater to be used in non-potable applications. This method was approved on the national level to be incorporated into the 2021 International Plumbing Code (IPC) and IRC.
- **[P] Tiny houses.** Incorporates an IRC appendix with provisions specific to tiny homes as an alternative compliance path for homes 400 square feet or less. The appendix from the 2018 IRC is utilized with some amendments to bring in improvements that have been approved for the 2021 IRC.
- **[P] Impervious surface slope.** Decreases the minimum required slope of impervious sidewalks, patios, driveways and landings adjacent to houses from 2% to 1%.
- **[F] Order of precedence.** Trade codes supersede energy codes when addressing same subject matter.
- **[F] Engineering details.** Requires specific engineering details when dry flood proofing is provided.
- **[F] Flood hazard areas documentation.** Buildings and structures in flood hazard areas require documentation of the elevation of the lowest floor to be submitted to the building official.
- **[F] Review board guidance.** Adds Code of Virginia language to VCC, VMC and SFPC to guide the State Building Code Technical Review Board.
- **[F] Updated definitions.** Accessory Dwelling Unit, Dwelling, Substantial Damage, Substantial Improvement and Permit Holder.
- **[F] Residential uses.** Overhaul of residential uses classification sections to provide clarity and simplification.

Note: Items preceded by **[P]** are changes that were approved during the Proposed Regulations Phase and items preceded by **[F]** are changes that were approved during the Final Regulations Phase.

- **[F] Tall wood.** Adds alternative provisions for the inclusion of considering tall wood buildings/mass timber as a construction option.
- **[F] Smoke/heat detection.** New section requiring an automatic smoke or heat detection system where special locking systems are installed on means of egress doors.
- **[F] Gender-neutral facilities.** Updated provisions to incorporate multi-user gender-neutral facilities.
- **[F] Dock safety.** Code requirements for Marinas, Boatyards, and Commercial and Noncommercial Dock Facilities fall under the 2020 edition of NFPA 70.
- **[F] IPC provisions in IBC.** Removes duplicated sections from the International Building Code (IBC) that are found in the IPC and provides pointers.
- **[F] Airport facilities.** Increases female fixture requirements for airport terminals.
- **[F] Wind zone/maps.** Updates the component and cladding values, wind maps, wind zones.
- **[F] Sprinkler pipes in common walls.** Allows water-filled sprinkler piping in common walls separating townhouses.
- **[F] Structural independence exception.** Provides an exception to structural independence where a townhouse is protected by a fire sprinkler system.
- **[F] Carbon monoxide alarms.** Required to be interconnected much like fire alarm systems.
- **[F] Flood hazard areas.** Many updates to buildings constructed in flood hazard areas.
- **[F] Accessory dwelling units.** Adds provisions for accessory dwelling units.
- **[F] Ceiling insulation.** Increases minimum ceiling insulation to R-49 which is a major enhancement in energy efficiency.
- **[F] Arc-fault.** Requires arc-fault circuit interrupters (AFCIs) in locations same as the IRC, with an exception for locations where Ground Fault Circuit Interrupters (GFCIs) are already required.
- **[F] Access for backflow prevention assemblies.** Expands access requirements for backflow prevention assemblies.

VIRGINIA EXISTING BUILDING CODE (VEBC)

- **[P] Alterations.** Many correlation changes and changes related to alterations of existing buildings to eliminate conflicts, or remove requirements to “retrofit” parts of an existing building that are not part of the alterations being performed.
- **[F] New definition.** Roof covering.
- **[F] Additional toilet and bathing facilities.** Additional facilities in assembly and mercantile occupancies shall have not fewer than one accessible family or assisted-use toilet room. Same with recreational facilities.
- **[F] Existing building provisions in the International Energy Conservation Code (IECC).** Moved existing building energy provisions from IECC to the VEBC.
- **[F] Alterations.** Provides multiple provisions for how certain alterations are to comply with the Virginia Energy Conservation Code (VECC) or VRC.
- **[F] Roofing.** Provides multiple provisions for reroofing, roof replacement, roof recovering, and reinstallation of roofing materials.
- **[F] Additions.** Provides multiple provisions by which additions shall conform to the VECC.

VIRGINIA MAINTENANCE CODE (VMC)

- **[P] Elevator testing.** Adds a requirement for the name and certification number of the elevator mechanic performing the test to be included on the inspection report, when the test is being witnessed by a third-party inspector. (Also added to VCC).

Note: Items preceded by **[P]** are changes that were approved during the Proposed Regulations Phase and items preceded by **[F]** are changes that were approved during the Final Regulations Phase.

- **[P] Rodents and insects.** Generally prohibits any rodent harborage and insect infestation, and requires extermination. Previous editions of the code limited requirements for extermination of rodents and insects to those that were causing structure damage.
- **[F] Notice to owner.** Notice must be delivered to owner even when the owner is not the responsible party.
- **[F] Notice to tenant.** Provides provisions by which the tenant must be notified

VIRGINIA STATEWIDE FIRE PREVENTION CODE (SFPC)

- **[P] Fire code edits.** The Fire Code Edits were revisited during the 2018 code update cycle. Over a thousand changes were reviewed by the stakeholders and consensus was reached on 99% of the changes.

VIRGINIA INDUSTRIALIZED BUILDING SAFETY REGULATIONS (IBSR)

- **[P] Shipping containers.** Adds language to provide a clear path for approval of intermodal freight containers to be used as building components in industrialized buildings.
- **[P] Panelized construction.** Adds a definition and fee structure for closed-panel construction to ensure equitable application of registration seal fees to this type of off-site construction method.

VIRGINIA AMUSEMENT DEVICE REGULATIONS (VADR)

- **[P] Trampoline parks.** Adds trampoline courts as regulated amusement devices. References ASTM F2970 Standard for the design, manufacture, installation, operation, maintenance, inspection and major modification of trampoline courts.
- **[P/F] ASTM Standard Updates.** Incorporates newest available editions of all VADR referenced ASTM standards for amusement devices.
- **[F] Fee schedules.** Adds fee schedules for concession go-karts, zip-lines, and coasters exceeding 60 ft. in height.
- **[F] Reinspection fees.** Allows local building departments to increase fees 50% when a reinspection is required.

VIRGINIA MANUFACTURED HOUSING SAFETY REGULATIONS (MHSR)

- **[P] Certificates of installation.** Clarifies the requirements for completion and submission of a certificate of installation and requires a copy to be provided to the homeowner and when requested to the building official. The U.S. Department of Housing and Urban Development (HUD) regulations require a licensed installer to certify that each installation complies with HUD installation standards.

VIRGINIA CERTIFICATION STANDARDS (VCS)

- **[F] New definitions.** Active certificate and inactive certificate
- **[F] Certification status.** Specifies that certificates will either be “active” or “inactive”. “Lapsed” is no longer a certificate category. Provides clarity on circumstances that lead to an “inactive” certificate.
- **[F] Board sanctions.** Clarifies when the Board will issue sanctions.
- **[F] Noncompliance notification.** Places noncompliance notification for certificate holders under the purview of the Virginia Building Code Academy.

Note: Items preceded by **[P]** are changes that were approved during the Proposed Regulations Phase and items preceded by **[F]** are changes that were approved during the Final Regulations Phase.

ITEMS CARRIED OVER TO (OR TO BE CONTINUED IN) THE 2021 CODE UPDATE CYCLE

- In-Building Emergency Communications – Subworkgroup to convene for 2021 code update cycle.
- Both the Energy and Resiliency subworkgroups will continue for the 2021 code update cycle.
- Automatic Sprinklers in R-5 Townhouses – Subworkgroup to convene for 2021 code update cycle. This was a major area where the Board of Housing had differing opinions and has asked DHCD to work with all due haste to convene a workgroup to study the issue and make recommendations as soon as possible.
- Active Shooter Barricade Devices in Public Buildings (Not schools) – Subworkgroup to convene for 2021 code update cycle as required by 2020 legislation.
- On-Demand Mobile Fueling – The Mobile Fueling Study Group report was sent to the General Assembly House Transportation Chair, January 2021.
- Continued advancement in increasing resiliency and energy efficiency will be major priorities of the next cycle along with considering options to increase housing affordability through building technology.

2018 Code Update Cycle – Resiliency Impact Analysis

In response to Executive Order 24, the Virginia Department of Housing and Community Development (DHCD) convened a Resiliency Subworkgroup that met throughout the 2018 code development cycle. The Subworkgroup was tasked with both developing proposals that focus on resiliency and analyzing proposals submitted by others for the 2018 Uniform Statewide Building Code (USBC) to determine effects on resiliency.

The hard labor of the Subworkgroup resulted in eleven proposals approved by the Board of Housing and Community Development (BHCD) for inclusion in the 2018 USBC. The majority of the proposals go beyond the already high levels of resiliency established by the 2018 I-Codes Collection¹, which the 2018 USBC amends, and bring forth provisions from the most current published model codes, the 2021 I-Codes Collection².

The proposals generated by the Resiliency Subworkgroup's efforts (summary attached) have received favorable vote by the BHCD for inclusion in the 2018 USBC.

It is also important to note that the Federal Emergency Management Agency (FEMA) not only endorses all the aforementioned proposals, as a Resiliency Subworkgroup Member, but also the original proponent for most of them.

Resiliency has always been at the heart of code development process, however, given the increase in natural disasters and other climate concerns, resiliency has re-emerged as a key factor in code development. It was only fitting then to add, for the 2018 USBC development cycle, a requirement for code change proponents to include a "Resiliency Impact Statement" along with the proposal. In reviewing these statements, it was evident the proponents did not appear to fully reflect the resiliency impact of the proposal.

As a result, the Resiliency Subworkgroup reviewed all the code change proposals submitted by others to determine their impact on resiliency.

An original two-part analysis (Proposed Regulations & Final Regulations) was performed by DHCD Staff and shared with the Subworkgroup for review and feedback.

While resiliency could appear to be very subjective at time, the industry as a whole has come together and developed several white papers on the subject.

The Alliance for National Community Resiliency³ (ANCR) *"is a 501(c)(3) national coalition of public and private sector stakeholders working to advance community resilience"*; and one of the leaders in the resiliency arena. While there are multiple facets to resiliency, ANCR has developed three Community Resilience Benchmarks™, as follows: Building Benchmark, Housing Benchmark and Water Benchmark. As per ANCR, *"Community Resilience Benchmarks (CRB™s) allow cities to evaluate their resilience within and across these functions and chart a path towards increased resilience."*

Building Benchmark: while the paper's content is very rich in relevant information, the Benchmark Requirement 1) - Adoption of Building Codes - is intimately related to the code development process. The Benchmark is organized across three tiers: Essential Requirements; Enhanced Requirements and Exceptional Requirements. Each level is judged based on the adoption of *"building codes substantially equivalent to the requirements contained in a model*

code that are no more than 9, 6 and 3 years respectively, out of date. The 2018 USBC is based on the 2018 I-Codes. That would place Virginia in the “Enhanced Requirements” category. However, in addition to the proposals mentioned above submitted by the Resiliency Subworkgroup, there is a multitude of other proposals based on the 2021 I-Codes which have been approved by the BHCD for inclusion in the 2018 USBC. Therefore, in some categories, Virginia meets the “Exceptional Requirements” level.

Water Benchmark: one of the principal subjects covered is the conservation of water. This can be achieved in many ways, some of which are covered under *“adopted building codes, standards or guidelines for water conservation that are substantially equivalent to the requirements contained in a model code that is not more than 3 years out of date”*. As previously noted, the 2018 USBC will meet and in some cases surpass this requirement.

A method commonly used for achieving such goal is rain water harvesting. As indicated on page 30 of the Water Benchmark paper, *“Standards for rainwater harvesting systems include CSA B805/ICC 805 Standard for Rainwater Harvesting Systems”*. Code change proposal TP1303.1-18, which has been approved by the BHCD for inclusion in the 2018 USBC, allows CSA B805/ICC 805 to be used as an alternative standard to the provisions already contained in the VPC Section 1303.1 for rain water collection. This proposal constitutes another prime example of code changes based on the 2021 I-Codes as the proposal was modeled after similar 2021 International Plumbing Code⁴ language.

Housing Benchmark: out of the nine Housing Benchmark Requirements covered by the paper, three of them are focused on affordability: Requirement 1. Housing Affordability and Availability; Requirement 2. Housing Affordability: Policies; and Requirement 6. Total Cost of Home Ownership/Rental.

Likewise, the study titled “Addressing the Impact of Housing for Virginia’s Economy” – a joint research effort between four Virginia Universities (Virginia Tech, George Mason University, The College of William and Mary, and Virginia Commonwealth University), at the request of the **Housing Policy Advisory Council**⁵ (HPAC), emphasizes the importance of affordable housing as well as the downside of housing unaffordability. An excerpt from the *Conclusions* drawn at the end of the report reads: *“Virginia faces serious challenges. Housing costs have risen faster than incomes, and nearly one million households need more affordable housing. This shortage of affordable housing reduces productivity, poses challenges for both the current and future workforce, and threatens our economic future”*.

The USBC has also recognized the housing affordability issues underlined in the ANCR and HPAC publications. During the 2018 USBC development, the various stakeholders engaged in the process have continuously strived for reaching the fine balance between safety and affordability, and conform with § 36-99.01 of the Code of Virginia⁶.

The ANCR Housing Benchmark, Preamble, partly reads: *“The safety, sustainability, resilience and affordability of a community’s housing stock has a direct correlation to the community’s overall resilience and the ability of a community to prepare for current and future risks.”*

As reflected by the above white papers, while safety concerns are and should be at the core of building codes development, there are additional aspects and contributing factors to the overall resiliency of buildings, their occupants and communities as a whole. In performing the analysis summarized in the following report, every effort has been made to ensure that the proposals have been reviewed from all vantage points and a comprehensive analysis has been reported to support the resiliency impact as determined by the Subworkgroup.

The Resiliency Subworkgroup has concluded that 28.5% of proposals submitted to amend the Virginia Codes have a neutral impact on resiliency, 4% of the proposals have somewhat of a negative impact, and 67.5% have a positive impact on resiliency overall. Out of those code change proposals with an impact on resiliency – not including proposals with a neutral impact, 6% of the proposals have somewhat of a negative impact and 94% have a positive impact on resiliency overall.

In addition to the resiliency improvements that will result from the Virginia amendments analyzed in this report, it is important to note the final 2018 Virginia regulations also incorporate the resiliency improvements of the updated 2018 edition of the I-codes. As an addendum to this report, the following white papers issued by the International Code Council have been included herein:

- Resilience Contributions of the International Building Code
- The Important Role of Energy Codes in Achieving Resilience

The Resiliency Subworkgroup is committed and eager to continue to improve Virginia's resiliency through code development for the next code update cycle.

RESOURCES

1. 2018 I-Codes Collection¹ - <https://codes.iccsafe.org/codes/i-codes>
2. 2021 I-Codes Collection² - <https://codes.iccsafe.org/codes/i-codes>
3. The Alliance for National Community Resiliency³ - <http://www.resilientalliance.org/the-benchmarks/>
4. 2021 International Plumbing Code⁴ - <https://codes.iccsafe.org/content/IPC2021P1>
5. Housing Policy Advisory Council⁵ - https://www.vchr.vt.edu/sites/vchr/files/publications/HPACReport_AddressingtheImpactofHousingforVirginiasEconomy.pdf
6. § 36-99.01 of the Code of Virginia⁶ - <https://law.lis.virginia.gov/vacode/title36/chapter6/section36-99.01/#:~:text=The%20General%20Assembly%20hereby%20declares,older%20residential%20buildings%20in%20the>

2018 Code Update Cycle - Resiliency Impact Analysis

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
Proposed Regulations				
A103.2-18	Clarifies the applicability of the Virginia Construction Code (VCC), Section 103.2.	Will not increase or decrease resiliency.	The proposal appears to clarify the Section's intent. As indicated by the proponent, the current code language has incorrectly been interpreted by some to mean that the section only applies to "new" construction. The proposal intends to rectify this by deleting the word "new". It is the RSW's opinion that the proposal could have a positive influence on resiliency by virtue of ensuring that the correct code editions are enforced as applicable.	+
A105.2.1-18	Includes High School and College level training programs to the experience/education deemed equivalent to the minimum required years of experience for technical assistants.	This proposal will neither increase nor decrease Resiliency. This is not related to resiliency.	As noted by the reason statement, it is becoming much harder to attract new technical assistants to the code profession. Allowing High School and College graduates that have satisfactorily completed related training to meet the minimum qualifications for technical assistance should help overcome this obstacle. The ICC High School Technical Training Program has already produced many graduates that have successfully passed several ICC Certification Exams. Allowing such graduates to enter the code profession and furthering their already vast code knowledge should only improve the code enforcement as a whole, culminating in code compliant, resilient buildings/structures. It is the RSW's opinion that the proposal could positively impact resiliency.	+
A106.3.1-18	Allows the Building Official to consider nationally recognized guidelines for code modification requests, or, alternative methods/materials.	This proposal will increase Resiliency. This proposal is intended to support the use of published guidelines, from nationally recognized sources, such as CC G5-2019 "Guideline for the Safe Use of ISO Intermodal Shipping Containers Repurposed as Buildings and Building Components" published by ICC, as supporting documentation for a code modification. The published container guideline provide valuable information that a building official can utilize to approve the use of shipping containers as building materials. Allowing the use of shipping containers will provide an additional option for affordable resilient housing.	The RSW agrees with the proponent's resiliency statement.	+
A108.4--18	Deletes the affidavit requirements for permit applicants not subject to licensure.	None.	The proposal correlates the code with the current law; and it does not appear to have an impact on resiliency.	0
A110.5-18	Removes the requirements for Building Official's signature on permits.	This proposal will neither increase nor decrease Resiliency. This has nothing to do with resiliency.	The Building Official's signature on the building permits does not appear to have an impact on resiliency. The RSW concurs with the proponent's resiliency statement.	0
A110.8--18	Adds "non-compliance with provisions of this code and pertinent laws and ordinances" to the reasons for permit revocation.	No impact.	The proposal appears to clarify when the permit could be revoked by the Building Official. Allowing the Building Official to revoke a permit when the project is in non-compliance should aid in avoiding the construction of non-compliant and potentially unsafe projects. It is the RSW's opinion that the proposal could have a positive effect on resiliency.	+
A113.7(2)-18	Requires the name and certification number of the elevator mechanic (performing the required tests) to be listed on the inspection report.	This proposal will neither increase nor decrease Resiliency.	Ensuring that the tests are performed by licensed mechanics is a critical component of a safe installation. Adding the name and certification number of the mechanic to the inspection report, provides for an avenue of verification with the licensure requirements. While test performance by licensed mechanics will not result in safer, more resilient buildings by default, the expectation is that licensed mechanics have obtained the necessary training and experience to perform said tests, thus, resulting in code compliant, resilient systems. It is the RSW's opinion that the proposal could positively influence resiliency.	+
A113.8-18	Revamps VCC Sections 113.8 and 116.1.	This proposal will neither increase nor decrease Resiliency. This is not related to resiliency.	As reasoned by the proponent, the current language does not appear to fully express the Sections' intent. The proposal appears to rectify this issue, provide for much needed clarity and improve the code enforcement uniformity. It is the RSW's opinion that the resiliency could benefit from this proposal.	+
A115.2(3)-18	Clarifies the party(ies) to whom Notices of Violation are to be served.	This proposal will neither increase nor decrease Resiliency. Nothing contained in this proposal impacts resiliency.	The proposal appears to be editorial in nature with no apparent changes to the already existing requirements. The RSW concurs with the proponent's resiliency statement.	0
A116.4-18	Expands the scoping provisions of VCC Section 116.4 to also include post USBC buildings without a Certificate of Occupancy.	Will not increase or decrease resiliency.	The Certificate of Occupancy (CO) is a fundamental document for any building. While requiring this could impose additional stress on the already slim Building Departments, the information contained therein could be of tremendous help for potential future building owners and an invaluable resource for designers during the design phase of any project. Knowing the basic information which a CO contains (such as use/occupancy, construction type, sprinkler vs. no sprinkler, etc.) should aid in facilitating the design and approval of code compliant and resilient alteration/renovation/addition projects. It is the RSW's opinion that the proposal could positively impact resiliency.	+
A119.6-18	Provides for alternative means (electronic) of communicating the time and place of LBBCA meetings.	This proposal will neither increase nor decrease Resiliency.	The code change proposal is administrative in nature and it does not appear to have an impact on resiliency.	0
AD30-18	Adds institutional trampolines and trampoline courts to the list of regulated amusement devices.	This proposal will neither increase nor decrease Resiliency.	Currently, trampolines are not regulated as amusement devices. As such, there are no standards and provisions that they must comply with. This has resulted in multiple accidents and injuries. Regulating such devices and ensuring compliance with the applicable ASTM standard(s) should provide for much more safe and resilient trampolines; and help avoid accidents/injuries. It is the RSW's opinion that the proposal could increase the resilience of trampoline courts and institutional trampolines.	+
AD40-18	Addition of ASTM F2461-18 to the list of applicable amusement device standards.	This proposal will neither increase nor decrease Resiliency. No impact on resiliency.	The addition of ASTM F2461 standard could prove to be very beneficial in the design/construction/enforcement of aquatic play equipment. This should also facilitate uniformity in the enforcement of provisions applicable to aquatic play equipment and provide for safer, more resilient equipment. It is the RSW's opinion that the proposal could have a positive impact on resiliency.	+
AD75-18	Requires the permit application and pertinent documentation/information to be provided to the Building Department at least three days prior to the operation of certain amusement devices.	This proposal will neither increase nor decrease Resiliency. The information is currently required to be submitted. Doing so prior to operation will have no impact.	Providing the information ahead of time should enable the local Building Department to become more familiar with the devices; and be better prepared to inspect and ensure compliance with the applicable provisions. A comprehensive review of the applicable documentation coupled with a thorough inspection should ensure the safety of riders as well as the resiliency of said devices against adverse effects from wind, etc. It is the RSW's opinion that the proposal could positively affect resiliency.	+
B108.1-18	Allows limited type of "barricade" devices on doors serving groups E and B educational.	This proposal will neither increase nor decrease Resiliency.	The number of active shooting events occurring in educational type occupancies in the recent years, has triggered an interest in allowing certain types of locking arrangements in such occupancies. Being able to shelter in place by locking the door(s) could deter the shooter from trying to enter the room and potentially save lives. Thus, although the installation of barricade type devices would not necessarily improve the resiliency of the buildings, it could improve the resiliency of occupants against shooters/other individuals intending to inflict harm onto occupants. It is the RSW's opinion that the proposal will increase resiliency as a whole.	+

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
B202(1)-18	Reverts the definition of "Walls" back to the definition found in the 2012 VCC.	Will not increase or decrease resiliency.	As per the reason statement, the Virginia Existing Building Code provisions could potentially be incorrectly interpreted should the 2015 VCC definition not be changed. Reverting back to the 2012 VCC definition should provide the needed clarity, avoid erroneous code interpretations and improve the code enforcement uniformity. It is the RSW's opinion that the proposal could have a positive effect on resiliency.	+
B408.2.1-18	Updates reference to the correct section.	Will not increase or decrease resiliency.	This appears to be an editorial change and it does not appear to impact resiliency.	0
B428-18	Rewrite of Higher Education Laboratories section based on the 2018 IBC but incorporating Virginia amendments.	Will not increase or decrease resiliency.	In addition to deleting conflicting requirements, the provisions covered by the proposal appear to be more stringent than the current code (i.e. Table 428.3 in the proposal vs. Table 430.3 in the 2015 VCC). The additional limitations imposed should increase the resiliency of buildings against hazards associated with laboratories. It is the RSW's opinion that the proposal will increase resiliency.	+
B703.3-18	Editorial revision to reference the appropriate section.	Will not increase or decrease resiliency.	This appears to be an editorial change and it does not appear to impact resiliency.	0
B905.3.1-18	Adds requirements for standpipes in buildings of four or more stories above grade plane.	This proposal will increase Resiliency. This proposal will ensure that all new structures that are four or more stories above or below grade are equipped to provide critical fire protection infrastructure for interior fire and rescue operations in multi-story buildings.	Improvements to the efficiency of fire fighting operations should provide for safer and more resilient buildings against fire events. The RSW agrees with the proponent's resiliency statement.	+
B907.5.2.3-18	Deletes fire alarm provisions applicable to existing buildings.	Will not increase or decrease resiliency.	As indicated by the proponent, the current provisions have the potential of conflicting with the requirements set forth by the Virginia Existing Building Code (VEBC). Deleting the requirements from the VCC should avoid conflicts and improve consistency in the code interpretation and enforcement. It is the RSW's opinion that improving uniformity in the code enforcement could positively impact resiliency.	+
B912.2.2-18	Removes signage requirements applicable to fire department connections associated with existing buildings.	Will not increase or decrease resiliency.	The proposal appears to delete requirements already found in the Statewide Fire Protection Code (SFPC). The RSW agrees with the proponent's resiliency statement.	0
B916.1-18	Adds exemption from the In-Building Emergency Communication Coverage for buildings in localities which do not provide the required infrastructure.	This proposal will neither increase nor decrease Resiliency. This code provision is not related to resiliency.	Although the proponent makes a very compelling argument regarding resources used in vain, reducing the already impaired requirements, would appear to be against the intent and principles of the code. The proposal appears to be a way out for each jurisdiction from providing the necessary infrastructure for successful fire fighting operations. Weakening the requirements would appear to reduce the resilience of buildings, building occupants and fire fighting personnel against fire events. In this regard, it is the RSW's opinion that the proposal could negatively impact resiliency. However, many newer buildings incorporate newer technology infrastructures (e.g., wireless) or could more easily be retrofitted with wireless capabilities (in lieu of the outdated code required "wired/cabled" systems), thus potentially allowing such buildings to more easily accommodate such emergency systems in more and more existing buildings and to accommodate future considerations, which should have a positive effect on resiliency. It is the RSW's opinion that the proposal could have an overall positive impact on resiliency.	+
B1010.1.10-18	Maintains the same locking arrangements as the 2015 VCC.	This proposal will neither increase nor decrease Resiliency. This change proposal is unrelated to resiliency.	The proposal deletes the additional locking option allowed by the 2018 IBC and reverts back to what the 2015 VCC currently allows. Given that no changes from the current code provisions occur, it is the RSW's opinion that the proposal does not impact resiliency.	0
B1026.2-18	Intends to clarify the requirements for openings through floor assemblies associated with horizontal exits.	This proposal will neither increase nor decrease Resiliency.	The proposal intends to clarify the requirements of Section 1026.2 as it relates to floor openings. This appears to be achieved by specifically requiring openings to comply with the applicable code sections which are now referenced by Section 1026.2. The revised language and the listing of applicable code sections should avoid code misinterpretations and ensure that buildings are constructed in compliance with the intent of the code; thus, resulting in more resilient buildings. Given the above, it is the RSW's opinion that the proposal could have a positive impact on resiliency.	+
B1030.4-18	Relocation of eero (emergency escape and rescue opening) provisions applicable to existing buildings from the VCC to the VEBC.	Will not increase or decrease resiliency.	Given the mere relocation of same requirements from one code to another, it is the RSW's opinion that resiliency will not be impacted by the proposal.	0
B1103.2.8-18	Modifications to raised and lowered areas in places of religious worship.	Will not increase or decrease resiliency.	The proposal appears to match the code language with the actual use of such areas; and it does not appear to have an impact on resiliency. The RSW agrees with the proponent's resiliency statement.	0
B1011.5.2--18	Deletes non applicable reference to the International Existing Building Code (IEBC).	Will not increase or decrease resiliency.	In Virginia the code applicable to existing buildings is the VEBC and not the IEBC. Furthermore, Section 403.1 of VEBC does not cover stairway replacements. Keeping the reference to the IEBC could create conflicts, confusion and possibly misapplication of the code. The proposal intends to address those issues and improve the uniformity of code enforcement. It is the RSW's opinion that the proposal could have a positive effect on resiliency.	+
B3002.4-18	Increases the requirements for the placement of international symbol for emergency services; and adds new exception from the fire resistance requirements of machine rooms/spaces.	Will not increase or decrease resiliency.	The current code provisions require machine rooms/spaces to have the same fire resistance rating as the hoist way enclosure. There currently is, however, an exception for buildings four or less stories above grade plane. Said exception eliminates the requirements for fire-resistance rating of rooms/spaces if certain conditions are met. The proposal adds a 2nd exception which would allow the reduction in fire resistance rating to no more than 1-hour. This exception would normally apply to buildings more than four stories above grade plane. The reason statement indicates that the proposal is intending to get the VCC closer to the IBC in language; and that Virginia should allow for the utilization of another exception that is offered at the national level. a. During the development of the 2012 VCC, by way of consensus for approval by the workgroups, a similar exception which existed in the 2009 VCC/2009 IBC has been deleted. b. It appears that the proposed exception is closer in language to the 2009 VCC/2009 IBC/2012 IBC and not to the 2015/2018 IBC. c. The 2015/2018 IBC, unlike the proposal under consideration, do not allow any of the two (2) exceptions to be applied to rooms/spaces associated with fire service access elevators and occupant evacuation elevators. This was a significant change (code change proposal G171-12) during the development of the 2015 IBC. As indicated by the G171-12 reason statement - which has been approved as submitted, "Section 903.3.1.1.1, items 5 and 6 prohibit sprinklers in machine rooms of fire service access elevators and occupant evacuation elevators. Thus, they are unprotected. As such, they should not be allowed a reduction in enclosure protection." While Section 903.3.1.1.1 does not prohibit, it does allow for the omission of sprinklers in such rooms. When comparing the proposal with the 2015 VCC/2018 IBC, it appears that the latter provide for more resilient fire service access elevators and occupant evacuation elevators. Given the above, it is the RSW's opinion that the proposal could negatively impact the resiliency of buildings containing fire service access elevators or occupant evacuation elevators.	-

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
B3007.6-18	Clarifies that the section referenced is an IBC and not VCC section.	This proposal will not increase or decrease resiliency. It is a clarification to correct a reference to a deleted section in the Virginia Construction Code.	It is the RSW's opinion that clarifying which code section applies could positively influence resiliency by improving the consistency in the application of the code.	+
B3113-18	Deletes the 2018 IBC provisions for Relocatable Buildings.	Will not increase or decrease resiliency.	As indicated by the reason statement, provisions for the relocation of buildings/structures already exist within the USBC. As per the reason statement associated with the IBC code change proposal resulted in the IBC Section 3113 (code change proposal G223-15) said provisions are intended for states that do not have a process in place for dealing with the relocation of modular buildings: "Many states have statutes that govern the building and relocating of relocatable modular buildings. For those that do not have state mandated requirements, much confusion and inconsistency exists about the requirements for relocatable modular buildings as existing buildings." Introducing one more section dealing with the relocation of buildings could create potential conflicts and non-uniformity in the USBC enforcement. It is the RSW's opinion that deleting Section 3113, as intended by the proposal, the resiliency could be positively influenced.	+
B3302.1-18	Deletes certain VCC provisions (already in the VEBC) applicable to existing buildings.	Will not increase or decrease resiliency.	Having similar requirements in more than one code book could result in future potential conflicts and erroneous code enforcement; i.e. during the code development process, the provisions in one of the code books could be amended while those in the other code book could be overlooked. An example of this instance is the location of plumbing facilities located on cemetery properties, VCC Section 2902.3.2 vs. VPC Section 403.3.3. The proposal appears to prevent such occurrences. It is the RSW's opinion that the proposed change could have a positive effect on resiliency as a factor of correct code application.	+
B3310.1-18	Deletes certain VCC provisions (already in the VEBC) applicable to existing buildings.	Will not increase or decrease resiliency.	Similar with B3302.1-18 above. It is the RSW's opinion that the proposed change could have a positive effect on resiliency as a factor of correct code application.	+
BAQ104.1.2-18	Several changes to the Appendix Q - Tiny Houses.	This proposal will neither increase nor decrease Resiliency.	The proposal modifies and adds new sections to the Appendix Q. The modifications and additions appear to clarify and increase the stringency of the requirements imposed by the 2018 IRC. I.e. it clarifies how the ceiling height must be measured; provides dimensions for intermediate and bottom landings; increases the loading requirements for ladders; specifically indicates that the guards must comply with the opening and loading requirements in Chapter 3; etc. While the amendments do not necessarily improve the resiliency of Tiny Houses, it appears to increase the resiliency of their occupants against possible falls and other types of accidents. It is the RSW's opinion that the code change will improve resiliency overall.	+
CS41-18	Editorial change.	This proposal will neither increase nor decrease Resiliency.	The proposed change is editorial in nature and it does not appear to have an impact on resiliency.	0
E402.4-18	Reduces the SHGC from 0.4 to 0.36.	This proposal will increase Resiliency. This proposal will make buildings more resilient. Low-SHGC windows maintain better occupant comfort by reducing the volatility of indoor temperature swings. Moreover, these windows will help maintain more livable conditions during power outages due to natural emergencies. These improvements fall squarely within the Governor's directive to the Department of Housing and Community Development to identify "resilience-specific improvements to the Uniform Statewide Building Code (USBC) for inclusion in the 2018 code update," in Executive Order 24 from November 2018. At the macro level, buildings currently account for over 40% of the nation's energy use and over 70% of the nation's electricity use. A significant portion of that electricity comes from burning fossil fuels, which is one of the causes of climate change. Improvements in efficiency – particularly peak electric demand reductions – will help curb Virginia's need to build and site peak generation (which tends to be both more expensive and more carbon-intensive). Low-SHGC fenestration is designed to reduce cooling demand during the hottest hours and months of the year, providing these additional benefits to building owners and all Virginia's citizens. It is well within Virginia's interests in improving resiliency to a changing climate to reduce energy demand wherever possible.	The RSW agrees with the proponent's resiliency statement.	+
E403.2.8-18	Deletes energy requirements associated with kitchen exhaust systems.	This proposal will neither increase nor decrease Resiliency. It is possible that this will decrease resiliency, however it will most certainly increase life safety.	Deleting the existing Virginia Energy Conservation Code (VECC) requirements for kitchen exhaust systems - which have the potential to provide for significant energy savings, would appear to reduce resiliency. However, while aiding with energy savings, it appears that the current limitations prohibit the kitchen exhaust systems from functioning as required to produce the intended results. Not exhausting the smoke and grease laden vapors would defeat the purpose of installing such exhaust systems; and could potentially expose the buildings and their occupants to dangerous environments. Considering the above, it is the RSW's opinion that the proposal could have an overall neutral effect - at worst, or, a positive effect - at best, on resiliency.	+
EB103.5-18	Clarifies the inspection requirements associated with the changing of fuel burning appliances/equipment.	This proposal will neither increase nor decrease Resiliency. No impact on resiliency.	As indicated by the proponent, the current language does not appear to correctly communicate the original intent of the Section. Deleting the provisions from the current location, will enable the reader to correctly determine which fuel burning equipment/appliances must be inspected by referring to VCC Section 113.3.1. Given the clarification and the expected improvement in the uniformity of code enforcement, it is the RSW's opinion that the proposal could have a positive effect on resiliency.	+
EB103.10-18	Editorial change.	Will not increase or decrease resiliency.	This appears to be a minor editorial change with no effect on resiliency.	0
EB103.10 (Option B)-18	Deletion of "Work Area" definition and significant revisions to Chapters 6 and 7 of the VEBC.	Some may suggest this proposal will decrease resiliency because less of the existing building will be updated/upgraded; however, it could also be argued that if that "other" work was required, the applicant might just walk away from the project and not do ANY new work - or greatly reduce the amount of the intended work to avoid the increased requirements anyway. So, in that respect, one might argue that this proposal incentivizes the rehabilitation of the building and therefore, increases the resiliency to the extent it would not otherwise have been done.	The RSW agrees with the proponent's resiliency statement.	+
EB302.1-18	Removes retrofit type language pertaining to existing materials.	This proposal will neither increase nor decrease Resiliency. This code change is not related to resiliency.	The USBC's intent has always been to allow the continuance use of existing building components, features, equipment, etc. so long as they are in compliance with the applicable code provisions in effect at the time of their construction/installation. The existing code language, however, goes against this principle. As indicated by the reason statement, this could result in potential high costs added to any given renovation. The additional expense triggered by this code section could actually deem potential renovation projects to be cost prohibitive. As such, buildings could be left to continue to deteriorate and reduce their resiliency. The proposal removes the retrofit type language and should assist in promoting the renovation of existing buildings/structures which otherwise would not be feasible to be renovated; thus increasing their resiliency. It is the RSW's opinion that the proposal could have a positive effect on resiliency.	+

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
EB303-18	Consolidation of the VEBC Section 303 -Fire Escapes	This proposal will neither increase nor decrease Resiliency. Fire escapes do not impact resiliency.	In addition to consolidating the Section, the proposal also eliminates a conflict within it. Eliminating the conflict should streamline the interpretation and enforcement of the code provisions and result in more uniform code application. Also, the alleged reduction in construction cost, for some projects, could increase the eligibility of certain buildings to be renovated. It is the RSW's opinion that the proposal could positively impact resiliency.	+
EB304.1-18	Editorial change regarding glass replacement.	This proposal will neither increase nor decrease Resiliency. This is an editorial change.	Although the proposal rewrites and deletes (from certain VEBC Chapters) the replacement glass provisions, the requirements appear to remain the same. The RSW agrees with the proponent's resiliency statement.	0
EB304.3(1)-18	Clarifies that sections referenced are VCC sections.	Will not increase or decrease resiliency.	Indicating that the sections referenced are from the VCC should avoid any confusion which the current provisions may create; and ensure that the intent of the section is achieved. The approval of the proposal should result in an improvement in the uniformity of code application. It is the RSW's opinion that the change could have a positive effect on resiliency.	+
EB304.3(2)-18	Adds R-5 occupancies to the R-groups covered by this Section.	Will not increase or decrease resiliency.	This proposal compliments the previous one [EB304.3(1)-18] by including R-5 occupancies and the related VRC references. As reasoned by the proponent, the 2015 VEBC although could be used for work on existing buildings housing R-5 occupancies, Section 304.3 only covers R-2 and R-3 occupancies. The current provisions of Section 304.3 work fine for IEBC and/or IRC, however, given the fact that the R-5 occupancy is specific to Virginia, single family dwellings would not be covered by this Section. The proposal intends to fill this gap; thus, providing the reader with the necessary tools to address the replacement of windows serving as eero's. It is the RSW's opinion that the proposal could have a positive impact on resiliency.	+
EB305.1-18	Editorial change.	Will not increase or decrease resiliency.	The proposal replaces the word "relocation" with the word "moving" which is more appropriate for Industrialized Buildings; and deletes no longer applicable code provisions/language. The RSW agrees with the proponent's resiliency statement.	0
EB307.3.1-18	Section reformatting; and deletion of requirements applicable to existing materials.	This proposal will neither increase nor decrease Resiliency. This is editorial.	Current exceptions to the VEBC Section 307.3.1 are proposed to be relocated and converted from exceptions (to the requirements), to requirements themselves. Additionally, it deletes the provisions applicable to existing materials set forth by Section 307.7.1.1. As indicated by the proponent, if the materials are not removed/repared/alterd or otherwise part of work under the scope of VEBC, are allowed to remain in use by default. The current language appears to give the Building Official the authority to determine whether any given existing material is "unsafe" and if deemed so, he/she could order the removal/replacement of said existing material. This appears to be in contrast with the intent of the code and a very subjective proposition; i.e. the same building material, in the same condition and location could potentially be viewed as "safe" or "unsafe" by different individuals. The proposal appears to correct this issue and promote code enforcement uniformity. Given the later part of the proposed change, it is the RSW's opinion that the proposal could have a positive influence on resiliency.	+
EB402.1-18	Replaces the "aggregate area" with the "building area"	Will not increase or decrease resiliency.	The "aggregate area" are not code defined terms. The proposal suggests using "building area" instead, which is a defined term (in the VCC and therefore the VEBC per VEBC Section 201.3). Using a defined term should eliminate any confusion regarding the percentage of what area must not exceed 50. Incorrectly interpreting the section in question could lead to significant construction cost increases; and ultimately result in projects stagnant in the planning phases. It is the RSW's opinion that the proposal could positively affect resiliency.	+
EB403.1-18	Editorial change.	This proposal will neither increase nor decrease Resiliency. This is editorial.	The change updates the referenced sections with the correct sections and it does not appear to have an impact on resiliency.	0
EB404.4.4-18	Editorial change.	Will not increase or decrease resiliency.	While the proposal eliminates unnecessary and non applicable language, it appears to have a neutral effect on resiliency.	0
EB404.4.10-18	Single-user toilet and bathing rooms added to the scoping provisions of the VEBC Sections 404.4.10 and 405.1.4.	Will not increase or decrease resiliency.	The proposal revises the scoping provisions to more accurately match the 2018 I-codes language; and it appears to eliminate the confusion in applying the requirements set forth by the sections under consideration. It is the RSW's opinion that the proposal could have a positive impact on resiliency.	+
EB501.1(1)-18	Revisions to the scoping provisions.	Will increase resiliency, by allowing the repairs of existing facilities without the potential of having to forego the repairs or demolishing the building.	The RSW agrees with the proponent's resiliency statement.	+
EB501.1(2)-18	Editorial change.	This proposal will neither increase nor decrease Resiliency. This is editorial.	The proposal deletes the Exception to VEBC 501.1, which appears to be non-necessary and redundant language; and re-numbers certain sections. The technical requirements do not appear to be altered by this proposal. The RSW concurs with the proponent's resiliency statement.	0
EB601.1(1)-18	Editorial change.	Will not increase or decrease resiliency.	Redundant and/or non-applicable language is proposed for deletion. In addition, the scoping provisions are revised to include the entire Chapter 9 and not just Section 905.1. The proposal does not appear to have an impact on resiliency.	0
EB601.1(2)-18	"Substantial structural alteration" caveat deletion.	This proposal will neither increase nor decrease Resiliency.	As indicated by the proponent, the current language could be misinterpreted as not allowing the exception to be utilized if substantial structural damages are present. If so, the added cost associated with this could be significant and prohibit owners from repairing the affected buildings/structures. As such, while the proposal could give the impression of reducing resiliency, considering the overall impact, it would appear that the resiliency could actually be improved by allowing the repairs to comply with the building code under which the buildings/structures were built. Any level of repair is better than no repairs at all. It is the RSW's opinion that the proposal will positively impact resiliency.	+
EB601.1(3)-18	Editorial change.	Will not increase or decrease resiliency.	The proposal appears to be editorial in nature with no apparent impact on resiliency.	0
EB601.2.1-18	Levels I and II alterations - scoping revisions.	This proposal will neither increase nor decrease Resiliency. This change corrects a hole in the code. The proposal reflects the way it is being taught in the DHCC course; therefore, it should not be a change in code application.	The change intends to codify an already existing practice. Without the added clarification, such scopes of work could be misinterpreted as requiring a higher level of alterations (Level 2 or even a Level 3, depending on how it is interpreted). If so, the added cost associated with this could be significant and prohibit owners from proceeding with any alterations. As such, considering the overall impact, it would appear that the resiliency could actually be improved by allowing the alterations to comply with Level 1 alteration requirements. Allowing such alterations is going to be better than no alterations at all. It is the RSW's opinion that the proposal will positively impact resiliency.	+

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
EB603.4.3-18	Flame spread index revisions.	Will not increase or decrease resiliency.	The proposal provides a direct reference to the VCC Table 803.13 and deletes the references to ASTM E84 and UL 723. The proposed reference is all encompassing by also including materials that could(ve) be(en) tested and classified in accordance with NFPA 286. This part of the change would appear to ensure that all the existing interior trim and finish materials will be provided with a minimum degree of protection against flame spread. Thus, have a positive influence on resiliency. The change, however, also adds the words "permitted to be". As a result, it now appears that Section 906.9 of the 2018 VEBC, unlike 2015 VEBC, does not require existing nonconforming interior finish and trim materials to be surfaced with a fire retardant coating, but it allows them to be coated. The question is then, if Section 906.9 permits the coating of materials, does it mean that a minimum threshold of compliance with the flame spread levels is no longer required? If so, and this was intentional in order to avoid costly construction with the expectation that more buildings will be renovated, perhaps it could improve the resiliency of certain buildings. However, eliminating the basic flame-spread requirements, would appear to make the buildings and their occupants more vulnerable to fire events. Considering all the above, it is the RSW's opinion that the change could have a negative impact on resiliency.	-
EB603.4.5-18	Deletes the condition of "Where approved by the code official".	Will not increase or decrease resiliency.	The USBC has always been intended to be enforced uniformly throughout the Commonwealth, hence the title. The existing language is very subjective, however, and it appears to promote the non-uniformity of code application. The proposal appears to correct this matter and potentially avoid possible erroneous code interpretations. It is the RSW's opinion that the proposal could have a positive impact on resiliency.	+
EB802.2-18	Clarifies the Exception's intent.	Will not increase or decrease resiliency.	Much needed clarification appears to be provided by the proposed change. In some instances the addition of stairways and/or elevator shafts would be required to be added onto a building due to a change of occupancy/space re-configuration/increased occupant load/etc. Prohibiting and/or requiring fire separation or a sprinkler system due to the mere construction of such spaces could stall the rehabilitation of existing buildings. In addition to an expected increase in the uniformity of code enforcement, the proposal also appears to support the renovation of existing buildings which should increase the resiliency of such buildings. It is the RSW's opinion that the proposal could have a positive effect on resiliency.	+
EB904-18	Deletion of Section 904, revisions to Section 905 and re-write of Section 906.	Will not increase or decrease resiliency.	The proposal appears to clean up the provisions found throughout the Sections and removes non-applicable and in some instances - what would appear to be - retrofit requirements. As the proponent has reasoned, this chapter should "encourage" the rehabilitation of historical buildings not make it difficult to renovate them. The code change appears to achieve that goal, thus, having the potential of increasing the resiliency of historical buildings, which in many cases, are left in derelict conditions due to cost issues. It is the RSW's opinion that the proposal will positively impact resiliency.	+
EB904.10.1-18	Clarifies the required guard height.	Will not increase or decrease resiliency.	As expressed by the proponent, the existing code requirements are ambiguous and could be misinterpreted. The proposal intends to satisfactorily address this issue by clarifying that the height of existing guards are to be deemed acceptable. This should improve the code enforcement uniformity and avoid incorrect code interpretations. It is the RSW's opinion that the proposal could have a positive effect on resiliency.	+
EB1401.6.1-18	Editorial change.	Will not increase or decrease resiliency.	The proposal changes current reference to the IBC with a reference to the VCC; and it does not appear to affect resiliency. The RSW concurs with the proponent's resiliency statement.	0
EB1401.6.3-18	Allows for interpolation in determining the compartmentation value.	Will not increase or decrease resiliency.	The current code is vague when it comes to this subject, which normally leads to varied code interpretations. The codification of this issue should increase the uniformity in the code interpretation and appears to ensure that the intent of the code is achieved. It is the RSW's opinion that the resiliency could benefit from this proposal.	+
EB3303.1-18	Relocates Demolition provisions from VCC to VEBC.	Will not increase or decrease resiliency.	While the proposal relocates the Demolition provisions to the VEBC - the appropriate code, it does not appear to impact resiliency. The RSW agrees with the resiliency statement by the proponent.	0
FP103.2.1 (VFSB SFPC Edit Part 1)-18	Extensive editing of several Statewide Fire Prevention Code (SFPC) Chapters.	This proposal will neither increase nor decrease Resiliency. No information from proponent.	This is a joint effort between several stakeholders (i.e. Fire Services Board, Virginia Building and Code Official's Association, Apartment and Office Building Association, etc.) to edit the provisions of the International Fire Code (IFC) - which is a code intended to be applied to new construction, to more accurately fit within the scoping provisions of the SFPC - a code meant to be applied to existing buildings, as a maintenance code. It is the RSW's opinion that the proposal could have a positive impact on resiliency via expected improvement in the uniformity of code enforcement across the Commonwealth.	+
FP202(1)-18	Enhancement of "corrosive" definition.	This proposed change to a definition will neither increase nor decrease Resiliency.	Quantifiable physical properties are added to the "corrosive" definition which should aid plan reviewers in determining compliance with the applicable code requirements. It is the RSW's opinion that the improved definition could positively impact resiliency.	+
FP202(2)-18	Revision of "Permissible Fireworks" definition.	This proposed update to a definition will neither increase nor decrease Resiliency.	The current definition is proposed to be amended to match the most current Code of Virginia changes. The proposed definition appears to set certain limitations on the effects of fireworks (i.e. burning effects distance, no explosion, no reloading, etc.), thus, potentially improving the resiliency of buildings and humans against such effects. It is the RSW's opinion that the proposed change could have a positive effect on resiliency.	+
FP202(3)-18	Editorial change to "Restricted/unrestricted explosives manufacturing".	This proposal will neither increase or decrease resiliency.	This appears to be an editorial change with no impact on resiliency.	0
FP316.6-18	Restricts storage underneath bridges or elevated roadways.	This proposal will neither increase nor decrease Resiliency.	Judging based on the example provided in the reason statement, it appears that storage underneath bridges and elevated roadways poses a significant danger to such structures. Introducing code language prohibiting this activity will provide the code enforcement personnel with the necessary tool to proactively avoid unfortunate events similar to that referenced in the reason statement. It is the RSW's opinion that the proposal will increase resiliency.	+
FP1031.2.1-18	Removes the requirement for approval of security devices by the Fire Code Official.	No impact.	The installation of security devices affecting the means of egress require a building permit/review/approval by the Building Official and not the Fire Code Official. The proposal clarifies this provision which should help with improving the uniformity of code enforcement. It is the RSW's opinion that the proposal could have a positive impact on resiliency.	+
IB20-18	Requires administrator's approval (via modification) for the use of intermodal freight containers.	This proposal will neither increase nor decrease Resiliency. This change is administrative in nature and does not impact resiliency.	The RSW agrees with the proponent's resiliency statement.	0

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
IB260-18	Revises the "Industrialized building" definition and adds "Closed panel construction" definition.	This proposal will neither increase nor decrease Resiliency. This change is administrative in nature and will not impact resiliency.	The RSW agrees with the proponent's resiliency statement.	0
MH10-18	Adds new definition for "Certificate of installation" and revises the "Installer" definition.	This proposal will neither increase nor decrease Resiliency. None.	The RSW agrees with the proponent's resiliency statement.	0
MH60-18	Requires the installer to provide a Certificate of Installation to the homeowner; and to the Building Official - when requested.	This proposal will neither increase nor decrease Resiliency. None.	The RSW agrees with the proponent's resiliency statement.	0
PM103.2.3-18	Adds informational note for code officials regarding the responsible party; and the authority to request documentation.	This proposal will neither increase nor decrease Resiliency.	As per the reason statement, some code officials may not be aware that the General Assembly has authorized the transfer of certain duties and responsibilities from the landlord to the tenant. As such, without this knowledge, the code officials could possibly cite the incorrect party; and the party cited may (rightfully so) refuse to take corrective action. This could result in prolonged periods of time during which the buildings/structures will continue to be in a state of disrepair, potentially unsafe, or otherwise non-compliant. The proposed informational note appears to aid with avoiding such situations. Ensuring that the Notice of Correction/Violation is being issued to the appropriate/responsible party should expedite the necessary repairs, therefore improving the resiliency of buildings/structures. It is the RSW's opinion that the proposed code change could positively impact resiliency.	+
PM104.5.3.2-18	Correlates the requirements with proposal A113.7(2).	This proposal will neither increase nor decrease Resiliency. This proposal is administrative in nature and will not impact resiliency.	Ensuring that the tests are performed by licensed mechanics is of utmost importance. Adding the name and certification number of the mechanic to the inspection report, provides for an avenue of verification with the licensure requirements. While test performance by licensed mechanics will not result in safer, more resilient buildings by default, the expectation is that licensed mechanics have obtained the necessary training and experience to perform said tests, thus, resulting in code compliant, resilient systems. It is the RSW's opinion that the proposal could positively affect resiliency.	+
PM106.3-18	Deletes retrofitting provisions.	This proposal will neither increase nor decrease Resiliency. This has nothing to do with resiliency.	By removing the authority appeared to be given to code officials - by current code provisions, in mandating the retrofit of buildings, an argument could be made that the proposal would negatively impact resiliency. I.e. imposing certain repairs or improvements to existing buildings could make them more resilient. However, the current requirements are very subjective and appear to provide for an environment of great non-uniformity in the code enforcement. Considering the overall impact of the proposal, it is the RSW's opinion that the code change will have a neutral effect on resiliency.	0
PM302.5-18	Rodent Harborage and Infestation amendments.	This proposal will neither increase nor decrease Resiliency. This proposal does not increase the potential for natural disasters or climate change.	After a first read, it would appear that the proposed text would make the requirements more stringent and the buildings could become more resilient to rodents, pests, insects, etc. However, the revised definition introduces - what would appear to be, a very biased term, "sufficient (number)". Such terms have the tendency to "promote" non-uniformity in the code enforcement; and potentially could lead to dilapidated structures based on one's understanding of "sufficient number to adversely affect the structure...". Considering the overall effect of the proposal, it is the RSW's opinion that the code change will have a neutral effect on resiliency.	0
PM304.1-18	Deletes the "health, safety, welfare and sanitary" requirements.	No resiliency statement?	While the "health, safety, or welfare" provisions are currently also addressed by Section 102.1 as pointed out by the reason statement, the "sanitary" provisions do not appear to be covered somewhere else. As hinted by the proponent, the "sanitary" is being referred to by the IPMC Commentary as "accumulation of litter or debris on porches and other parts of the exterior structure." Excessive accumulation of debris, or materials of sorts, could be detrimental to the structure and it could promote rodent and insect infestation. None of which are good for the structures. Since debris accumulation on the exterior portions of the structures (i.e. porches, decks, etc.) or against the exterior walls would affect "the exterior of the structure", it would appear to be safe for Section 304 - Exterior Structure to contain such "sanitary" provisions. Removing them would appear to have a negative impact on the resiliency of buildings against rodents, insects, etc. However, given the fact that the Property Maintenance Code is an elect code and only certain jurisdictions across the Commonwealth chose to enforce it, the impact of the proposal will only be seen in said localities. Furthermore, 15.2-901 of the Code of Virginia allows localities to address the disposal of trash and similar items by means of local ordinance. It is the RSW's opinion that the proposal could have a slight negative impact on resiliency.	-
PM304.18-18	Editorial change	This proposal will neither increase nor decrease Resiliency. This proposal is not related to resiliency.	The proposal updates the sections under consideration with correct code references; and removes non necessary ones. The RSW agrees with the proponent's resiliency statement.	0
PM602.4-18	Reduces the maximum allowed temperature within R-2 apartment buildings from 80 to 77 degrees F.	This proposal will neither increase nor decrease Resiliency.	The change intends to codify the emergency cooling regulations adopted by the Board of Housing and Community Development and approved by the Governor. The reduction in temperature should increase the resiliency of the occupants of such buildings, especially the geriatric ones. In addition, the buildings should also benefit from the reduced temperature as a factor of lower humidity levels normally associated with lower temperatures/proper functioning Air Conditioning systems. Excessive humidity, if uncontrolled, could lead to mold and/or rot. It is the RSW's opinion that the proposed change will have a positive impact on resiliency.	+
PM603.7-18	Introduces new maintenance requirements for fuel tanks and systems.	No resiliency statement?	The current Virginia Maintenance Code (VMC) appears to be silent as it relates to the subject at hand. The proposal intends to address this by providing the local jurisdictions - enforcing the VMC, with the necessary code language to address such systems. Fuel tanks, containers, piping, etc. if not properly maintained could lead to considerable damage to the surrounding buildings/structures and occupants. Maintaining said systems in proper working condition, in compliance with the code under which they have been installed should avoid such damages and increase the resiliency of said buildings/structures and occupants. It is the RSW's opinion that the proposal will improve resiliency.	+
PM702.1-18	Deletion of IFC reference and coordination with the SFPC.	This proposal will neither increase nor decrease Resiliency. This proposal is not related to resiliency.	The proposal attempts to remove an incorrect reference to the IFC and requires the existing means of egress to be maintained in accordance with the applicable building code and the SFPC. Revising the language in a manner which clarifies the intent of the Section should lead to correct code enforcement and properly maintained and resilient buildings. It is the RSW's opinion that the proposal could have a positive effect on resiliency.	+

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
RB311.3.2-18	Changes the elevation of landings/floors at exterior doors other than the required egress doors.	This proposal will neither increase nor decrease Resiliency. No impact on resiliency.	While the proposal appears to provide for language consistent with other provisions of the code, it does not appear to have an impact on resiliency. The RSW agrees with the proponent's resiliency statement.	0
RB332-18	Allows for alternative provisions for dwellings 400 square feet or less in area (aka Tiny Houses).	This proposal will neither increase nor decrease Resiliency.	The RSW agrees with the proponent's resiliency statement.	0
RB401.3-18	Reduces the required slope of impervious surfaces from 2% to 1%.	This proposal will neither increase nor decrease Resiliency. Allows for flexibility to meet requirements of both code sections while still moving water away from foundation. No quantifiable impact on resiliency.	Although, the reduced slope will be quite difficult to adequately enforce, unless a digital level is used during inspections (which the majority of inspectors are not equipped with), the correct installation of impervious surfaces with the (reduced) minimum slope should not have an impact on resiliency. The RSW agrees with the proponent's resiliency statement.	0
RB403.1.6-18	Revisions to coordinate with IBC language.	This proposal will neither increase nor decrease Resiliency. This clarifies the intent of the code and is not intended to impose requirements that are not already implied in the code.	The proposal intends to achieve three (3) results, as follows: (1) revise current language to match the text in the IBC; (2) specifically require that bolts are made out of steel and (3) that they must be embedded vs. extended into concrete or masonry. The clarifications regarding bolt material and embedment requirements coupled with language consistent with the IBC should eliminate any confusion and improve the uniformity and accuracy of code interpretation and application. Code compliant buildings are resilient buildings. It is the RSW's opinion that the proposal could positively impact resiliency.	+
RB408-18	Clarifies the section's intent.	This proposal will neither increase nor decrease Resiliency. This code change clarifies current intent and therefore has no impact on resiliency.	The current code provisions provide the opportunity for misinterpretations due to duplicated and confusing language. The proposal appears to solve this issue by consolidating and reformatting the section. This should promote more uniformity in the enforcement and avoid the construction of potentially non-compliant buildings due to erroneous code interpretations. It is the RSW's opinion that the proposal will positively impact resiliency.	+
RE401.2-18	Updates the REScheck to the 2018 IECC.	This proposal will neither increase nor decrease Resiliency. This proposal will not directly impact the resiliency of buildings.	Whilst using REScheck is not a requirement but an option, the 2018 IECC has increased the energy provisions. Using REScheck based on the 2018 IECC for demonstrating compliance, should yield buildings that are more energy efficient, thus improving their resilience against environmental conditions. It is the RSW's opinion that the proposal could positively impact resiliency.	+
RE401.3-18	Restores the requirement for energy Certificate.	This proposal will neither increase nor decrease Resiliency. This proposal will have no direct impact on resiliency.	As indicated by the proponent, the energy features of a building are of great importance for owners and future renovations/alterations/etc. In accordance with the Library of Virginia, the building permit records are disposed off by the majority of local Building Departments, three years after the CO issuance/Final Inspection approval. As such, it would be nearly impossible for future building owners to determine the energy features of any given building. Posting a certificate containing said information could prove to be a very valuable resource for future building alterations/renovations/etc.; and could assist with maintaining and improving the resilient features of existing buildings. It is the RSW's opinion that the proposal could positively impact resiliency via future building renovations/alterations.	+
RE402.4.1.2-18	Re-writing of the air sealing/air leakage provisions.	This proposal will increase Resiliency. This proposal will increase the resiliency of homes. A properly sealed home will help maintain better indoor air quality and improve the long-term durability of the home. It will also reduce the volatility of indoor temperature swings and maintain more livable conditions during power outages due to natural emergencies. These improvements fall squarely within the Governor's directive to the Department of Housing and Community Development to identify "resilience-specific improvements to the Uniform Statewide Building Code (USBC) for inclusion in the 2018 code update," in Executive Order 24 from November 2018. It is also critically important that the homebuilder and homeowner understand the actual air leakage rate of the home so that ventilation strategies can be employed in a manner that will maintain occupant health. Relying on a "visual inspection" instead of objective testing is not a safe, long-term strategy for making homes resilient and healthy for occupants.	The RSW concurs with the proponent's resiliency statement.	+
RE403.3.5-18	Removes the prohibition of using building framing cavities as ducts or plenums.	This proposal will neither increase nor decrease Resiliency. This is a code correlation issue.	Current prohibition imposed by the section under consideration directly conflicts with other codes, which allow the use of building framing cavities as ducts or plenums. Conflicts lead to non-uniformity in the application of the code and potential non compliant buildings. The proposal intends to sort out this issue by removing the conflict. It is the RSW's opinion that the proposal could have a positive effect on resiliency as a result of improved code compliance.	+
RTP3011-18	Adds new section for relining of existing sewers.	This proposal will increase Resiliency. Reducing open trench excavation, assisting with preservation of the natural environment and limiting destruction of private property will help increase resiliency.	Notwithstanding the alternative materials and methods provisions of the current code, replacing an existing sewer in compliance with the applicable "prescriptive" provisions of the current code is an expensive proposition, as indicated by the proponent. In many instances there are also additional permits required for digging up and replacing existing sewers, such as street cut permits, sidewalk cut permits, street closure permits, etc. Furthermore, many utilities are located on or crossing adjacent parcels; some are located on recorded easements and some are not. All of the aforementioned costs and "road blocks" have the potential of delaying the replacement of existing systems which show early signs of trouble. Waiting until the inevitable happens only adds to the costs. Providing for a codified alternative should be of great assistance for all the parties involved, i.e. building owners, contractors, code officials, etc. As a benefit, it could "encourage" the repair/relining of existing systems at an earlier stage, thus improving the resilience of said systems and the buildings they serve. The RSW agrees that the proposal could have a positive impact on resiliency.	+
TM505.6-18	Allows other types of range hoods, besides domestic types, with certain conditions.	Will not increase or decrease resiliency.	The current language is very prohibitive in nature. The concept of the building codes has always been to set the minimum requirements and not the maximum requirements. This code section, however, limits anyone's wish to install a much safer hood system. The proposal eliminates said interdiction. Allowing for much more robust range hoods, with suppression systems, to be installed will improve the resiliency of buildings against fire and excessive moisture. It is the RSW's opinion that the proposal could increase resiliency.	+
TM506.5.6-18	Updates the UL standard and further clarifies the section.	This proposal will neither increase nor decrease Resiliency.	The proposal appears to be based on I-codes proposal M52-18 which has been approved as submitted and included in the 2021 IMC. The Section under consideration is updated with the most current, all encompassing UL standard applicable to Pollution Control Units; and revises certain provisions to be more in line with the requirements for grease ducts. The revisions proposed should result in much more safer systems; thus, the resiliency of buildings should be improved. It is the RSW's opinion that the proposal could have a positive impact on resiliency.	+
TM510.7.1.1-18		This proposal will neither increase nor decrease Resiliency.	It appears that the intent of the proposal is to increase the stringency of current requirements as they relate to hazardous exhaust ducts penetrating fire-resistance-rated shafts. However, there is a slight possibility that the proposed language could lead to differing interpretations. It is the RSW's opinion that the overall resiliency impact of the proposal would be neutral.	0

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
TP202-Service Sink Definition-18	Adds new definition for "Sink".	This proposal will neither increase nor decrease Resiliency.	The proposed definition should aid in eliminating the confusion surrounding what a service sink is, which should improve consistency in the code interpretation. Furthermore, it should also increase the resiliency of building occupants against adverse effects of using a kitchen(ette) sink for "building cleaning and associated caustic products" - as indicated by the proponent. It is the RSW's opinion that the proposal could have an overall positive impact on resiliency.	+
TP410.4-18	Clarifies the allowances for the substitution of required drinking fountains.	This proposal will neither increase nor decrease Resiliency.	As reasoned by the proponent, the current code language leaves much room for misinterpretation. This could result in buildings without the minimum required number of drinking fountains. Standing or wheelchair occupants could be left without the required drinking fountain. The proposed amendment, appears to correct this issue by ensuring that each building occupant is provided with the minimum required fixtures. While the buildings would not appear to become more resilient due to the proposed change, it is the RSW's opinion that the building occupants' resiliency could benefit from this change.	+
TP423.1-18	Requires backflow prevention for footbaths and pedicure baths.	This proposal will neither increase nor decrease Resiliency.	New equipment and technologies become available on the market at any given time. It is difficult, to say the least, for the codes to keep up with all the changes. This proposal appears to be an attempt for the code to catch up with more current equipment and popular social activities. The protection of the water supply against harmful effects of backflow is of utmost importance. The proposal intends to provide the means for ensuring such protection. It is the RSW's opinion that the proposal will have a positive impact on resiliency.	+
TP605.2.1-18	Deletes unenforceable language applicable to lead content.	This proposal will neither increase nor decrease Resiliency.	Although the provisions are deleted from the code, as per the reason statement, the same provisions are found in the NSF 372. By verifying compliance with said standard, the code enforcement personnel would also indirectly verify the current weighted average content indicated in the code. The RSW agrees with the proponent's resiliency statement.	0
TP705.11.2-18	Removes the exception allowing PVC joints made with solvent cement and no purple primer.	This proposal will neither increase nor decrease Resiliency.	If all manufacturer's do require the use of purple primer, the exception is not necessary. Thus, it would appear that the change does not introduce any actual changes to the current provisions. The RSW concurs with the proponent's resiliency statement.	0
TP717-18	Adds new section for relining of existing sewers.	This proposal will increase Resiliency. Reducing open trench excavation, assisting with preservation of the natural environment and limiting destruction of private property will help increase resiliency.	Similar with RTP3011-18 above. In addition, the relining could provide for significant financial savings for commercial establishments via income that could otherwise be lost due to long periods of business closures required to facilitate open trenches type of repairs. The RSW agrees that the proposal could have a positive impact on resiliency.	+
TP1303.1-18	Allows the provisions of CSA B805/ICC 805 as an alternative to the current requirements applicable to rainwater nonpotable water system.	This proposal will increase Resiliency. Planning, design, and management of rainwater harvesting and water storage, as well as considering the full range of water storage options would enable better opportunities for enhancing resilience against climate change.	The RSW agrees with the proponent's resiliency statement.	+
TP1101.7-18	Deletes non applicable text.	This proposal will neither increase nor decrease Resiliency.	The text appears to be editorial in nature with no apparent impact on resiliency. The RSW agrees with the proponent's resiliency statement.	0
TP1105.2-18	Deletes non applicable text.	This proposal will neither increase nor decrease Resiliency.	The text appears to be editorial in nature with no apparent impact on resiliency. The RSW agrees with the proponent's resiliency statement.	0
TP1110-18	Adds new section addressing the method of calculating the equivalent roof area of continuous flow.	This proposal will neither increase nor decrease Resiliency.	As noted by the reason statement, the previous Virginia amendments have mistakenly deleted this section. Incorrectly sizing the roof drain system could lead to catastrophic building failures. Providing the means for correctly calculating the equivalent roof area of continuous flow helps ensure that the roof drain system is sized adequately. It is the RSW's opinion that the proposal will improve resiliency.	+
Final Regulations				
A101.5	Language added to clarify references to the I-family of codes.	This proposal will neither increase nor decrease Resiliency.	The proposed change adds new language clarifying that the references to the International Codes found throughout the VCC include the Virginia amendments to said sections. By doing so, it is ensured that the buildings/structures are constructed following the appropriate/enforceable requirements; thus, providing for more resilient buildings/structures. It is the RSW's opinion that the proposal could positively impact resiliency.	+
A101.6-18	Order of precedence (between different model codes) clarification.	Generally, does not increase resiliency in most cases. However, as indicated in the reason statement, sometimes the VECC actually is LESS resilient than the iCode under which such elements or systems are typically regulated.	The Current USBC contains several conflicts between the energy requirements and the building/mechanical/electrical/plumbing/fuel gas provisions. The code change under consideration adds language to clarify that when such conflicts occur, the trade (building/mechanical/electrical/plumbing/fuel gas) specific requirements supersede the energy provisions. During the Code Development Workgroup meetings, the stakeholders have reached consensus for approval of proposed code change. While the energy is a very important factor to be considered, when conflicts occur, the building/mechanical/electrical/plumbing/fuel gas requirements generally provide for more resilient buildings/structures than the energy. The RSW agrees with the Resiliency Statement by Proponent.	+
A103.1-18	Minor editorial change.	Will not increase or decrease resiliency. It is intended to be an editorial change only.	As indicated by the proponent, the code change is intended to clarify that the VEBC, Section 103.1 should reference the VEBC and not the IEBC as is the case currently. The RSW concurs with the proponent's Resiliency Impact Statement.	0
A109.3-18	Adds requirements for engineering details where dry flood proofing is proposed.	This proposal will increase Resiliency. Having details on the construction documents improve efficiency for review from flood investigations and aids with compliance with national flood programs and regulations.	The RSW agrees with the proponent's resiliency statement.	+
A113.3-18	Adds requirements concerning the lowest floor elevation and flood hazard documentation on buildings/structures located in flood hazard area.	This proposal will increase resiliency by allowing for additional clarification to the owner as to the lowest floor elevation and for certification purposes for flood documentation.	The RSW agrees with the proponent's resiliency statement.	+
A117.2-18	Adds flood hazard documentation requirements for moved buildings/structures as one of the criteria for Certificate of Occupancy (CO) Issuance.	This proposal will increase resiliency by requiring documentation for moved buildings in flood hazard areas before a new CO can be issued	The RSW agrees with the proponent's resiliency statement.	+
A119.5-18	New/clarified guidelines for the Technical Review Board (TRB).	Will not increase or decrease resiliency.	The proposal appears to enhance the current code provisions by providing much needed clarification/guidance related to the TRB proceedings. While at first glance, it would appear that the proposed code change does not have any impact on resiliency, one may argue that by clarifying and/or adding guidance to the TRB proceedings, the current code requirements would more accurately be applied. It is the RSW's opinion that the proposed change has the potential of improving resiliency.	+

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
AD40(2)-18	Updating current provisions to reference the most current American Society for Testing and Materials (ASTM) standards.	This proposal will neither increase nor decrease Resiliency.	Similar to the code development process at the national/state level, the standards referenced throughout the codes are also being updated in order to keep up with new technology/materials/equipment. The proposed code change intends to incorporate by reference the most current/updated edition of the previously referenced standards, as well as adding new ones to the requirements (i.e. F2960-16: Standard Practice for Permanent Amusement Railway Ride Tracks and Related Devices; and F3054-18: Standard Practice for Operations of Amusement Railway Rides, Devices, and Facilities). It is the RSW's opinion that incorporating the most up to date standards, will increase resiliency by ensuring that the amusement devices will be installed/inspected/operated in accordance with the best known practices/requirements at the time, and not based on outdated/no longer relevant standards.	+
AD75(2)-18	Recommends changes to the fee schedule for permits/inspections associated with amusement devices.	This proposal will neither increase nor decrease Resiliency.	Should the proposed code change be approved, the fees associated with building permits for amusement devices will increase. While the proposed fees increase - in most cases - may still not cover the cost associated with processing/reviewing/inspecting amusement devices, it should aid the local Building Departments in dedicating the necessary time and resources required for such tasks. It is the RSW's opinion that the overall outcome of this proposed code change will have, amongst others, a positive impact on resiliency.	+
B202(3)-18	Proposes the addition of definition for "Permit Holder" .	This proposal will neither increase nor decrease Resiliency. There will be no impact on resiliency of the building.	The introduction of a new definition for "permit holder" does not appear to have an impact on resiliency. The RSW concurs with the Resiliency Statement by Proponent.	0
B202(4)-18	Correlation of "building" definition with the 2018 International Building Code (IBC) definition.	Will not increase or decrease resiliency.	The scope of the change is to clarify that the creation of separate buildings by means of fire walls construction, does not have any implications on the building systems. G130-15 reason statement [code change proposal referenced by B202(4)-18] reads, in part, "some code officials have incorrectly interpreted that language to mean that the portions of the various elements and systems on each side of a fire wall must be completely self-contained." The proposal appears to eliminate the possibility of such misinterpretations of the code and improve uniformity in the code enforcement. As a result, it appears that the proposal will have a positive impact on resiliency.	+
B310.1-18	Clarification of residential (R) uses provisions.	This proposal will neither increase nor decrease Resiliency	This code change is the product of the Residential Use Subworkgroup which has been convened - in part, to clarify the classification of R uses/occupancies. The current provisions have created much confusion and resulted in non-uniform interpretation/application of the requirements. By re-arranging/simplifying/elucidating the R use/occupancy requirements, the interpretation/application of those requirements should become more uniform across the Commonwealth; and it should aid the code officials in applying the correct R provisions. Hence, the buildings should be more resilient. It is the RSW's opinion that the proposed code change will increase resiliency.	+
B907.3.2-18	Updating to reflect correct (relocated) Section.	This proposal will neither increase nor decrease Resiliency. This proposal is an editorial correction.	The RSW agrees with the proponent's Resiliency Impact Statement.	0
B1709.5.2-18	Garage doors and rolling doors acceptance criteria clarifications and addition of labeling requirements.	This proposal will increase Resiliency. Provides information on performance characteristics and compliance with the applicable industry standard for positive/negative wind design pressure ratings for garage and rolling doors.	The proposal appears to mirror the 2018 IBC code change proposal S109-19 which has been approved as modified by the committee. The RSW concurs with the proponent's resiliency statement as the labels would be specifically valuable to future building owners in cases where doors, or parts, must be replaced due to mechanical failure or other factors.	+
B101-18 (formerly BU101)	Proposes new types of construction (mass timber) under Appendix U. Same provisions have been approved at the national level and will be incorporated in the 2021 IBC.	This proposal will increase Resiliency.	The proposal allows for the construction of high-rise buildings comprised of mainly wood structural components, comparable in size/height with current Construction Types I and II. While this type of construction has been widely used throughout Europe for the past couple of decades, it has started to gain popularity in the US only in the past few years. Although similar buildings have been constructed in the US over one hundred years ago (i.e. Butler Bros Building, Minneapolis, built between 1906-1908), it could be considered fairly new to the US by some. However, extensive research has been done on the subject in the recent past. The research results suggest that the proposed new type of construction displays many resilient features. 1. Fire resistance: fire tests of cross laminated timber panels, which subjected the panel to temperatures in excess of 1,800 degrees Fahrenheit, revealed that the panel lasted 3 hours and 6 minutes. This is in part due to its mass and the charring effect which provides an "insulation" to the interior section of wood member. The combustion eventually stops due to oxygen depletion. Coupling the mass timber's inherent resistance to fire with the requirements for encasing the timber in gypsum panels (in some cases) would further improve its resilience against fire events. Another attribute of the mass timber construction is the reduction of concealed spaces which tend to promote the undetected spread of fire. 2. Seismic resistance: several seismic tests performed on mass timber - the most renowned one being the test of a seven story mass timber building performed on the world's largest shake table in Japan, have demonstrated the ability of such buildings to resist seismic effects with little to no damage. The reduced weight of mass timber buildings as compared to concrete and/or steel buildings will also aid during seismic events due to the reduced seismic forces imposed onto such buildings. 3. Construction effectiveness: unlike most of the construction methods currently utilized, the majority of components (i.e. walls, floors, roofs, etc.) are constructed off site, delivered and assembled on site. The construction effectiveness produced by this method would be invaluable in the aftermath of natural disasters. During such times the reconstruction via current types/methods of construction could be delayed due to the lack of local resources (i.e. concrete plants, building suppliers, etc.) which could also be affected by the disaster. The mass timber components, on the other hand, could be produced off site/in areas unaffected by the local natural disaster and delivered on site for assembly. Given the above and other factors, such as alleged sustainability, cost-effectiveness, etc., it is the RSW's opinion that the proposed code change will increase resiliency.	+
CS10-18	Addition of several defined terms and removal of "nongovernmental employee" definition.	This proposal will neither increase nor decrease Resiliency.	The change does not appear to have an effect on resiliency as it merely relocates/rewrites the same information in a different location, in definition form.	0
CS31-18	Qualification and examination requirements section clean up.	This proposal will neither increase nor decrease Resiliency.	13VACS-21-31 Paragraphs A and B have been deemed unnecessary; thus, they have been removed; and the "Technical Assistance Services" have been replaced with "Virginia Building Code Academy Office" to accurately identify the certificate issuer. The updates do not appear to have an effect on resiliency; the RSW agrees with the proponent's resiliency statement.	0
CS41-18	Reduction in the allowed time passed between completion of required training and certification application.	This proposal will neither increase nor decrease Resiliency.	Current provisions allow a prospective certification applicant to have had the required training completed as far back as six years prior to certification application. Given the code development schedule, in some instances, the training may have been based on code editions in effect two code cycles prior. As such, the training subject could potentially no longer be relevant. The reduction from six to four years should ensure that the training is based on current/enforceable editions of the code; thus, generating knowledgeable certificate holders. Considering this, it is the RSW's opinion that the proposed change will increase resiliency.	+

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
CS45-18	Grammatical correction.	This proposal will neither increase nor decrease Resiliency.	The proposal contains one minor grammatical correction; the RSW concurs with the proponent's resiliency statement.	0
CS51-18	"Issuance of certificates" section clean up.	This proposal will neither increase nor decrease Resiliency.	The proponent's reason statement reads, in part, "Certificate statuses have been consolidated into two statuses to mitigate misunderstanding between the statuses: active and inactive." This action could have a positive effect on resiliency by way of easily identifying which certificates are in non compliance (i.e. "inactive" certificates), taking corrective action; and, thus, ensuring that only certified personnel will carry out the enforcement of the USBC. There is a reasonable expectation that enforcement by certified individuals will result in code compliant buildings. Code compliant buildings means resilient buildings. It is the RSW's opinion that the proposal could have a positive impact on resiliency.	+
CS61-18	Removal - from this section - of statements regarding noncompliant notice letters.	This proposal will neither increase nor decrease Resiliency.	This appears to be an administrative type change which does not appear to have an effect on resiliency. The RSW agrees with the proponent's resiliency statement.	0
E402.1.4.2-18	Clarifies roof insulation requirements.	This proposal will increase Resiliency. Building energy efficiency can have a quantifiable impact on resiliency. To the extent that this proposal's clarifications will improve compliance and enforcement of the energy code, this proposal will result in improved building energy efficiency (especially for existing buildings undergoing a roof replacement) and will therefore improve resiliency.	RSW concurs with the proponent's resiliency statement.	+
E402.4.2-18	Deletion of requirements for minimum skylight fenestration area.	This proposal will increase Resiliency. This proposal will help industry for compliance with the VECC, the number of possible skylights that could be required may not be practicable or improve energy efficiency.	Current code provisions require certain buildings with enclosed spaces greater than 2,500 square feet in area, to be provided with a certain minimum skylight fenestration area. While daylight zones created by the installation of skylights could eliminate the need for artificial lighting, thus, appearing to increase resiliency, it appears to limit the capacity of energy producing systems, such as photovoltaic (PV) systems, that could be installed on the roof of buildings. The roof real estate is already limited given the various items normally located on the roof. Items such as HVAC equipment, roof access hatches, penthouses, shafts extensions, etc. are commonly found on today's building roofs. Further limiting the area that could otherwise be utilized for the installation of PV systems, could deem the installation of such systems unworthy. When comparing the potential in energy savings from skylights vs. PV systems and their resilient characteristics, while there are similarities between the two, there are some distinct differences. One evident similarity between the two is that both save/produce energy during daytime. The installation of either one would improve the resiliency of a given building. One distinct difference is exemplified below. The energy savings from skylights are "in the moment", while the sun is shining brightly. The potential for energy savings increases and/or decreases throughout the day based on the location of the sun on the horizon. Additionally, during times the building is unoccupied; or, occupied at reduced levels, the potential for energy savings is very limited or non-existent. The PV systems, however, have the capability of storing energy and using it during peak demand and/or for other types of power utilization equipment (i.e. space conditioning; emergency lighting, etc.) during off hours such as night and/or weekends. Additionally, the PV technology is ever evolving. Unlike skylights, through the use of power optimizers, sun trackers and other similar technologies, PV systems are capable to fully harness the sun's energy anytime during daylight. Considering this, it is the RSW's opinion that the proposal will have a neutral impact on resiliency.	+
E404.5-18	Deletes certain requirements for heated water supply piping.	Will not increase or decrease resiliency.	The requirements proposed to be deleted appear to be very cumbersome to design/review; and it would appear to be seemingly impossible to determine code compliance during inspections. This would result in non-uniformity in the code enforcement, as well as non-compliant systems. On the contrary, the correct enforcement of proposed alternative requirements appears to be much more palatable. Given this, it is the RSW's opinion that the proposal could have a positive effect on resiliency.	0
ES01.1-18	Removes energy provisions for existing buildings and refers the reader to the Virginia Existing Building Code.	This proposal will neither increase nor decrease Resiliency. This proposal is administrative by moving energy provisions relating to existing buildings from the VECC to the VEBC and will not impact resiliency.	The 2015 USBC contains - what appears to be - conflicting energy provisions applicable to existing buildings, as described herein. VECC, Section R501.1 (similar with VRC, Section 11070 reads, in part, "The provisions of this chapter shall control, the alteration, repair, addition and change of occupancy of existing buildings and structures." The Virginia Construction/Residential Code, Section 103.1.1 states that existing buildings must comply with the VEBC. VEBC, Section 102.2.2 indicates that compliance with it is to be considered an acceptable alternative for reconstruction, alterations and repairs in Group R-5 occupancies. The proposal intends to correct this conflict by removing the technical provisions from the energy code and referring the reader to the existing building code. Doing so, should assist with avoiding non-uniform and possible incorrect code interpretation/application. It is the RSW's opinion that the proposed change will positively affect resiliency.	+
ES02-18	Relocates energy provisions, related to existing buildings, from the Virginia Energy Conservation Code to the Virginia Existing Building Code.	This proposal will neither increase nor decrease Resiliency. This proposal is administrative and will neither increase nor decrease resiliency.	The scope of this proposal appears to be the relocation of energy provisions, related to additions, from the VECC to the VEBC. The RSW agrees with the proponent's resiliency statement.	0
ES03-18	Relocates energy provisions, related to existing buildings, from the Virginia Energy Conservation Code to the Virginia Existing Building Code.	The code change proposal will not increase or decrease the cost of construction. This proposal is administrative and supports other proposals to move the requirements of Chapter 5 of the VECC to the VEBC	The scope of this proposal appears to be the relocation of energy provisions, related to alterations, from the VECC to the VEBC. The RSW agrees with the proponent's resiliency statement.	0
ES04.1-18	Relocates energy provisions, related to existing buildings, from the Virginia Energy Conservation Code to the Virginia Existing Building Code.	This proposal will neither increase nor decrease Resiliency. This proposal is administrative and does not impact resiliency.	The RSW is in agreement with the proponent's Resiliency Impact Statement.	0
EB102.2.3-18	Clarification of "addition" vs. "separate building" as it relates to new fire walls in the context of VEBC.	This proposal will neither increase nor decrease Resiliency.	As the proponent has indicated in the reason statement, current code provisions appear to be unclear and provides for non-uniformity in the enforcement of the USBC. The proposed change appears to adequately address this issue. Thus, it should improve resiliency by ensuring uniform enforcement of the code. It is the RSW's opinion that the proposal appears to improve resiliency.	+
EB307-18	Relocation of reroofing requirements and addition of "roof covering" definition.	Will not increase or decrease resiliency.	In addition to relocating the reroofing requirements to a more appropriate location, the proposal also adds a new definition for "roof covering", which - as the proponent indicated, "it is vital to how to apply the VEBC when it comes to roof recover and replacement". Ensuring that the code is applied as intended, should improve resiliency. It is the RSW's opinion that the proposal appears to positively impact resiliency.	+

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
EB402.1-18	Removes the requirements for additional accessibility features triggered by the change of occupancy.	Will not increase or decrease resiliency.	<p>a. The proposal removes the accessibility features that would currently be required for buildings undergoing a change of occupancy and refers the reader to the alteration provisions. The list of required accessible features currently includes, amongst others, an accessible building entrance; and an accessible route from the accessible entrance to the primary function areas. While the alteration provisions, namely Section 403.3 also requires an accessible route to the primary function, Exception #1 to said Section allows for the costs associated with providing the accessible route to not exceed 20% of the total alteration costs.</p> <p>In the case of an R-5 conversion to a B use/occupancy, for instance, one potential costly alteration that would be required (in addition to the accessible toilet facilities and drinking fountains imposed by Section 403.3) is the re-enforcement of the floor system due to greater loading requirements for B use/occupancy. As a result, it is likely that the permit applicants would try to take advantage of Exception #1; thus, the building could end up without an accessible entrance, or, with a possible "partial accessible route" - at best.</p> <p>Research has shown that persons with handicap disabilities face their own unique challenges during and after natural disasters. A couple examples would be the inability to take shelter in a nearby building due to the lack of accessible entrance; or, not being able to access buildings providing post-disaster aid due to the same shortcomings. Thus, in this regard, it would appear that the proposal would have a negative impact on resiliency.</p> <p>b. The intent of the proposal appears to be, in part, bringing the 2018 VEBC more in line with the 2010 ADA and the 2021 IEBC, which do not require new accessibility features as a result of occupancy change. One of the primordial purpose of the VEBC is to aid with the rehabilitation of existing buildings at the least possible cost. Current code provisions could prove to be cost prohibitive and financially unworthy for the building owners and/or prospective business owners/tenants to tackle. That could result in an increase in the vacant commercial building stock. History has shown that the ongoing required maintenance of vacant buildings is not nearly performed at the same levels as for occupied buildings. An increase in the number of vacant buildings, as well as the deterioration of existing buildings would appear to be in direct conflict with § 36-99.01 of the Code of Virginia. Hence, it would appear that resiliency would be positively impacted by the proposal, in this regard.</p> <p>Considering "a" and "b" above, it is the RSW's opinion that the proposed code change would have a neutral impact on resiliency.</p>	0
EB404.3-18	Clarifies the section's intent.	Will not increase or decrease resiliency.	Judging based on the example provided by the reason statement, it would appear that the current code language coupled with potentially erroneous interpretations, could provide for much more accessible buildings/structures. Thus, it would appear that the proposed language would negatively impact resiliency. However, the USBC has always been intended to be uniformly interpreted and enforced. The proposed language appears to provide the much needed clarity for code officials, designers and builders alike, in addition to using identical language as the ADA (which is another point of confusion among professionals due to accessibility requirements different than those imposed by the USBC). The proposed language will likely produce more uniformity in the enforcement of the USBC; thus, it would appear to improve resiliency. It is the RSW's opinion that the proposed change would positively affect resiliency.	+
EB405.1-18	Removes the requirements for accessibility features triggered by the change of occupancy.	Will not increase or decrease resiliency.	Similar to EB402-18. Picture a change of occupancy from single family dwelling (R-5) to museum (A-3). It is the RSW's opinion that the proposed code change could have a negative impact on resiliency.	-
EB504.1.6-18	New requirements for smoke alarms repair and replacement.	This proposal will increase Resiliency.	As indicated by the comprehensive reason statement, the new requirements should aid in avoiding nuisance alarms; prevent loss of life due to smoke alarm devices containing dead batteries or no batteries; and improve the overall safety of occupants. Additionally, correct and timely activation of devices could reduce the physical damage the buildings could incur during fire events. It is the RSW's opinion that the proposal will positively impact resiliency.	+
EB601.4(3)-18	Complete re-write of the Section.	<p>This proposal will increase Resiliency. This proposal is unique in that it will make existing buildings more resilient and will help VA address broader resiliency concerns due to a changing climate. These improvements fall squarely within the Governor's directive to the Department of Housing and Community Development to identify "resilience-specific improvements to the Uniform Statewide Building Code (USBC) for inclusion in the 2018 code update," in Executive Order 24 from November 2018. At the macro level, buildings currently account for over 40% of the nation's energy use and over 70% of the nation's electricity use. A significant portion of that electricity comes from burning fossil fuels, which is one of the causes of climate change. Improvements in efficiency – particularly peak electric demand reductions – will help curb Virginia's need to build and site peak generation (which tends to be both more expensive and more carbon-intensive).</p> <p>At the building-specific level, improvements to the building's thermal envelope will improve the resiliency of Virginia's buildings. For example, efficient windows maintain better occupant comfort by reducing the volatility of indoor temperature swings. Moreover, these windows will help maintain more livable conditions during power outages due to natural emergencies. Efficient fenestration is designed to reduce both heating and cooling demand, reducing the need to build and site peak generation, resulting in benefits to building owners and all of Virginia's citizens. Energy codes are increasingly being recognized as playing a role in maintaining resilience and passive survivability, particularly during extended power outages. A recent white paper released by the International Code Council (ICC) and the Alliance for National and Community Resilience (ANCR) recommended that "[a]ny policies, guidance or criteria that includes building codes as a strategy should explicitly incorporate energy codes as a fundamental resilience strategy." See International Code Council, The Important Role of Energy Codes in Achieving Resilience, at 15 (Dec. 2019). Among these resiliency benefits are improved habitability, more grid stability, moisture management, and improved durability of buildings, and others. It is well within Virginia's interests in improving resiliency to a changing climate to reduce energy demand wherever possible.</p>	The RSW concurs that improvements of the thermal envelope would have a positive effect on resiliency.	+

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
EB704.1-18	Clarifies the Section's intent.	This proposal will neither increase nor decrease Resiliency.	In accordance with the reason statement submitted, "it appears a number of plan reviewers are interpreting that VEBC Section 704 requires compliance with the entire Chapter 9 of the VCC". The alleged erroneous interpretation would impose more stringent requirements than what the code intends; thus, potentially providing for buildings/structures more resilient to fire events. As such, it could be said that the proposed change would decrease resiliency. However, imposing additional requirements is normally associated with an increase in the cost of construction. In some instances the increase in construction could prove to be unbearable, resulting in proposed projects not seen to fruition, but remaining stagnant at the proposed phase. The overall scope of the VEBC is to "recondition" old/dilapidated/vacant structures at the least possible cost. By clarifying the provisions, the proposal could prevent the abandonment of such rehabilitation projects due to considerable cost increases, thus, improving the overall resiliency of existing buildings. Additionally, the proposal adds/addressed standpipes - which under previous editions was not addressed - so, in that respect, that part of this proposal would improve resiliency as well. It is the RSW's opinion that the proposal will increase resiliency.	+
EB1101.18(2)-18	Relocates requirements for Address Identification of existing buildings from the VCC to the VEBC; and adds retrofit requirements for existing buildings.	Will not increase or decrease resiliency.	For successful fire fighting operations, it is imperative that the emergency responders are able to easily identify the physical address where the event occurs; and even more so, the location of the Fire Department Connection (FDC). The introduction of retrofit requirements for the identification of FDC's, will enable the local Fire Departments to proactively ensure that the FDC's are easily visible to the approaching fire apparatus; thus improve the resilience of existing buildings/structures against fire events. It is the RSW's opinion that the proposed code change will improve resiliency.	+
EB1401.1-18	VEBC Chapter 14 overhaul.	Will not increase or decrease resiliency.	The proposal reorganizes/restructures/rewrites certain sections as well as removes conflicting/non-applicable provisions related to I-2 occupancy. Notwithstanding the exception to current Section 1401.1, there are several provisions within the Chapter which would appear to (incorrectly) imply that said Chapter can be used to show compliance of I-2 use/occupancies. The use of I-2 provisions could have resulted in non-compliant buildings. Removing those I-2 requirements/allowances should lead to more uniformity in the application of Chapter 14 and have a positive effect on resiliency. It is the RSW's opinion that the proposal has the potential of improving resiliency.	+
FP101-18	Companion proposal to BU101-18: new appendix "P" - Tall wood buildings.	This proposal will increase Resiliency.	Similar to BU101-18.	+
FP107.2(1)-18	Adds requirements for operational permit for the operation of State-Regulated Care Facilities (SRCF's)	This proposal will increase Resiliency.	Due to administration regulation changes in the Department of Social Services, the frequency of inspections to be performed on SRCF's would increase. With an increase in inspections, there is a reasonable expectation that unexpected and unfortunate fire events will be prevented; thus, improving the resiliency of buildings housing SRCF's. The RSW agrees with the proponent's resiliency statement.	+
FP107.2(2)-18	Adds operational permit requirements for commercial cooking appliances in occupancies other than assembly (which is already covered).	This proposal will increase Resiliency.	There is an abundance of commercial occupancies served by commercial type kitchens which are exempted from the operational permit requirements based on their use/occupancy designation. I.e. fast food type establishments with an occupant load of 49 are designated as B use/occupancies. As such, an operational permit is not required. As noted by the reason statement, the risk of fire is not reduced just because of a different use/occupancy designation. The proposal will enable the local Fire Departments, or the State Fire Marshal's Office respectively, to require operational permits for such establishments. The proactive Fire Inspections allowed to be performed under said permits should prevent future grease fires; thus, improve the resilience of such premises to fire events. It is the RSW's opinion that the proposed change will increase resiliency.	+
FP202(4)-18	New "Cooking Tent" definition is proposed.	This proposal will neither increase nor decrease Resiliency.	The proposed definition should result in more uniformity in the application of the code; and, therefore, could improve resiliency by avoiding erroneous code interpretation. It is the RSW's opinion that the proposal could positively affect resiliency.	+
FP319.1.1-18	Addition of wheel chock and fire separation requirements for Mobil food preparation vehicles.	This proposal will increase Resiliency.	New fire separation requirements and means to achieve them are introduced by this proposal. Requiring a minimum separation distance between these possible fire event producers should aid with avoiding unnecessary damages to nearby buildings/structures/other Mobil Food Vehicles and possible injuries to their occupants. It is the RSW's opinion that the proposal will increase resiliency.	+
FP319.2.1	New "Permit Authority Having Jurisdiction (AHJ)" definition.	This proposal will increase Resiliency.	The proposal appears to clarify which is the entity responsible for the issuance of permits for the operation of Mobil Food Preparation Vehicles (MFPV). This should increase the uniformity in the enforcement of applicable code provisions; and it appears to make it easier for the MFPV owners to obtain the required permits. It is the RSW's opinion that the proposal could have a positive effect on resiliency.	+
FP405.2-18	Adds requirement for emergency evacuation drills on R-2 buildings designed/marketed to senior citizens.	No statement?	As indicated by the reason statement, senior citizens are more prone to injury and loss of life during emergency events. While requiring emergency evacuation drills would not deem the existing buildings more resilient, it would aid their occupants to more easily evacuate the buildings during emergency events; thus, it would provide for more resilient occupants during such unfortunate events. It is the RSW's opinion that the proposal would have an overall positive effect on resiliency.	+
FP407.2-18	Allows for electronic Safety Data Sheets submittal.	This proposal will increase Resiliency. By limiting the time necessary to find and retrieve SDS binders, first responders can use the business' SDS-on-demand program to retrieve applicable SDS information, therefore hastening response time and the safety of responders and the nearby community. This will help to minimize damages and the business/community to recover quicker as a result.	The RSW agrees with the proponent's Resiliency Impact Statement.	+

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
FP609.2-18	Revised scoping provisions.	This proposal will neither increase nor decrease Resiliency.	The proposal appears to clarify the scoping provisions intended by the Section. Doing so, should aid with the uniformity of code enforcement throughout the Commonwealth and avoid erroneous code interpretation and applications. It is the RSW's opinion that the proposal could have a positive effect on resiliency.	+
FP807.5.4-18	Adds exception allowing limited combustible decorative materials within I-3 Groups.	This proposal will neither increase nor decrease Resiliency.	While the proposal appears to allow for an exception to the rule, thus, lowering the levels of safety, in fact the exception appears to impose greater limitations than the current provisions, as explained herein. The exception allows for a maximum four square feet of wall area "for personal items 0.025 inch (0.64 mm) or less in thickness applied directly to and adhering to the wall." The items allowed, however, are not to be considered "decorative materials" based on the definition found in Chapter 2. Said "Decorative Materials" definition specifically indicates that items such as those "allowed" by the exception are not to be considered decorative materials. As such, the 2015 SFPC, Section 807.5.4, does not appear to impose any limitations on "items 0.025 inch (0.64 mm) or less in thickness applied directly to and adhering to the wall" as they are not to be considered decorative materials by definition. Given the limitations set forth by the proposal and the additional safety measures noted by the Reason Statement, it would appear that the proposed change would help improve resiliency by reducing the amount of combustible items that could add to the fire load of the building. It is the RSW's opinion that the proposal will have a positive effect on resiliency.	+
FP2306.2.1-18	Provides pointers for State Water Control Board (SWCB) regulated tanks.	This proposal will neither increase nor decrease Resiliency.	The proposal adds pointers to the appropriate code sections dealing with tanks subject to the SWCB regulations. This is a good reminder for those familiar with such requirements; and an ever better tool for the code readers not aware that some tanks are covered by the SWCB regulations. The change should improve the uniformity of the USBC enforcement. It is the RSW's opinion that the proposal will have a positive impact on resiliency.	+
FP2306.2.1.1-18	Removes the list of requirements for release detection and adds new section requiring compliance with the SWCB regulations.	This proposal will neither increase nor decrease Resiliency.	As noted by the reason statement, the list of requirements proposed to be removed were originally intended to regurgitate the SWCB provisions. Given the fact that USBC and the SWCB update cycles do not coincide, there is a potential for conflicting information. The proposal intends to address this issue and avoid misinterpretation of the USBC. Approval of the proposal should provide for more uniformity in the enforcement of the USBC; and have a positive effect on resiliency as a result. It is the RSW's opinion that the resiliency could benefit from this proposal.	+
FP2403.2.1.3-18	Changes the horizontal dimension defining the area within which the equipment must be maintained.	This proposal will neither increase nor decrease Resiliency. There is no expected change to resiliency to this code change as the 3 foot horizontal dimension has been the standard by NFPA 70 since at least 1978.	As reasoned by the proponent, the purpose of the change is to create consistency with NFPA 70, NFPA 33 and 2018 IFC in defining the classified area outside of a spray booth. Unlike the aforementioned codes/standards, the SFPC has always been intended as a maintenance code and not a new construction code. As such, during previous code development cycles, tremendous efforts have been put into revising the "new construction" type language found throughout the SFPC to "maintenance" type language. Section 2403.2.1.3 is one such section that has been revised. The 2012 IFC/2015 IFC/2012 SFPC, Section 2403.2.1.3 (as well as Section 1503.2.1.3 of earlier editions) read "Electrical wiring and equipment located outside of, but within 5 feet (1524 mm) horizontally and 3 feet (914 mm) vertically of openings in a spray booth or a spray room, shall be approved for Class I, Division 2 or Class II, Division 2 hazardous locations, whichever is applicable." In contrast, the 2015 SFPC, requires equipment located within the same boundaries referenced above to be "maintained". This proposal, however, would only require equipment located "...within 3 feet (915mm) horizontally and 3 feet (915mm) vertically..." to be maintained; implying that the remainder of equipment does not have to be maintained in accordance with the applicable code. It would be reasonable to assume that buildings constructed prior to the 2015 USBC, contain equipment (approved for Class I, Division 2 or Class II, Division 2 hazardous locations) located within three to five feet from spray booths/rooms. By this proposal, the aforementioned equipment would no longer have to be maintained. This could potentially result in malfunctioning equipment located in an area considered to be a hazardous location by the SFPC in effect at the time of installation, which could lead to fire events. It is the RSW's opinion that the proposal could have a negative impact on resiliency.	-
FP5703.1.2-18	Editorial change only to correct Section number.	This proposal will neither increase nor decrease Resiliency. This is an editorial correction that does not impact resiliency.	The RSW concurs with the proponent's resiliency statement.	0
FP5704.2.13.1.1-18	Adds two exceptions applicable to tanks subject to the Virginia State Water Control Board regulation 9VAC25-580.	This proposal will neither increase nor decrease Resiliency.	The proposal intends to clarify the applicable requirements by referring the reader to the SWCB regulations for certain specific tanks. The added clarification should aid with the enforcement of correct/applicable provisions; and improve the enforcement consistency/uniformity. It is the RSW's opinion that the proposal could positively impact resiliency.	+
MH20-18	Lists the specific federal regulations applicable to the enforcement of 13VAC5-95-20.	The code change proposal will not increase or decrease the cost of construction.	The current provisions indicate that the enforcement of the Chapter must be in accordance with the federal regulations; it does not, however, specify which regulations. The proposal intends to rectify this by listing the applicable regulations. While the proposal should streamline the enforcement process, it does not appear to have an effect on resiliency.	0
MH20(2)-18	Updates an incorrect reference to the USBC.	This proposal will neither increase nor decrease Resiliency.	The current provisions contains reference to an incorrect/outdated USBC Section. The proposal updates the reference with the correct/applicable Section. Incorrect/outdated references could lead to erroneous code interpretations and non-compliant buildings/structures; the proposal should aid in avoiding those situations. It is the RSW's opinion that the proposal could positively affect resiliency.	+
PM105.2(2)-18	Requires copy of the Notice of Violation (NOV) to be provided to the owner of the building/structure.	This proposal will neither increase nor decrease Resiliency. This proposal is administrative and has no impact on resiliency.	As indicated by the reason statement, there have been situations in the past where the building/structure owners would/may have kept the buildings/structures in good condition had they known about the NOV and the issues associated with it. Providing the owners with a copy of the NOV should enable them to maintain the buildings/structures in good repair and avoid further damages due to fire and other detrimental events; thus, making the existing building stock more resilient to such events. It is the RSW's opinion that the proposed change will improve resiliency.	+
PM604.3.1.1-18	Replaces the allowance for certification of equipment by third party licensed or certified electrician with allowance for certification by Third-party inspector.	This proposal will increase Resiliency. This will increase the level of safety for all residential and commercial buildings that have been exposed to damaged electrical systems from flooding, exposure to water from Fire Fighting, and heat from exposure to fires. This allows the Building Official to determine the qualifications for the agency and/or inspectors performing the evaluations on these systems.	The current provisions are vague/broad/unclear as they relate to the allowance for a "third-party licensed or certified electrician" approval report of equipment. I.e.: licensed electrician by the Commonwealth of VA vs. other states; certified master electrician vs. journeyman vs. apprentice; certified by which entity; etc. As indicated by the proponent's resiliency statement, the proposal allows the Building Official to determine the minimum qualifications for the person evaluating the equipment. Furthermore, the qualifications would be based on a written policy already required by the code. This is consistent with other provisions of the code allowing for third-party inspection reports; and it would appear to aid with improving uniformity in the application of the USBC. The RSW agrees that the proposal will have a positive effect on resiliency.	+

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
RB200-18	Adds and revise the definitions for "Substantial Damage" and "Substantial Improvement".	This proposal will neither increase nor decrease Resiliency. This change just incorporates additional definitions and does not increase or decrease resiliency.	The definitions are a very important part in the correct understanding and enforcement of the code. Revising/clarifying and adding definitions will likely improve the consistency of code enforcement and should result in more resilient buildings/structures as a factor of correct code enforcement. It is the RSW's opinion that the proposal could improve resiliency.	+
RB301.2.1-18	Several changes intended to coordinate with the new wind speed requirements found in the referenced standard ASCE7-16.	No statement?	The coordination between the code and the referenced standard should help avoid potential erroneous code interpretations due to possible conflicting information. It is the RSW's opinion that the proposal could affect resiliency in a positive way.	+
RB301.2(1)	Companion proposal to RB301.2.1-18.	This proposal will increase Resiliency. Increases resiliency by updating basic wind speed maps for Risk Category II buildings and strengthens roof component loads for buildings with mean roof heights less than or equal to 60 feet.	The RSW agrees with the proponent's Resiliency Impact Statement.	+
RB301.2.1.1-18	Clarifies the limitations of the prescriptive VRC wind provisions.	This proposal will increase Resiliency. This proposal clarifies and updates the sections for Ultimate Wind Design.	The proposal clarifies that some Virginia Regions may not be able to use the prescriptive wind provisions set forth by the VRC. Incorrectly using the wind provisions could result in catastrophic damages and potential life loss. The RSW agrees that the proposal will increase resiliency.	+
RB302.1-18	Allows projections to be located anywhere within 5' of the property line.	This proposal will neither increase nor decrease Resiliency. This is not related to resiliency.	The 2015 VRC prohibits the installation of projections (i.e. roof overhangs) within 2' of the property line. The code change proposes to remove said requirements and allow projections to be located up to the property line. Although, said projections would be required to be provided with a one hour fire-resistance rating on the underside (alternatively they can be constructed of heavy timber, or fire-retardant-treated wood), it would appear that the proposal will increase their potential to fire exposure from neighboring buildings/structures. The reduction on safety would appear to negatively impact the buildings' resiliency against fire events. It is the RSW's opinions that the proposal appears to have a negative impact on resiliency.	-
RB302.2-18	Adds pointers to additional sections that townhouses must comply with.	This proposal will neither increase nor decrease Resiliency.	The proposal does not appear to change the existing code requirements. It appears to just add pointers to specifically reemphasize that said sections must be complied with. The RSW agrees with the proponent's resiliency statement.	0
RB302.2.2-18	Allows water-filled fire sprinkler piping to be installed within common walls separating townhouses.	This proposal will increase Resiliency. The reduced cost of installing fire sprinkler systems associated with this proposal and the allowance to run piping through and in interior walls separating townhouses will increase system reliability and performance.	Fire sprinkler systems are not currently mandatory for buildings under the scope of VRC. The main opposition to sprinkler systems, historically, has been due to the cost associated with the installation of sprinkler systems. The proposed code change appears to significantly reduce such costs, thereby "encouraging" the installation of sprinkler systems. Given this and the added system reliability alleged by the proponent, it would appear that the proposal will increase resiliency. It is the RSW's opinion that the proposal will increase resiliency.	+
RB302.2.6-18	Adds exception from the structural independence requirements for townhouses protected by fire sprinkler system.	This proposal will neither increase nor decrease Resiliency.	The current structural independence requirement provides for a townhouse building to stand, while allowing for the collapse of adjacent townhouse succumbing to a fire event. While research has shown that fire sprinkler systems do aid with limiting the damages incurred by buildings/structures due to fire events, research has also revealed occasional shortcomings of said systems due to lack of maintenance, impeded coverage, etc. The proposal, although requires fire sprinklers, would eliminate the structural independence requirement. As such, should a townhouse collapse for whatever reason during a fire event, this proposal would allow for the collapse to bring down the adjacent building(s) and create a domino effect. The reason statement references the IBC Section 706.1.1, Exception #2, and indicates that the IRC should not have more stringent requirements than the IBC. It appears, however, that there are two (2) distinct differences between section referenced and proposed exception, as follows: (1) buildings covered under IBC Section 706.1.1 are normally protected by NFPA 13 or NFPA 13R systems, while the exception proposed would allow NFPA 13D systems; and (2) the IBC Section requires "dedicated access easements and contractual agreements..." between the different owners of the buildings, while the proposed exception does not require such easements. Additionally, fire sprinkler systems in commercial buildings are normally maintained by trained technicians, unlike those in single family dwellings. Furthermore, NFPA13D systems allow for the omission of sprinkler heads from certain attics, crawlspaces, garages, etc. Considering the above, it would appear that the removal of the structural integrity requirement in favor of the proposed sprinkler system would reduce resiliency. It is the RSW's opinion that the proposed code change will decrease resiliency.	-
RB302.3(1)-18	Adds NFPA 13R and NFPA 13D sprinkler systems to the exception allowing a fire separation reduction in two-family dwellings.	This proposal will neither increase nor decrease Resiliency.	While it would appear that the resilience could be reduced by allowing less robust sprinkler systems to take the same reduction in fire separation levels as the NFPA 13, in fact, similar reductions are already allowed for other R-uses when NFPA 13R systems are installed. Additionally, as indicated by the reason statement, NFPA13R and NFPA13D systems are allowed in two-family dwellings. By allowing the reduction in fire separation from one hour to 1/2 hour when NFPA13R and NFPA13D systems are installed, it could actually increase resiliency, as explained herein. Based on the common construction practice and in accordance with the applicable provisions of the VCC Section 722.6 (and VRC Section R329) the wall separating the two dwelling units from each other, in most cases, has a default fire resistance rating of 50 minutes with exposure from either side. Coupling the default fire resistance rating with the protection afforded by the sprinkler system, it would appear that the end result would be a product much more resilient to fire events than that which is required by the current provisions. Furthermore, allowing the much more cost effective NFPA 13R and NFPA 13D systems, would appear to "incentivize" the use of sprinkler system within the compounds of R-5 buildings. It is the RSW's opinion that the proposed change could have a positive effect on resiliency.	+

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
RB302.3(2)-18	Allows R-5's to contain an Accessory Dwelling Unit.	This proposal will neither increase nor decrease Resiliency.	The first impression would be that the proposal would reduce the resiliency of buildings to fire events due to the elimination of required fire separation between Two-family dwellings. One of the criteria for such an allowance, however, is the installation of a fire alarm system in compliance with the VRC Section R314.7. The commentary to aforementioned code section reads, in part, "The detection and notification system requirements of Sections R314.7 through R314.7.4 provide early warning to occupants of the building in the event of a fire, thereby providing a greater opportunity for everyone in the building to evacuate or relocate to a safe area." and "Of all the provisions for safety features that have been placed within the code over the past few decades other than fire sprinkler system requirements, the provisions for these detection and alarm devices have probably offered the greatest benefit in increasing safety and reducing the loss of life". Having a system that is electronically monitored in accordance with the applicable NFPA 72 standard will ensure prompt and effective fire fighting response. The RSW agrees with the proponent's resiliency statement.	+
RB302.13-18	Correlation with RB302.3(1) and RB302.2.6.	This proposal will neither increase nor decrease Resiliency.	The proposal intends to correlate with other proposed changes by referencing the NFPA 13D, 13 and 13R in the appropriate sections. The RSW agrees with the proponent's resiliency statement.	+
RB313.1-18	Requires fire sprinkler system in single family dwellings.	COV Executive Order Twenty-four speaks to increasing Virginia's resilience to sea level rise and natural hazards. The Executive Order goes further in saying, "We must act now to protect lives and property from multiple threats and reduce taxpayer exposure through fiscally responsible planning." According to the Resilient Design Institute, resilient design is defined as "the intentional design of buildings, landscapes, communities, and regions in response to vulnerabilities to disaster and disruption of normal life". Fire is a natural hazard to a community whether it is a single house or an entire neighborhood. I submit this proposal provides resilience but it is targeted only to the hazards of fire on a scale smaller than what may be intended or described in Executive Order 24.	Historically, it has been proven that sprinkler systems are capable of preventing loss of life, as well as reducing building damages due to fire events. The RSW agrees that the proposal would increase resiliency.	+
RB314.6(1)-18	Allows smoke alarms with a 10-year, sealed battery.	This proposal will increase Resiliency.	As indicated by the comprehensive reason statement, the new requirements should aid in avoiding nuisance alarms; prevent loss of life due to smoke alarm devices containing dead batteries or no batteries; and improve the overall safety of occupants. Additionally, correct and timely activation of devices could reduce the physical damage buildings sustain during fire events. It is the RSW's opinion that the proposal will positively impact resiliency.	+
RB314.6(2)-18	Deletes exception no longer applicable.	This proposal will neither increase nor decrease Resiliency. This proposal is an editorial correction that will not affect resiliency.	The proposal removes an exception referencing a section which has been deleted in the 2015 VRC. Said section used to be applicable to existing buildings which are now covered under the VEBC; thus, the exception is no longer valid. The RSW agrees that the proposal has no effect on resiliency.	+
RB322.2.1-18	Clarifies requirements for garages and carports located within flood hazard areas.	This proposal will increase resiliency by ensuring garages and carports are not enclosed in Flood Hazard Areas.	The proposal appears to clarify requirements already in place for carports and garages. The revised language should help the reader to clearly understand the applicable requirements; and avoid potential erroneous code interpretations/application due to the apparent ambiguity of current language. It is the RSW's opinion that the proposal will have a positive impact on resiliency.	+
RB322.3.3-18	Reorganization of section.	This proposal will neither increase nor decrease Resiliency. This is just a reorganization and makes no changes to increase or decrease resiliency.	The gist of the change appears to be the reorganization of existing requirements; and the addition of direct reference to the section including the requirements for documents which must be prepared and sealed by a Registered Design Professional (RDP). The proposed section format appears to be more reader friendly; and clearly indicating the requirements for RDP sealed documents should avoid any confusion regarding whom may prepare such documents. Given this, it is the RSW's opinion that the proposal could have a positive effect on resiliency by ensuring correct application of the code requirements.	+
RB403.1.6-18	Revisions to the placement of required anchor bolts.	This proposal will neither increase nor decrease Resiliency. This is not related to resiliency.	The proposal appears to clarify proper securement of construction - in this case anchor bolts - so there is enough "bite" to withstand the implied loads and so things don't fall down or come apart. It is the RSW's opinion that the proposal will have a positive effect on resiliency.	+
RE402.1.2(4)	Increases the R-value of ceiling/roof insulation.	This proposal will increase Resiliency. This proposal will make buildings more resilient by reducing the volatility of indoor temperature swings and maintaining more livable conditions during power outages due to natural emergencies. These improvements fall squarely within the Governor's directive to the Department of Housing and Community Development to identify "resilience-specific improvements to the Uniform Statewide Building Code (USBC) for inclusion in the 2018 code	The RSW concurs with the proponent's resiliency statement.	+
RTE3902.16(2)-18	Requires arc fault circuit interrupters (AFCI) throughout dwelling unit rooms with some exceptions (where GFCI's are required).	No resiliency statement?	Research has shown that one of the leading causes for residential fires is faulty electrical systems. An estimation by the Consumer Product Safety Commission (CPSC) indicates that more than 50% of electrical fires could be preventable by AFCI's. While the current code provisions do require the installation of AFCI's in sleeping rooms, it does not impose such requirements for outlets serving other rooms throughout the building. Expanding the requirements for AFCI's to other rooms could, as demonstrated by research, not only increase the buildings' resiliency against fire events but actually save lives. It is the RSW's opinion that the proposed change will increase resiliency.	+
RTP2801.6-18	Prohibits the use of plastic pans below gas-fired water heaters.	This proposal will neither increase nor decrease Resiliency.	Storage tank-type water heaters are required to be installed in a pan so that it can prevent damage to the building caused by water leakage from the tank. Plastic pans could potentially melt; thus, damages could occur. Prohibiting such pans could avoid unnecessary damages, ensure that the intent of the code requiring pans will be met and increase the resiliency of buildings against floods due to water heater leakage. It is the RSW's opinion that the proposed code change will have a positive effect on resiliency.	+
T2701.1.1(2)-18	Proposes the adoption of certain requirements set forth by the 2020 National Electrical Code (NEC).	This proposal will increase Resiliency. This proposal will allow for new wiring methods and equipment not permitted in the current 2014 NEC and going to the 2020 NEC will include 4 new articles not covered in the 2017 NEC. We are currently two code cycles behind on the National Electrical Code and products that are available will not be in the 2018 VUSBC if this change is not adopted.	Should the proposal be approved, Marinas, Boatyards and Commercial and Noncommercial Docking facilities will have to comply with the 2020 NEC requirements applicable to said facilities. Article 555 of the 2020 NEC has seen several improvements over the previous versions. Electric Shock Drowning is an ongoing issue which has yet to be entirely addressed and fully preventable. The improvements found in the 2020 Edition of the NEC, Article 555, is the best attempt thus far in helping correct this problem. It is the RSW's opinion that the proposal will positively affect resiliency.	+

Code Change Proposal	Description	Resiliency Statement by Proponent	Resiliency Subworkgroup (RSW) Analysis	Resiliency Impact Positive (+) Negative (-) Neutral (0)
TM403.3.1.1-18	Provides prescriptive ventilation requirements for medical procedure rooms, patient rooms and physical therapy rooms not located in an ambulatory care facility or clinic, outpatient.	This proposal will neither increase nor decrease Resiliency.	Providing a prescriptive method for the calculation of required ventilation rates would be helpful to contractors, designers and code enforcement personnel alike as it would appear to be much easier to achieve compliance. This should increase the uniformity in the code application. As per the proponent's reason statement, however, the ASHRAE requirements are more rigorous. That would imply that the ventilation rates could be reduced if based on the prescriptive method. It is the RSW's opinion that the overall resiliency impact is neutral.	0
TM504.10-18	Editorial change to fix a broken reference.	This proposal will neither increase nor decrease Resiliency. This is only an editorial change and will have no effect on resiliency.	The change proposes to update the exception number so that it will match the Virginia amendments to the referenced section. The RSW agrees with the proponent's resiliency statement.	0
TM505.5-18	Deletes the prohibition of damper installations in the common exhaust systems for domestic kitchens located in multistory structures.	This proposal will neither increase nor decrease Resiliency.	Current provisions prohibit the installation of dampers. As indicated by the reason statement, "logic would not prohibit this (the installation of dampers) in the common domestic kitchen exhaust duct". While the grease laden vapors removed by (individual) domestic kitchen exhausts could be considered minimal, the combined vapors exhausted by the common system could amount to significant quantities. If it was intended by the proposed change to allow the installation of dampers in the common exhaust (as implied by the reason statement) the installation of dampers could aid with the collection of grease along the common duct; thus, creating the possibility of grease fires. Considering this, it is the RSW's opinion that the proposal could have a negative impact on resiliency.	-
TP403.1(2)-18	Increases the number of required plumbing facilities within airport terminals.	This proposal will neither increase nor decrease Resiliency.	The RSW agrees with the proponent's Resiliency Impact Statement.	+
TP403.3.3-18	Adds exception for the location of required plumbing facilities in Storage occupancies.	This proposal will neither increase nor decrease Resiliency.	The proposal does not appear to have an effect on resiliency.	0
TP1209.3.1-18	Adds provisions for Multi-user gender-neutral plumbing facilities.	Will not increase or decrease resiliency.	As per Industry statements, a growing number of owners/clients are requiring gender-neutral toilet facilities and with the recent Supreme Court decision, this proposal provides guidance to both designers and code officials on how to properly design, regulate, and enforce such toilet facilities. Thus, leading to consistent interpretation/application/enforcement when such toilet facilities are provided. It is the RSW's opinion that the proposal will increase resiliency.	+
TP2902.1-18	Correlates the plumbing requirements found in the VCC with the ones in the VPC by deleting provisions in the VCC and referencing to the VPC.	This proposal will neither increase nor decrease Resiliency.	As indicated by the proponent's reason statement, having duplicated requirements in more than one code (book) could lead to misinterpretations and erroneous code enforcement. Maintaining the requirements in one location only, and provide pointers to it should prevent such occurrences and ensure correct, uniform code application. It is the RSW's opinion that the proposal could have a positive effect on resiliency.	+
TP2902.1.1-18	Allows single-user toilet and bathing facilities to be identified as being available for use by all persons regardless of their sex.	This proposal will neither increase nor decrease Resiliency.	The proposal appears to clarify the intent of this section which should result in more uniformity in the application of the code. It is the RSW's opinion that the proposal could have a positive effect on resiliency.	+
Total neutral impact: 28.5% (28.49) *Total negative impact = 4% (4.14) *Total positive impact = 67.5% (67.35)				
* Out of those code change proposals with an impact on resiliency – not including proposals with a neutral impact, 6% of the proposals have somewhat of a negative impact and 94% have a positive impact on resiliency overall.				

2018 CODE UPDATE CYCLE - RESILIENCY SUBWORKGROUP PROPOSALS (APPROVED BY BOARD OF HOUSING AND COMMUNITY DEVELOPMENT)

USBC ADMINISTRATIVE (CHAPTER 1)

- **A109.3** – Where dry flood proofing is proposed, requires the engineering details to include details of the walls, floors and flood shields. **FEMA & DCR Supported**
- **A113.3** – Adds additional minimum inspections to establish lowest floor and elevation in flood hazard areas. **FEMA & DCR Supported**
- **A117.2** – Requires flood hazard documentation for moved buildings (if in flood hazard areas) before the buildings can be occupied. **FEMA & DCR Supported**

VIRGINIA CONSTRUCTION CODE (VCC)

- **B1709.5.2** - Requires garage doors have a permanent label that provides a way for the owner to be able to determine their performance characteristics after the building has been occupied. **[From 2021 I-Code] FEMA Recommendation/DCR Supported**

VIRGINIA RESIDENTIAL CODE (VRC)

- **RB200** – Add the existing VEBC definitions for “substantial damage” and “substantial improvement” to the IRC. **DCR Recommendation/FEMA Supported**
- **RB301.2(1)** – Coordinates the wind design criteria in the IRC with the currently referenced edition (2016) of ASCE 7. Updates basic wind speed maps for Risk Category II buildings and revises roof component and cladding loads for buildings with mean roof heights less than or equal to 60 feet. **[From 2021 I-Code] FEMA Recommendation/DCR Supported**
- **RB301.2.1** – Companion to proposal RB301.2(1), submitted by Glenn Overcash. **[From 2021 I-Code] FEMA & DCR Supported**
- **RB301.2.1.1** – Corrects errors regarding the applicability of the IRC to areas where wind speeds exceed the prescriptive provisions of the IRC. **[From 2021 I-Code] FEMA Recommendation/DCR Supported**
- **RB322.2.1** – Moves elevation requirements for garage and carport floors in flood hazard areas into Section R322 (was in R309.3). **[From 2021 I-Code] FEMA Recommendation/DCR Supported**
- **RB322.3.3** – Foundation section for coastal high-hazard areas and Coastal A Zones reorganized and clarified regarding pilings and columns. **[From 2021 I-Code] FEMA Recommendation/DCR Supported**
- **RB609.4** – Requires garage doors have a permanent label that provides a way for the owner to be able to determine their performance characteristics after the building has been occupied. **[From 2021 I-Code] FEMA Recommendation/DCR Supported**

Resilience Contributions of the International Building Code



INTERNATIONAL CODE COUNCIL



Introduction to Resilience

So far in 2019, communities across the United States have been exposed to numerous hazards including earthquakes, hurricanes, tornadoes, flooding, hail storms and extreme heat and cold. Few places are without some risk. In fact, the frequency and impact of hazard events is increasing. In 2017, the U.S. saw a record number of events causing over \$1 billion in damages with 16, causing a total of over \$300 billion in damages. Fourteen such events occurred in 2018, resulting in almost \$100 billion in damage. See Figures 1 and 2. Governments, businesses and citizens cannot sustain the investments necessary to return devastated communities back to “normal.”

Figure 1: Number of Disasters Costing \$1 Billion or More (NOAA)


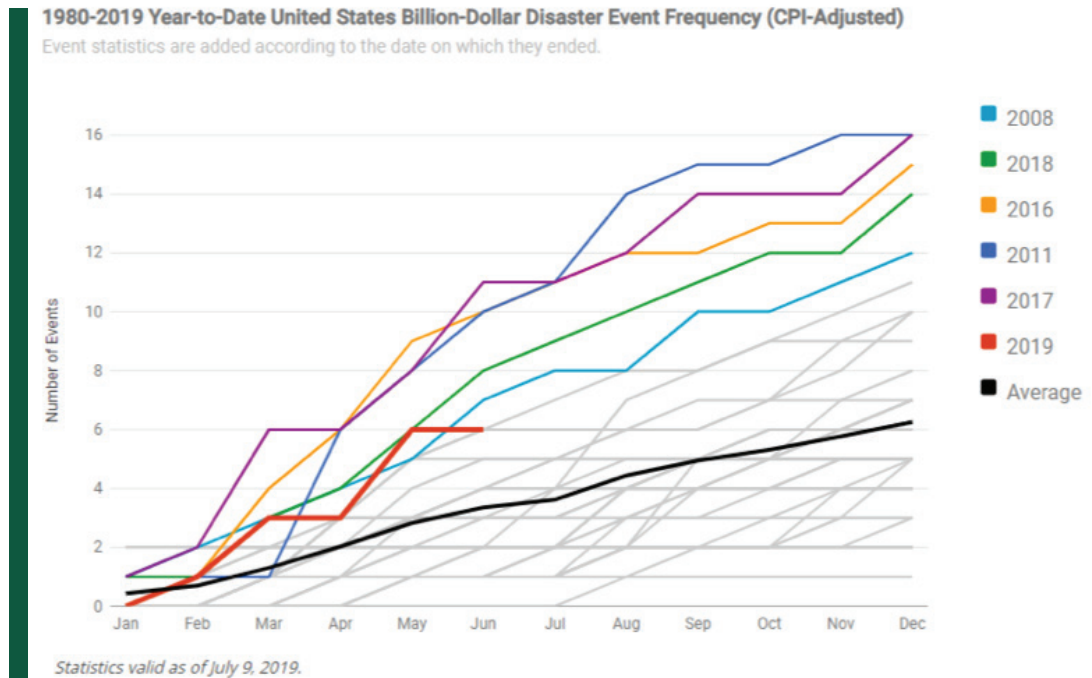


Figure 2: Cumulative Costs of Disasters of \$1 Billion or More (NOAA)

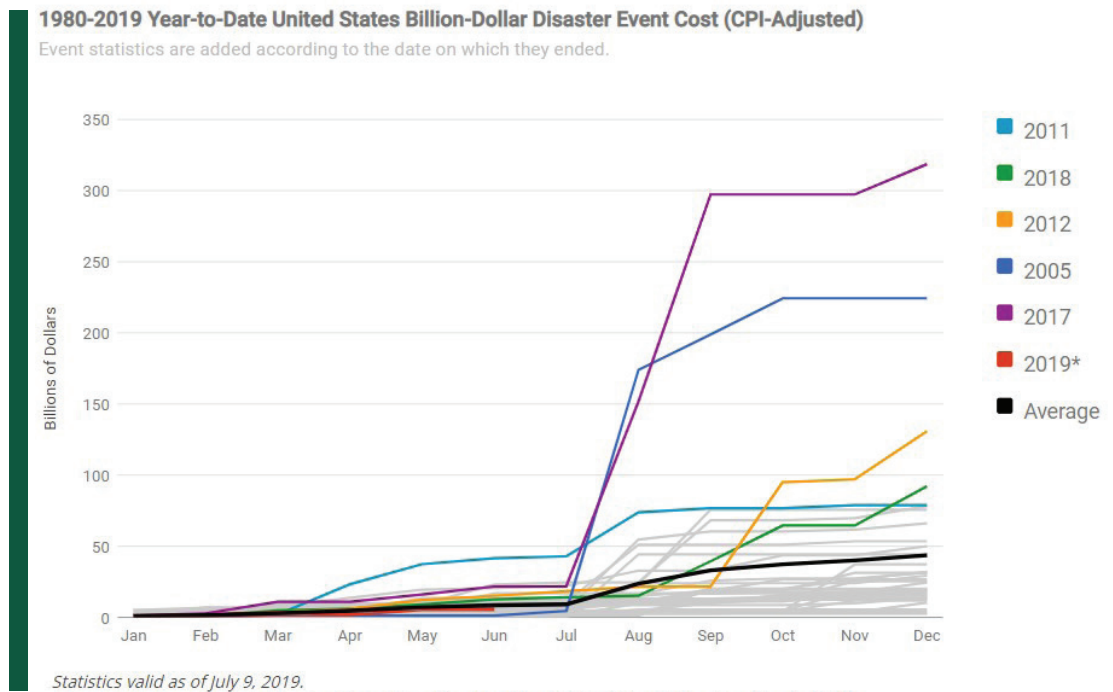

A new approach is necessary—one that focuses on strategies that prepare and protect communities ahead of such potentially devastating events. This approach aims to enhance community resilience.

The National Academies (2012) have defined resilience as, “the ability to prepare and plan for, absorb, recover from, and more successfully adapt to adverse events.” The building industry, including organizations representing planning, design, construction, ownership, operation, regulation and insurance, have embraced the definition put forward by the National Academies. Nearly 50 building industry organizations signed on to an Industry Statement on Resilience recognizing the need for coordinated action through research, advocacy, education, planning and response (AIA 2019).

To achieve resilience, communities must understand their risks and identify activities designed to reduce those risks. Communities often struggle to define what specific risks they should consider in defining their own resilience (e.g., resilient to what?). Risks vary by community based on geography and social, economic or organizational issues. Risks may be acute in the form of shocks from natural or man-made hazards or chronic in the form of stresses that develop over time. The American Institute of Architects has identified multiple shocks and stresses that impact communities (Figure 3). Some of these shocks and stresses are clearly tied to the condition of a community’s building stock while others reflect other community characteristics.

Figure 3: Community Shocks and Stresses
(AIA 2017)

Shocks	Stresses
Infrastructure failure	Affordability
Hurricanes	Aging population
Earthquakes	Environmental degradation
Wildfires	Sea level rise
Heat waves	Growing wealth gap
Blizzard	Drought
Epidemics	Species extinction
Flooding	Aging infrastructure
Tornadoes	Population growth
Acts of terrorism	Unemployment
Civil unrest	Melting polar ice
Dam failure	Global warming
Subsidence	Food scarcity
	Increasing pollution

Some stresses clearly cut across both social and infrastructural aspects of communities. Buildings can play a part in contributing to their resolution. Many communities are struggling with providing access to affordable housing. Model building codes are developed with affordability in mind. Through a national consensus-based process, efficiencies are captured that help establish consistency across the design, construction, operations and regulatory process—thus saving money for all stakeholders.

The condition of the local environment can impact a community’s resilience and the ability of its residents to thrive. During their design, construction and operations,

buildings can influence the environmental state of the community including through generation and management of waste products, contributions to both indoor and outdoor pollution, and their locational efficiency. Some of these influences can be addressed through building codes.

This report is the first of a multi-part series examining how the codes that make up the International Codes (I-Codes) contribute to resilience. It expands on the introductory report *Building Community Resilience through Modern Model Building Codes* (ANCR/ICC) released in December 2018.

Building Codes and Resilience

Building codes are a fundamental contributor to community resilience. A community cannot be resilient without resilient buildings and the codes that support their development. As identified in the initial report on building codes and resilience, “Resilience in the built environment starts with strong, regularly adopted, and properly administered building codes.” (ANCR/ICC 2018)

Numerous studies have been conducted to date to determine the effectiveness of codes and support updates based on lessons learned following disasters. A FEMA analysis estimated approximately \$500 million in annualized loss avoided in eight southeastern states due to the adoption of modern building codes (FEMA 2014).

The National Institute of Buildings Sciences (NIBS) in its *Natural Hazard Mitigation Saves: 2018 Interim Report* found that adoption of the 2018 International Building Code (IBC) and the 2018 International Residential Code (IRC) provide an \$11 benefit for every \$1 invested when compared to codes in place around 1990 (NIBS). Higher benefits can accrue when benefits and costs are studied at a more localized level. See Figures 4 and 5 for benefit cost ratios (BCRs) by hazard and location.

Figure 4: BCR of hurricane wind mitigation by increasing roof strength in new buildings to meet the 2018 IBC and IRC (by wind band) (NIBS)


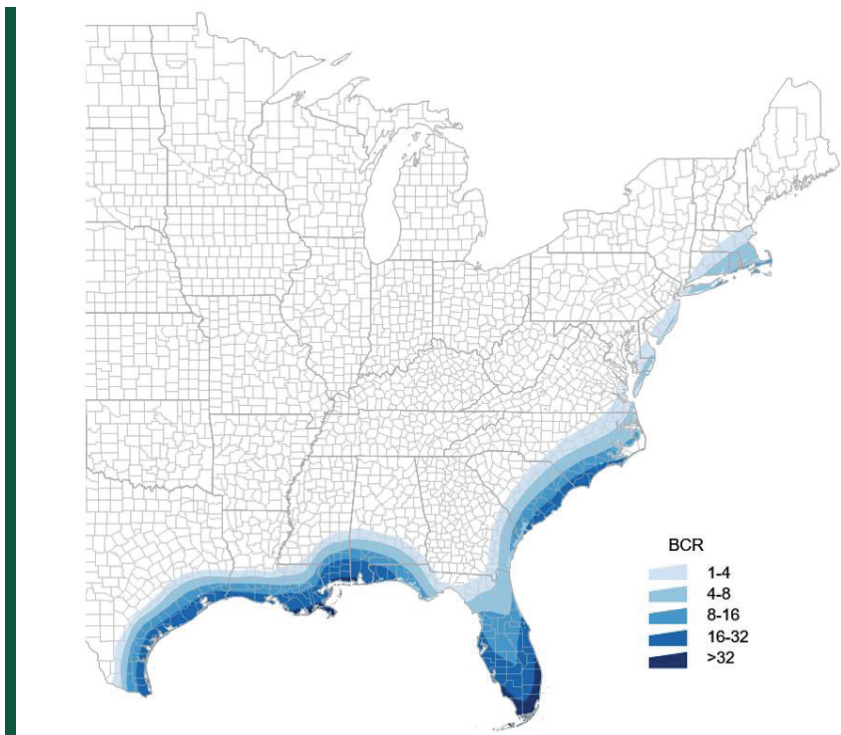


Figure 5: BCR of earthquake mitigation by increasing strength and stiffness in new buildings (by county) to meet the 2018 IBC and IRC (NIBS)

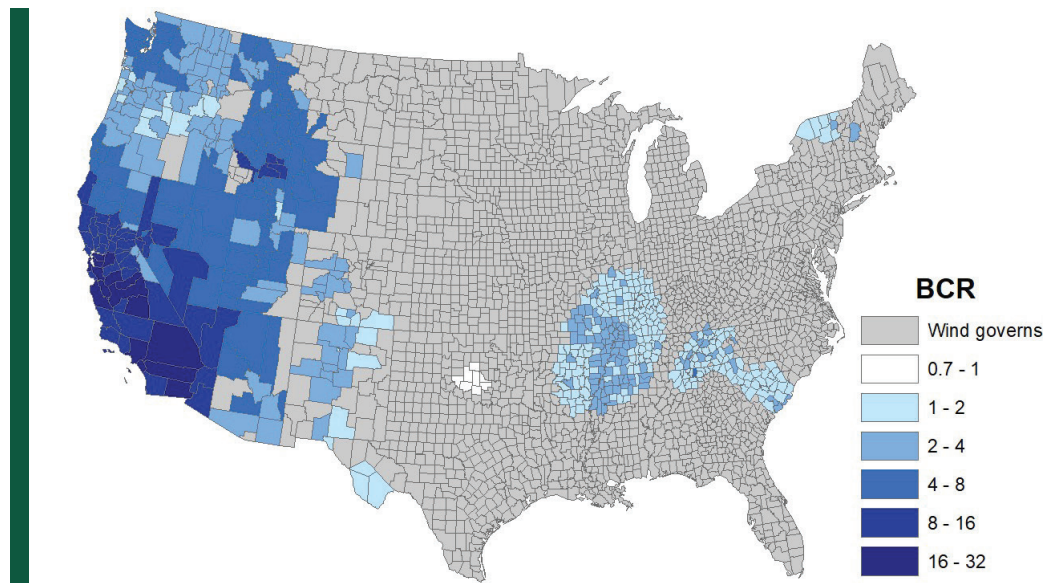

Following major disasters, Federal Emergency Management Agency (FEMA) and National Institute of Standards and Technology (NIST) conduct field evaluations and studies to determine the common modes of failure. These studies help identify where additional guidance or code and standard updates would lead to improved outcomes. These feedback loops into the code development process assure that codes capture the latest knowledge. Through regular updates of codes at the state and local level, communities can capture the benefits associated with research findings and new technologies and practices.

Congress has also recognized that the adoption and enforcement of up-to-date building codes is a cost-effective strategy to address the growing costs of recovery placed on taxpayers. Through the Bipartisan Budget Act (BBA) passed in February 2018 and the Disaster Recovery Reform Act (DRRA) passed in October 2018 Congress directed FEMA to incentivize states and localities to adopt and enforce the latest codes. The specifics of such efforts are still being finalized, but key provisions are outlined below.

The BBA authorized an increase in the federal cost share amount following a disaster based on the resilience measures undertaken including mitigation planning, adoption and enforcement of codes, participation in the Community Rating System (CRS) under the National Flood Insurance Program (NFIP) and the establishment of incentive programs.

DRRA provides communities with additional resources for the implementation of building codes post-disaster, increases funding for competitive pre-disaster mitigation (PDM) grants, allows PDM grants to be used for code adoption and enforcement, increases jurisdictions' chances of receiving PDM awards based on their adoption of the latest codes, and codifies FEMA's requirement that federally assisted repair and rebuilding efforts be built to the latest code requirements.


About the International Building Code

The IBC is a model code published by the International Code Council. It is developed through a consensus-based process conducted on a three-year cycle that allows for the incorporation of the latest technologies, practices and research findings. As a

model code, it is available for adoption by state and local governments and other entities that regulate or specify buildings.

In fact, the IBC is in use in every state, but how it is used and the editions adopted vary significantly. To learn more about the code adoption process visit www.iccsafe.org/CodesSave. Figure 6 includes information on the status of adoption of the 2018 IBC and IRC (as of May 2019).

Figure 6: 2018 Code Adoption Projections

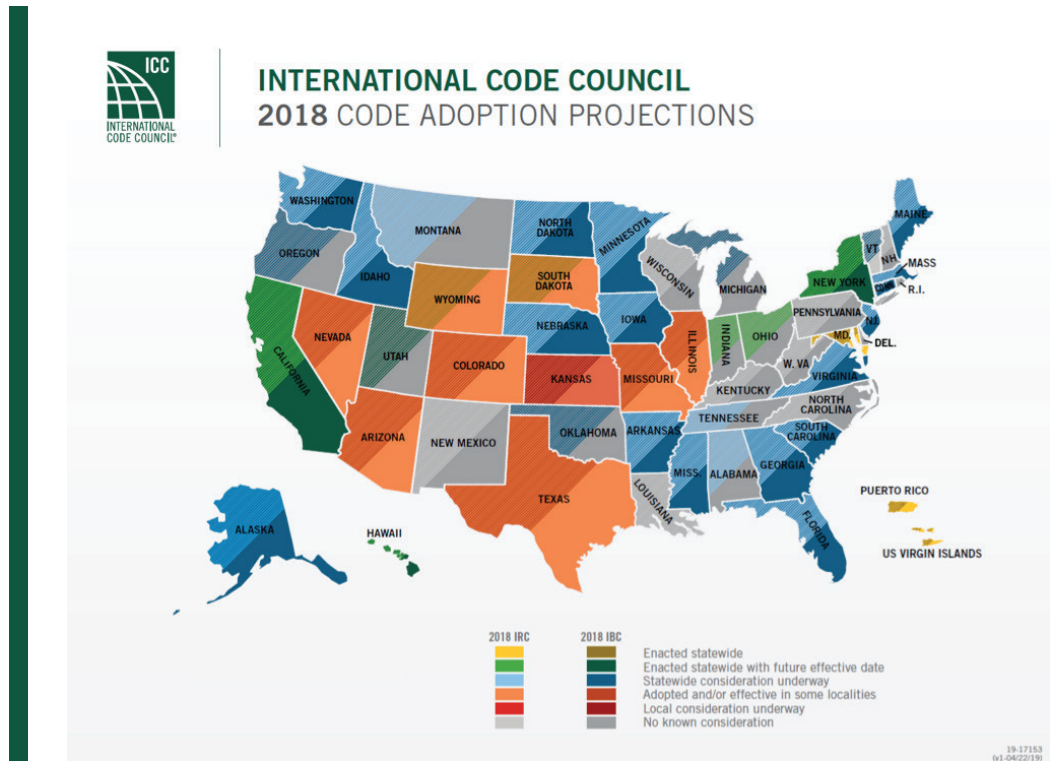

The federal government also relies on the IBC and other I-Codes. The Community Rating System (CRS), which provides federal flood insurance discounts for communities undertaking disaster mitigation measures, recognizes the flood mitigation value provided by the IBC and other I-Codes.¹ CRS also uses Building Code Effectiveness Grading Schedule (BCEGS) scores, which evaluates adoption and enforcement codes including the IBC. Finally, FEMA requires adherence to the latest edition of the IBC, IRC, and International Existing Building Code (IEBC) as minimum codes and standards for rebuilding using post-disaster public assistance funding (FEMA’s “Minimum Standards Requirement”).² The U.S. General Services Administration and the Department of Defense mandate use of the IBC for their building projects.

As identified in the scope and administration chapter of the IBC (Section 101.2), “The provisions of this code shall apply to the construction, alteration, relocation, enlargement, replacement, repair, equipment, use and occupancy, location, maintenance, removal and demolition of every building or structure or any appurtenances connected or attached to such buildings or structures.”³

The intent of the IBC is (Section 101.3), “to establish the minimum requirements to provide a reasonable level of safety, public health and general welfare through structural strength, means of egress facilities, stability, sanitation, adequate light and

ventilation, energy conservation, and safety to life and property from fire, explosion and other hazards, and to provide a reasonable level of safety to fire fighters and emergency responders during emergency operations.”

The IBC either incorporates or correlates with codes that address important building systems or characteristics—it provides a holistic approach. In the interest of keeping this report concise, the topics covered in the other codes will be addressed in greater depth in future reports in this series. The specific codes incorporated or correlated are listed in Table 1. In addition, the IBC captures the technical knowledge contained in multiple standards—particularly ASCE 7: Minimum Design Loads and Associated Criteria for Buildings and Other Structures.

Table 1:
Incorporated/
Correlated Codes
within the IBC

Incorporated/Correlated Code	IBC Chapter
<i>International Fire Code (IFC)</i>	Chapters 7-10, 27
<i>International Energy Conservation Code (IECC)</i>	Chapter 13
<i>International Mechanical Code (IMC)</i>	Chapter 28
<i>International Fuel Gas Code (IFGC)</i>	Chapter 28
<i>International Plumbing Code (IPC)</i>	Chapter 29
<i>International Residential Code (IRC)</i>	Parts of Chapter 3

The International Building Code and Resilience

The scope of the IBC is clearly focused on assuring that a community’s building stock supports the resilience of the community. Reducing the impacts on people and property in the face of multiple shocks and stresses allows communities to survive and ultimately thrive.

Through its organization and the topics covered, the IBC takes several approaches to addressing risks posed by multiple hazards. Many of the requirements contained in the code are organized around the building’s use and occupancy as defined in Chapter 3. As identified in the introductory pages to the IBC, “Defining the use of the buildings is very important as it sets the tone for the remaining chapters of the code. Occupancy works with the height, area and construction type requirements in Chapters 5 and 6, as well as the special provisions in Chapter 4, to determine “equivalent risk,” or providing a reasonable level of protection or life safety for building occupants. The determination of equivalent risk involves three interdependent considerations: (1) the level of fire hazard associated with the specific occupancy of the facility; (2) the reduction of fire hazard by limiting the floor area and the height of the building based on the fuel load (combustible contents and burnable building components); and (3) the level of overall fire resistance provided by the type of construction used for the building. The greater the potential fire hazards indicated as a function of the group, the lesser the height and area allowances for a particular construction type.”

In addition to the risks associated with a building’s occupancy, the safety of a structure is determined by the characteristics of building materials and systems. The IBC includes chapters focused on materials typically used in building construction and how they should perform to meet the intent of the code. The materials are captured in chapters 19 through 26 (concrete; aluminum; masonry; steel; wood; glass and glazing; gypsum board, gypsum panel products and plaster; and plastic, respectively) whereas systems are covered in chapters 27 through 29 (electrical,

mechanical systems, and plumbing systems, respectively). Where applicable, industry standards and related I-Codes are referenced.

Hazard maps incorporated into the IBC help communities determine their risk exposure and identify the measures within the Code that will help them adequately respond to such risks. The maps cover risks associated with snow loads, wind loads (including both hurricanes and tornadoes), rain loads, seismic loads, and termite infestations.

Like all the I-Codes, the IBC is focused on life-safety, protecting occupants from adverse impacts from buildings. However, it also recognizes where buildings intersect with other important community functions that support overall safety including utility connections, the performance of community shelters, building codes and code departments as part of the emergency planning process, and the importance of critical facilities.

Specific sections of the IBC and their contributions to resilience are outlined in Table 2. However, the discussion that follows examines what the IBC covers regarding the shocks and stresses identified above.

Hurricanes: The IBC includes multiple strategies for protecting structures and occupants against hurricane events. These include provisions associated with structural strength including wind and rain loads, protection of openings from flying debris and preventing the creation of flying debris, elevating structures to mitigate flooding and storm surge, preventing water intrusion and providing for storm shelters. Provisions for building enclosures (exterior walls and roofs) help maintain their integrity including through nailing patterns for roof decks and wall sheathing along with wind resistance of exterior materials including shingles, metal or tile and siding, stucco and masonry.

The IBC is focused on life-safety, protecting occupants from adverse impacts from buildings.

Tornadoes: Like hurricanes, provisions for storm shelters, prevention of flying debris, and structural strength contribute to tornado resistance.

Earthquakes: Protection from earthquakes relies heavily on designing for structural loads. Soil conditions also contribute to seismic risk and are addressed within the IBC. Securing appliances such as water heaters help prevent them from separating or falling, causing fires due to gas leaks or severed electrical connections.

Tsunami: In addition to requirements focused on structural integrity, the IBC includes an appendix covering specific conditions associated with tsunami-related flooding.

Fire: Whether a primary hazard in and of itself or secondary to another hazard event, fire can have a significant impact. The IBC looks to provisions from the International Wildland-Urban Interface Code (IWUIC) and IFC to reduce fire risk. Egress provisions help assure that occupants (including those with disabilities) can safely evacuate in the case of fire.

Heat Waves: Protecting occupants from extreme heat and uncomfortable temperatures requires focus on a few strategies including ventilation and maintaining comfortable temperatures. Provisions in the IBC and the IECC protect occupant comfort through ventilation, insulation and reduction of solar heat gain and urban heat island. The IECC is incorporated into the IBC as Chapter 13 and its contribution to resilience will be examined in a future report in this series.

Blizzards: Like heat waves, temperature control is an important aspect of resilience in the face of blizzards and other extreme cold events. In addition to measures in the IECC, the IBC includes provisions to assure buildings can support anticipated snow loads and associated water management due to snow melt.

Flooding: The IBC includes provisions covering flood loads and elevation of structures to reduce impacts of flood events. The Code prescribes overall structural strength to withstand hydrostatic forces of water and wave action. The IBC's requirements for flood mitigation closely follow or exceed those of the National Flood Insurance Program (NFIP)/Community Rating System (CRS) to support a community's compliance with both. Grading of the building site is also included to reduce the impact of floods. Specific provisions covering flood-resistant design are included in an appendix.

Subsidence: Addressing soil characteristics, water drainage, site grading and foundation design is necessary to help avoid subsidence. All these matters are included within the IBC.

Affordability: Embedded within the development process for the I-Codes is the concept of affordability. All potential updates from edition to edition are examined for their cost effectiveness. This assures that building safety is achieved without overburdening contractors and building owners.

Aging Populations: In addition to means of egress and accessibility requirements that address a wide variety of occupant needs—including those of aging populations—the IBC includes provisions specifically applicable to healthcare facilities. Such facilities include assisted living and nursing home type environments. Code provisions applicable to these building types specifically address the needs of their occupants and the risks they may face.

Environmental Degradation and Pollution: A wide variety of practices within a community can contribute to environmental degradation. For buildings, community-level environmental degradation is addressed in multiple ways through building codes. Through a focus on reducing the impacts of disaster, the IBC limits the clean-up required post-disaster. It also addresses indoor environmental quality. The IECC and the International Green Construction Code (IgCC) address energy use and the associated greenhouse gas emissions. The IgCC also addresses construction waste and the impact of material choices on the environment.

█ *All potential updates from edition to edition are examined for their cost effectiveness.*

Sea Level Rise: Some degree of protection from sea level rise is captured in the elevation requirements within the IBC. As codes evolve to respond to changing risks, additional measures on addressing sea level rise will be developed.

Drought: Provisions specifically focused on water conservation appear within the IPC, IECC and IgCC, but the IBC does include provisions focused on soils which could be impacted by changing moisture content or water table levels. The IPC and IRC provide requirements governing the construction, installation, alteration, and repair of on-site nonpotable water reuse systems, nonpotable rainwater collection and distribution systems, and reclaimed water systems. CSA B805/ICC 805 Rainwater Harvesting Standard and ASABE/ICC 802 Landscape Irrigation Sprinkler and Emitter Standard provide additional criteria to support the safe use of nonpotable water.

Table 2: Select IBC Provisions Contributing to Resilience

Selected Code Topic	Relevant Sections (2018 IBC)	Supported Resilience Strategy	Relevant Hazards
Critical facilities identification	307	<ul style="list-style-type: none"> Emergency planning Community operations Response and recovery 	<ul style="list-style-type: none"> Flooding Hurricanes Tornadoes Blizzards Terrorist Wildfire
Hazardous or combustible materials	413, 414	<ul style="list-style-type: none"> Isolating risks 	<ul style="list-style-type: none"> Terrorist Fire Flooding Hurricanes Tornadoes
Storm Shelters/Areas of Refuge	423, 1009, 1026	<ul style="list-style-type: none"> Shelter in place/Refuge Robustness Community protection 	<ul style="list-style-type: none"> Tornado Terrorist Fire
Flammability of materials	Chapter 6, 7, 8	<ul style="list-style-type: none"> Fire resistance Egress Indoor environmental quality Smoke exposure 	<ul style="list-style-type: none"> Fire Secondary to other hazards
Protection of openings	Chapter 7, 1609.2	<ul style="list-style-type: none"> Structural integrity Debris impacts 	<ul style="list-style-type: none"> Hurricanes Tornadoes
Fire suppression/protection. Smoke control	Chapter 9	<ul style="list-style-type: none"> Fire resistance Egress Property protection 	<ul style="list-style-type: none"> Fire Secondary to other hazards
Communication	907, 908, 917	<ul style="list-style-type: none"> Public safety Evacuation 	<ul style="list-style-type: none"> Fire Terrorist Earthquake Tsunami Tornadoes
Means of egress	Chapter 10	<ul style="list-style-type: none"> Evacuation Fire protection Accessibility 	<ul style="list-style-type: none"> Flooding Hurricanes Tornadoes Blizzards Terrorist Wildfire
Accessibility	Chapter 11	<ul style="list-style-type: none"> Inclusive communities Community cohesion Evacuation 	<ul style="list-style-type: none"> Public welfare Secondary to other hazards
Occupant health	Chapter 12	<ul style="list-style-type: none"> Indoor environmental quality Indoor air quality Access to sanitation 	<ul style="list-style-type: none"> Public health Fire Extreme heat/cold
Exterior envelope performance	Chapter 14	<ul style="list-style-type: none"> Property protection Debris impacts Hazard spreading 	<ul style="list-style-type: none"> Fire Flooding Hurricanes Tornadoes
Roof assemblies	Chapter 15	<ul style="list-style-type: none"> Fire resistance Debris impacts Sealing 	<ul style="list-style-type: none"> Fire Hurricanes Tornadoes Extreme heat/cold

Table 2 *continued*:
Select IBC
Provisions
Contributing to
Resilience

Selected Code Topic	Relevant Sections (2018 IBC)	Supported Resilience Strategy	Relevant Hazards
Moisture protection	1209, 1402, 1503	<ul style="list-style-type: none"> • Durability • Mold, mildew, rot • Property protection 	<ul style="list-style-type: none"> • Blizzards • Hurricanes • Flooding • Thunderstorms
Hazard Maps	1608, 1609, 1611, 1613, 2603	<ul style="list-style-type: none"> • Identifying risk 	<ul style="list-style-type: none"> • Tornado • Hurricane • Seismic • Pests • Snow • Rain
Continuous load paths	Chapter 16	<ul style="list-style-type: none"> • Structural integrity • Anchorage and bracing 	<ul style="list-style-type: none"> • Earthquake • Tornadoes • Hurricanes
Identification of risk	1604.5	<ul style="list-style-type: none"> • Public safety • Emergency planning 	<ul style="list-style-type: none"> • Earthquake • Tornadoes • Hurricanes • Blizzards
Elevation of structures	1612	<ul style="list-style-type: none"> • Flood mitigation • Property protection 	<ul style="list-style-type: none"> • Flooding • Hurricanes • Sea level rise
Tsunami	1615, Appendix M	<ul style="list-style-type: none"> • Identifying risk • Elevation above inundation • Minimum design loads • Evacuation/refuge 	<ul style="list-style-type: none"> • Tsunami
Special inspections	Chapter 17	<ul style="list-style-type: none"> • Verification of performance • Structural integrity • Fire resistance 	<ul style="list-style-type: none"> • Earthquake • Fire • Hurricanes • Flooding • Tornadoes • Blizzards
Soils and foundations	Chapter 18	<ul style="list-style-type: none"> • Load support • Subsidence 	<ul style="list-style-type: none"> • Earthquake • Sea level rise • Drought • Flooding
Material performance	Chapters 19-26	<ul style="list-style-type: none"> • Fire resistance • Structural integrity • Product safety 	<ul style="list-style-type: none"> • Flooding • Hurricanes • Tornadoes • Blizzards • Terrorist • Wildfire
Safety during construction	Chapter 33	<ul style="list-style-type: none"> • Public safety • Fire safety • Means of egress 	<ul style="list-style-type: none"> • Fire • Civil unrest
Fire Districts	Appendix D	<ul style="list-style-type: none"> • Fire safety 	<ul style="list-style-type: none"> • Fire
Flood Resistance	Appendix G	<ul style="list-style-type: none"> • Flood mitigation • Property protection 	<ul style="list-style-type: none"> • Flooding • Hurricanes • Sea level rise

Achieving Community Resilience

The Alliance for National & Community Resilience (ANCR) identified 19 functions that communities provide. The resilience of these functions contributes to the overall resilience of the community. These functions cut across social, organizational and infrastructural aspects of communities. See Figure 7. To be resilient, communities must address the resilience of each of these functions. ANCR is in the process of developing benchmarks for each of these functional areas to allow communities to assess and improve their resilience.

Figure 7: Community Functions



The first ANCR benchmark focused on buildings—an essential element of almost all community functions identified by ANCR. Utilities rely on structures to support their operational activities and represent a large portion of their customer base; schools, hospitals, governments and businesses rely on buildings to provide their services; and public safety officials rely on fire and police stations and emergency operations centers. As discussed above, buildings and the codes that govern their delivery of health, safety and welfare are an essential component of achieving a resilient community.

As recognized within ANCR's Community Resilience Benchmarks (CRBs), adopting model building codes is an essential first step to achieve a baseline level of safety and recoverability from disasters. Individual communities are at various stages in achieving resilience. With respect to their buildings, many regularly adopt and enforce up-to-date building codes, capturing the benefits identified in this white paper. These communities are encouraged to identify and implement strategies that further enhance their resilience through evaluation and rating of their existing building stock, high-performance design criteria for new buildings, and retrofit of older structures. The Enhanced and Exceptional requirements of the ANCR Building Benchmark can provide such strategies.

Conclusion

Building codes will continue to evolve to meet the changing needs of communities. Several communities are looking to extend the role of codes beyond immediate life-safety to assure that buildings continue to support the social and economic needs of a community following a disaster event. These efforts at immediate occupancy or functional recovery will require the development of performance goals and accompanying strategies to achieve those goals. Codes will need to interact with other community-level policies to assure coordination in achieving resilience against all shocks and stresses faced by the community.

Building codes will continue to evolve to meet the changing needs of communities.

Future editions of the IBC will include additional content aimed at improving community resilience. ICC-500: Standard for the Design and Construction of Storm Shelters will be updated in 2020 for inclusion in the 2021 edition of the IBC. ASCE 7: Minimum Design Loads and Associated Criteria for Buildings and Other Structures will include a new chapter on tornado loads in its 2022 edition and is planned for reference in the 2024 I-Codes. Additionally, a new ASCE/SEI/AMS standard on wind speed estimation for tornadoes is in development, significantly improving the current EF-scale.

As communities recognize the growing risks they face and the importance of implementing policies and practices that enhance their resilience, the adoption and enforcement of up-to-date building codes is a fundamental part of the solution. A community cannot be resilient without building codes. The International Building Code provides communities with essential requirements for addressing their risks.

Endnotes

¹ National Flood Insurance Program Community Rating System Coordinator's Manual, FIA-15/2017 (2017).

² Public Assistance Program and Policy Guide, FP 104-009-2 (2018).

³ Some residential structures may comply with either the IBC or the IRC.

Bibliography

(ANCR and ICC) Alliance for National & Community Resilience and International Code Council. *Building Community Resilience through Modern Model Building Codes*. December 2018.

(AIA) American Institute of Architects. *Disaster Assistance Handbook*. Third Edition, March 2017. http://content.aia.org/sites/default/files/2017-05/Disaster_Assistance_Handbook_050917.pdf

(AIA) American Institute of Architects. Building industry statement on resilience. <https://www.aia.org/resources/9336-building-industry-statement-on-resilience:56>. Accessed January 28, 2019.

(FEMA) Federal Emergency Management Agency. *Phase 3 National Methodology and Phase 2 Regional Study Losses Avoided as a Result of Adopting and Enforcing Hazard-Resistant Building Codes*. 2014.

International Code Council. *2018 International Building Code*.

(NIBS) Multihazard Mitigation Council. *Natural Hazard Mitigation Saves: 2018 Interim Report*. Principal Investigator Porter, K.; co-Principal Investigators Scawthorn, C.; Huyck, C.; Investigators: Eguchi, R., Hu, Z.; Reeder, A; Schneider, P., Director, MMC. National Institute of Building Sciences, Washington, D.C. https://www.nibs.org/resource/resmgr/mmc/NIBS_MSv2-2018_Interim-Report.pdf.

National Academies. *Disaster Resilience: A National Imperative*. National Academies Press. 2012

NOAA National Centers for Environmental Information (NCEI) U.S. Billion-Dollar Weather and Climate Disasters. <https://www.ncdc.noaa.gov/billions/>. Accessed January 28, 2019.

PRESENTED BY THE ICC FAMILY OF SOLUTIONS



The Important Role of Energy Codes in Achieving Resilience

TABLE OF CONTENTS

INTRODUCTION	<u>3</u>
DEFINING RESILIENCE	<u>4</u>
THE ENERGY/RESILIENCE NEXUS	<u>8</u>
INTRODUCTION TO ENERGY CODES	<u>10</u>
ENERGY CODES AS A COMPONENT OF RESILIENCE POLICY.....	<u>11</u>
CONCLUSION	<u>16</u>
BIBLIOGRAPHY.....	<u>16</u>
ACKNOWLEDGMENTS	<u>17</u>

INTRODUCTION

In mid-June 2017, the American southwest experienced stifling heat, breaking or tying numerous records for high temperatures (Masters 2017). Late-January 2019 saw a polar vortex entering midwest states, delivering “prolonged, life-threatening cold” (Pydynowski 2019). The 2017 Hurricane Season brought significant devastation along the Atlantic and Gulf coasts and islands in the Caribbean, leaving millions of people without power for extended periods of time.

These events and the growing frequency and intensity of disasters (NOAA 2019) in general point to the need to think and act differently. Enhancing community resilience has been identified as a key strategy for assuring communities are prepared for such events.

Building codes are an essential strategy in achieving resilience. Building codes provide minimum requirements to protect life-safety in the built environment—every day and particularly in the face of hazards. Energy codes are no exception. Code-based strategies to enhance community resilience must be coordinated across all building codes including energy, plumbing, mechanical, electrical and fire codes. While energy codes have primarily developed to enhance energy efficiency (a resilience goal in and of itself), they also are an important contributor to individual and community resilience in other ways. Figure 1 illustrates the contributions of energy codes to resilience. This paper examines the intersection of energy and resilience (here labeled the energy/resilience nexus) and the important role of energy codes in supporting community resilience. It is a supplement to the recent report *Building Community Resilience through Modern Model Building Codes* (ANCR and ICC 2018) and the second in a series of white papers on how various codes contribute to resilience (ICC 2019).



Figure 1: Energy Code Contributions to Resilience

DEFINING RESILIENCE

Nearly 50 organizations representing all aspects of the planning, design, construction, ownership, operations, management, regulation, and insurance of the built environment have signed on to an “Industry Statement on Resilience (AIA 2019).” Through the Statement the organizations have adopted a common definition for resilience based on one developed by the National Academies (2012), “the ability to prepare and plan for, absorb, recover from, and more successfully adapt to adverse events.”

The adverse events anticipated in the definition may take many forms including extreme, acute events like hurricanes, tornadoes, and earthquakes or more prolonged, chronic events like heat waves, cold snaps, and droughts. Adverse events could also include social challenges like loss of a major employer, growing poverty or homelessness, or economic downturns. Often, an initial adverse event may produce cascading impacts or secondary events that further stress a community. See Figure 3 for hazards and potential secondary hazard effects. The lack of power following a disaster (particularly in the middle of summer or winter) can lead to additional deaths as was the case in elder care facilities in Florida following Hurricane Irma (O’Matz, 2017).

Industry Statement on Resilience

Representing nearly 1.7 million professionals, America’s design and construction industry is one of the largest sectors of this nation’s economy, generating over \$1 trillion in GDP. We are responsible for the design, construction, and operation of the buildings, homes, transportation systems, landscapes, and public spaces that enrich our lives and sustain America’s global leadership.

We recognize that natural and manmade hazards pose an increasing threat to the safety of the public and the vitality of our nation. Aging infrastructure and disasters result in unacceptable losses of life and property, straining our nation’s ability to respond in a timely and efficient manner. We further recognize that contemporary planning, building materials, and design, construction and operational techniques can make our communities more resilient to these threats.

Drawing upon the work of the National Research Council, **we define resilience as the ability to prepare and plan for, absorb, recover from, and more successfully adapt to adverse events.**

As the leaders of this industry, we are committed to significantly improving the resilience of our nation’s buildings, infrastructure, public spaces, and communities.

- **We research** materials, design techniques, construction procedures, and other methods to improve the standard of practice.
- **We educate** our profession through continuous learning. Through coordinated and continuous learning, design, construction and operations professionals can provide their clients with proven best practices and utilize the latest systems and materials to create more resilient communities.
- **We advocate** at all levels of government for effective land use policies, modern building codes, and smarter investment in the construction and maintenance of our nation’s buildings and infrastructure.
- **We respond** alongside professional emergency managers when disasters do occur. Industry experts routinely work in partnership with government officials to survey damage, coordinate recovery efforts, and help communities rebuild better and stronger than before.
- **We plan** for the future, proactively envisioning and pursuing a more sustainable built environment.

The promotion of resilience will improve the economic competitiveness of the United States. Disasters are expensive to respond to, but much of the destruction can be prevented with cost-effective mitigation features and advanced planning. Our practices must continue to change, and we commit ourselves to the creation of new practices in order to break the cycle of destruction and rebuilding. Together, our organizations are committed to build a more resilient future.

CULTIVATORS

led the effort to establish and implement the Statement with their industry peers



FOUNDERS

united to define the goals and objectives of a resilient built environment



AMPLIFIERS

joined the founding signatories in committing to the advancement of Statement goals



Figure 2. Industry Statement on Resilience



Primary Hazards	Structural Damage	Utility Outage	Chemical Release/ Spill	Commodity Shortages	Emergency Comm. Failure	Erosion	Structural Fire	Mold	Carbon Monoxide Poisoning	Disease	Flooding	Landslide	Dam Failure	Storm Surge	Tornado	Wildfire	Hail	Tsunami
Coastal Erosion	x										x	x						
Coastal Flooding	x		x			x		x		x		x						
Inland Flooding	x	x	x			x		x		x		x	x					
Hurricane/ T.S.	x	x	x	x	x	x		x	x	x	x			x	x			
Tornado/ Downburst	x	x	x					x										
Major Thunderstorm/ lightning		x					x								x	x	x	
Earthquake	x	x	x	x	x		x		x			x	x					x
Winter Storms/nor'easters	x	x		x		x	x		x		x			x				
Ice Storms	x	x		x	x		x		x									
Ice Jam	x										x		x					
Landslide	x					x												
Wildfires	x						x											
Tsunami	x	x	x	x		x		x		x	x							
Major Urban Fire	x	x	x															
Drought				x												x		
Epidemic / Pandemic Disease				x														

Figure 3. Secondary Hazard Effects Matrix (Linnean 2013)

Source: MA Hazard Mitigation Plan (2010) p. 117 Table 14

In many cases, adverse events may have a particularly strong impact on vulnerable populations. Vulnerable populations are “any individual, group, or community whose circumstances create barriers to obtaining or understanding information, or the ability to react as the general population. Circumstances that may create barriers include, but are not limited to age; physical, mental, emotional, or cognitive status; culture; ethnicity; religion; language; citizenship; geography; or socioeconomic status (Iowa 2008).” These vulnerabilities may be particularly pronounced during chronic events where access to financial resources could serve to limit an event’s impact. For example, residents living paycheck to paycheck may need to make tough choices around whether to forgo other necessities to heat their home during a cold snap.

Resilience is not a strategy to be deployed in isolation. As recognized in the Energy Independence and Security Act of 2007, a high-performance building is one that, “integrates and optimizes on a life cycle basis all major high-performance attributes, including energy conservation, environment, safety, security, durability, accessibility, cost-benefit, productivity, sustainability, functionality, and operational considerations (EISA 2007).” High-performance communities should also take a holistic approach recognizing the need for integration and optimization.

Communities act as systems. A community is only as resilient as its weakest link (ANCR 2018). The Alliance for National & Community Resilience (ANCR) has identified 19 functions that contribute to a community and its resilience (See Figure 4). Identifying strategies that support the resilience of multiple community functions or help address other community priorities including energy efficiency can help reduce the overall cost of implementation and satisfy diverse stakeholder groups. Such an approach recognizes the potential for co-benefits and leverages potential synergies.



Figure 4. Functions that Define Community Resilience

THE ENERGY/RESILIENCE NEXUS

While significant attention is being paid to community resilience, the literature exploring linkages between resilience and energy, the “energy/resilience nexus,” have been limited. This is even more pronounced when considering how building energy codes contribute to resilience. After discussing the broad energy/resilience nexus literature to date, this white paper will focus on energy codes as a resilience strategy.

Energy plays a significant and varying role in modern life. It facilitates activities across the economy from transportation to buildings to manufacturing. Critical lifelines, water and wastewater systems, communications, emergency response and transportation networks all require energy to function. To date, the literature on resilience has either focused on addressing energy-related resilience needs broadly with buildings as a subset or building-related resilience literature has only touched on energy-related aspects.

The City of Boston undertook an effort to identify best practices for climate change adaptation and resilience in its existing building stock. The resultant study looked at the building stock in Boston and the potential vulnerabilities that would need to be addressed now and into the future. Floods and winter storms were identified as the most frequent potential events with hurricanes, severe storms, tornadoes and brush fires following. Based on these risks, the study identified specific strategies to address these risks. About one-third of the 30 recommendations related to building systems, building enclosures and other energy-related aspects of buildings (Linnean 2013). See Figure 5.

The American Council for an Energy-Efficient Economy (ACEEE) has developed multiple papers looking at the energy/resilience nexus. Its 2015 paper on *Enhancing Community Resilience through Energy Efficiency* takes a very comprehensive look at the resilience benefits of

energy efficiency (see Figure 6) and the energy efficiency measures that reduce vulnerability and increase capacity to cope (Figure 7). Building-related strategies feature prominently, but the paper does not delve into specifics around how building energy codes relate (Ribeiro et. al. 2015). In follow-on work ACEEE looked at potential metrics that could be used to understand the energy-resilience of a community. This 2017 paper did include discussion on multiple building-related and energy affordability strategies and potential metrics (Ribiero and Bailey 2017).

The National Association of State Energy Officials (NASEO) looked at the role of state energy offices in contributing to community resilience with a specific focus on residential structures. NASEO identified numerous challenges to integrating energy efficiency and resiliency into residential rebuilding including motivating property owners and developers to value energy efficiency and disaster resilience during the rebuilding process, identifying and understanding the various sources of rebuilding funding and assistance, and working with property insurance providers to allow upgrades above the value of the pre-existing structure. Despite these challenges, they identified six helpful strategies including leveraging existing programs and relationships, ongoing coordination and planning in advance of an event, and conducting evaluations to see what worked (NASEO 2015).

General Actions	Assess Vulnerability and Risk
	Create Places of Refuge
Site	Build for Higher Rainflow
	Create Cool Ground Surfaces
	Floodproof Building Site
	Floodproof Industrial Buildings
	Use Hard Infrastructure to Prevent Flooding
	Use Hazard Resilient Landscape Design
	Protect Entrances from Snow and Ice
	Provide Shade
	Reduce Vulnerability to Wind Damage
	Use Soft/Green Infrastructure to Prevent Flooding
	Stabilize Slopes Susceptible to Erosion, Landslide, Fire
Building Structure	Enhance Structural Elements for Extreme Loads
Building Enclosure	Use Cool Roofing
	Enhance Building Insulation
	Increase Resistance to High Winds
	Manage Heat Gain
Building Systems	Resilient Back-up Power and Systems
	Resilient Heating, Cooling and Ventilation Systems
	Resilient Water Systems During Outages
	Extend Emergency Lighting and Services
Building Operations	Have Emergency Communications Plans
	Protect Records and Inventory
	Secure Interior Environment
	Train Building/Facility Teams for Resilience Upgrades
People	Educate Households
	Partner with Local Community Organizations to Enhance Resilience
	Locate Vulnerable Populations
	Plan for Tenant Needs

Figure 5. Boston's Resilience Strategies for Existing Buildings (Linnean et. al. 2013)

Benefit type	Energy efficiency outcome	Resilience benefit
Emergency response and recovery	Reduced electric demand	Increased reliability during times of stress on electric system and increased ability to respond to system emergencies
	Backup power supply from combined heat and power (CHP) and microgrids	Ability to maintain energy supply during emergency or disruption
	Efficient buildings that maintain temperatures	Residents can shelter in place as long as buildings' structural integrity is maintained.
	Multiple modes of transportation and efficient vehicles	Several travel options that can be used during evacuations and disruptions
Social and economic	Local economic resources may stay in the community	Stronger local economy that is less susceptible to hazards and disruptions
	Reduced exposure to energy price volatility	Economy is better positioned to manage energy price increases, and households and businesses are better able to plan for future.
	Reduced spending on energy	Ability to spend income on other needs, increasing disposable income (especially important for low-income families)
	Improved indoor air quality and emission of fewer local pollutants	Fewer public health stressors
Climate mitigation and adaptation	Reduced greenhouse gas emissions from power sector	Mitigation of climate change
	Cost-effective efficiency investments	More leeway to maximize investment in resilient redundancy measures, including adaptation measures

Figure 6. Resilience Benefits of Energy Efficiency (Ribiero et.al. 2015)

Following Hurricane Sandy, the Urban Green Council undertook an effort to look specifically at how the temperatures inside buildings without power are impacted during both summer and winter. Details on this work are provided in the discussion below on passive survivability (Urban Green 2015).

The most specific paper looking at energy codes and resilience was published in 2013 and focused on individual residential code provisions and their impacts on resilience. The content remains relevant and is captured in the discussion below (Meres and Makela 2013).

INTRODUCTION TO ENERGY CODES

Energy codes were born out of a national crisis. The oil embargo and following energy crisis in the 1970s brought national attention to the need for criteria focused on building energy use. However, energy efficiency in homes caught the attention of the federal Housing and Home Finance Agency (a precursor to the U.S. Department of Housing and Urban Development) in 1950. HHFA developed requirements for residential energy efficiency following defaults on federally backed mortgages due to high energy bills. Development of standards for commercial building energy efficiency were triggered by a blackout in New York in 1970 (ASE 2013).

Today, those early efforts manifest themselves in model energy codes and standards intended for adoption by federal, state and local governments and as the basis for incentive and other programs. ASHRAE first published Standard 90: Energy Conservation in New Building Design in 1975. The standard has been regularly updated since then and is now known as ANSI/ASHRAE/IES Standard 90.1: Energy Standard for Buildings Except Low-Rise Residential. Predecessor organizations to the International Code Council published energy efficiency codes, but the International Energy Conservation Code (IECC) was released in 1998 as a national model code. The IECC and ASHRAE Standard 90.1 are updated on a three-year cycle.

In the Energy Policy Act of 1992 (EPA 1992), Congress explicitly recognized the importance of national model energy codes in meeting national priorities. EPA 1992 required states to report on their adoption of energy codes and whether they meet the currently published model codes. Similar requirements remain in law to this day.

Congress reaffirmed the importance of energy codes as it dealt with a national crisis of another form—recession. The American Recovery and Reinvestment Act of 2009 (ARRA) required states to commit to adopting the latest energy codes as a requirement of receiving certain energy stimulus funding. Plans to achieve high levels of code compliance were also required.

Energy codes have become an important component of building codes and support achievement of national and local priorities—including providing social, economic and infrastructural resilience as outlined in the sections that follow. Provisions from the IECC are directly incorporated into the International Building Code (IBC)(Chapter 13) and the International Residential Code (IRC)(Chapter 11). The IBC and IRC are adopted nationwide (all 50 states and 49 states respectively) and serve as the basis for federal, state and local incentive programs focused on advancing resilience. The IECC and Standard 90.1 are also widely adopted nationally—in 48 states for residential buildings and 41 states for commercial buildings.

Energy efficiency measure	Resilience implications
CHP	Provides backup power, allows facilities receiving backup power to double as shelter for displaced residents, reduces overall net emissions, and potentially increases cost savings
Microgrids	May disconnect from grid during power outage, maintaining power supply; allows facilities receiving backup power to double as shelter for displaced residents; reduces overall net emissions; and potentially increases cost savings
Transportation alternatives	Multiple transportation modes that can be used during evacuations and everyday disruptions
District energy systems	Provides heating, cooling, and electricity using local energy sources and reduces peak power demand through thermal energy storage
Utility energy efficiency programs	Increases reliability and reduces utility costs
Energy-efficient buildings	Allows residents/tenants to shelter in place longer, reduces annual energy spending, and reduces overall net emissions. Can help vulnerable populations avoid dangerous and occasionally life-threatening situations in which weather and economics present a dual threat
Green infrastructure	Reduces localized flooding due to storms, reduces energy demand, and reduces urban heat island (UHI) effect in cities and electricity demand
Cool roofs and surfaces	Reduces UHI effect and electricity demand and reduces overall net emissions
Transit-oriented development	Increases economic development opportunities; provides transportation cost savings and reduces impacts of price volatility; and may improve air quality

Figure 7. Energy Efficiency Measures that Reduce Vulnerability and Increase Capacity to Cope (Ribiero et.al. 2015)

ENERGY CODES AS A COMPONENT OF RESILIENCE POLICY

Community resilience focuses on deploying strategies that provide benefits before, during, and after disasters. The most commonly identified building-related strategies at the energy/resilience nexus have focused on passive survivability and reducing the urban heat island effect. While these approaches are a critical piece of the energy resilience nexus, they are not the only piece.

PRE-DISASTER/MITIGATION

SOCIAL RESILIENCE

Whole community resilience requires a focus on social, infrastructural and economic issues. Energy (and water) related policies and practices squarely fall within all three realms. Effective energy policies and practices contribute to the social resilience of a community and can help avoid significant burdens on vulnerable populations. Energy efficiency in particular supports local economies and local businesses by allowing funds otherwise spent on utility costs to remain in the community (Ribiero et. al. 2015).

Economically vulnerable populations must regularly balance energy costs with other important needs. The median energy burden for low-income households is more than twice that of average households (Drehobl and Ross 2016). High-energy burdens can mean that households have limited capacity to prepare for and respond to adverse events. They may also stress low-income residents, impacting their long-term health and well-being (in addition to the physical effects of inadequate housing).

In addition to the energy burden, volatility in energy prices may cause residents to become increasingly vulnerable and may hinder a business's ability to operate or expand. Overall energy costs may also fluctuate as extreme heat or cold require elevated use of heating or cooling. Again, energy efficiency provides a limit to the exposure level a homeowner or business owner may have to pricing volatility.

Reducing the energy burden through energy efficiency measures provided in energy codes can help reduce one potential source of vulnerability.

COMMUNITY HEALTH THROUGH REDUCED AIR POLLUTION

Energy generation produces multiple air pollutants including particulate matter (PM). Such pollutants can create or enhance health-related vulnerabilities in the form of asthma and other breathing issues. Such health impacts can influence the resilience of a community both pre- and post-disaster. An increased number of residents needing health care resources post-disaster can add unnecessary strain to the recovery effort. Such effects may even be further compounded when disasters have direct influence on health—extreme heat or cold for example.

Energy efficiency measures reduce energy generation and thus the pollutants associated with such generation. A reduction in health stressors can also reduce a potential source of vulnerability.

According to ACEEE, reducing electricity use by 15 percent for one year would result in saving six lives each day, up to \$20 billion in avoided health harms and nearly 3,000 fewer asthma episodes (Hayes and Kubes 2018).

URBAN HEAT ISLANDS

Urban environments tend to be several degrees warmer than the surrounding suburbs. This is due to a variety of factors, but certainly building energy efficiency measures including roofing material choices can help reduce these effects. Such measures could influence the severity of extreme heat events at a community level while also supporting passive survivability in individual buildings during such events.

DISASTER/LIFE-SAFETY

EXTREME TEMPERATURES

During extreme heat or cold events, energy infrastructure can be significantly stressed (DOE 2013). The polar vortex in 2014 caused increases in natural gas demand which could not be met by many utility systems. A 2016 Southern California heat wave ended up leaving 5,300 households without power for several hours as Los Angeles saw peak demand reach 50% higher than average (Ribeiro and Bailey 2017). Buildings constructed to be energy efficient maintain temperatures longer and require less energy to provide heating or cooling, resulting in less stress on the grid. This may allow the grid to remain functional during such an event, resulting in decreased overall impact to the entire community. A natural gas utility in Michigan recently experienced distribution challenges when a compressor station failed due to a fire. Residents were asked to lower their thermostats during freezing weather to allow continued service (Wisely and Hall 2019). Without energy efficiency measures like those contained in the energy code, the required use reductions would have been significantly higher, causing further reductions in service.

In conjunction with the decreased impact during extreme events, energy efficiency contributes to reductions in peak demand. During times of peak demand, the grid can also be significantly stressed. Smoother peaks can support resilience by lessening the extent of extreme conditions and allowing investments to be made to support everyday operations and reduced vulnerabilities (AEE 2015).

REDUCED IMPACTS FROM PRIMARY HAZARD EVENTS

In the midst of other hazard events including hurricanes and tornadoes, wind-borne debris can cause property damage or result in injuries. In earthquake and wind events, the structural stability of buildings is important. Wildfires or chemical release incidents can spread contaminants that may enter facilities causing health risks. During droughts, potable water use becomes a critical issue. In some cases, energy efficiency-focused measures can also contribute to the ability to withstand and remain operational during such events.

Highly-efficient windows can reduce the impact of projectiles either through the application of films or by nature of its multiple panes. Some insulation applications can also enhance building strength and stiffness. Controlled ventilation strategies can reduce the infiltration of outdoor contaminants. Pipe insulation can reduce the need to run water to achieve the desired temperature, thus resulting in less waste during drought.

POST-DISASTER/RECOVERY

The recovery process post-disaster is often a stressful time. Many residents and businesses may have suffered extensive damage to their homes and businesses. Often, the community is looking to “get back to normal.” If energy-related concerns (like those discussed below) are minimized, employees, business owners, first responders, and community leaders have one less challenge to address as the community recovers.

EXTENDING ON-SITE GENERATION AFTER LOSS OF POWER

Disaster events typically trigger loss of power for significant parts of the impacted community. This loss of power may linger for a significant time following the disaster, contributing to delays in recovery. Critical facilities would be particularly vulnerable to power outages, so many have deployed on-site generation and storage strategies to support continued operations. Non-critical facilities including businesses and homes also have installed generators to avoid the potential long-term challenges associated with power loss.

Coupled with on-site generation, energy efficiency measures deployed during design and construction and maintained in operations support both community and facility level resilience. Energy efficiency extends the supply of on-site power generation by reducing the overall energy needs to provide essential functions. This could result in either a reduction in on-site fuel storage needs and generator capacity or allow for longer operations without grid-provided electricity. Extended operating time reduces the burden on emergency shelters and emergency planners to implement contingency plans. Resources can be focused on more pressing community needs.

Further, if renewable energy generation (or CHP) is available on-site (with islanding capabilities) the facility may also continue to function post-disaster. Again, effective energy efficiency measures can reduce the burden placed on such systems (or allow the systems to cover the necessary loads). The renewable system may also fulfill a portion of a facility's electricity needs when the grid is under pressure (during an extreme heat event for instance).

PASSIVE SURVIVABILITY

Passive survivability is the ability for a building to remain habitable in the face of an event or crisis resulting in the loss of energy, water or sewage services. The need for passive survivability may surface during extreme heat or cold events when the grid is severely taxed or secondary to other hazard events. Temperature extremes can stress the grid, resulting in blackouts.

Incorporating measures related to passive survivability can help support resilience on two ends—reducing energy demands through increased efficiency thus reducing grid strain and keeping buildings occupiable for longer periods reducing shelter or other emergency services needs. Urban Green Council and Atelier Ten looked at passive survivability potential in New York City’s existing building stock (Urban Green 2014, Leigh et. al. 2014). The study found that during a winter blackout a typical high-rise apartment would drop to 45°F within three days and continue to fall. Buildings that met building codes in place at that time (ASHRAE 90.1-2007 and 2009 IECC) remained about 10°F warmer than older buildings. Subsequent improvements in the code likely lead to even greater improvements in performance relative to the existing building stock. In a summer blackout, a typical high-rise apartment would reach 95°F by the fourth day and peak at over 100°F. Code compliant buildings provided a few additional degrees of relief.

Extreme temperatures can lead to hypothermia and hyperthermia and other significant health risks. Impacts can begin at 61°F where respiratory resistance may be compromised. At 54°F blood pressure rises leading to increased heart attack or stroke risk. Environments below 41°F can lead to hyperthermia (Baker 2013). Hypothermia and heat stroke can set in when the internal body temperature reaches 104°F (NIH 2012). The heat index, a combination of temperature and relative humidity, determines risk for hyperthermia. A heat index of 105°F is considered dangerous and can occur when the dry bulb temperature exceeds 98°F and relative humidity is at 40 percent (Leigh et.al. 2014).

Power outages and extreme temperatures present particular challenges to vulnerable populations. The elderly and infirm are most susceptible to temperature extremes and may be unwilling or unable to leave their homes. The 1995 heat wave in Chicago saw hundreds of deaths—many elderly residents who were unwilling to leave their homes (Klineberg 2002). Economically vulnerable populations also may suffer as they make hard choices on whether to increase their energy spend in the face of extreme heat or cold.

Multiple provisions within the energy code contribute to conditions that support passive survivability. Enclosure criteria around insulation, air barriers, solar heat gain, glazing and fenestration support temperature-related aspects. While the building enclosure performance garners most of the attention around passive survivability, other code provisions are also relevant. Pipe insulation can prevent the freezing of pipes during extreme cold events. Daylighting can support continued use of spaces when emergency lighting is insufficient or when back-up power runs out. Access to daylight may also support occupant mental health during an otherwise stressful time.

Using energy codes to provide enhanced passive survivability provides significant co-benefits. Community and individual resilience is enhanced while building owners and tenants reap energy efficiency related rewards everyday in the form of lower energy bills and greater cost certainty.

ROT, MOLD AND MILDEW

In addition to power outages, communities may see secondary impacts affecting residents. Following extreme temperature and some water-related events (e.g., flooding, hurricanes, severe storms) incidents of mold, mildew and other indoor environmental quality issues may arise. Rot and durability issues are also of concern. To prevent rot, mold, and mildew, the energy code dives deep into the field of building science—controlling heat, air, and moisture transfer in building enclosures (Brinker 2017).

Warm air that comes in contact with a cooler surface can condense water onto that surface. Throughout different seasons and climate zones, houses are full of areas where warmer air and surfaces come in contact with cooler air and surfaces. Preventing that condensation through proper sealing, insulation materials, and construction techniques is what keeps the rot, mold, and mildew from running rampant. Energy code provisions that control moisture include:

- Air barriers. Air barriers prevent air—which carries moisture—from carrying and depositing that moisture right into the wall cavities.
- Slab-on-grade insulation. Take a cold slab in the winter and add warm conditioned air above it: you get condensation. Slab-edge insulation, if done properly according to code, reduces the risk of condensation.

- Sealing at rim joists. Rim joists are often easy to insulate but difficult to properly air seal. So, in colder climates, air (and moisture) passes through the insulation and condenses on the rim joists, keeping those rim joists moist for months on end. First the mold sets in, and then the rim joists get rotted out, making the building unsafe. Air sealing the rim joists according to code protects against this.
- Window U-factors and thermal barriers. Warm conditioned air that comes in contact with the cold surface of windows in winter months can condense, damaging nearby wall, ceiling, and floor materials over time. Better-quality windows specified by climate zone in the code significantly reduce this condensation.
- Insulation and sealing to avoid ice dams. Ice dams are thick ridges of ice that build up along the eaves. These can tear off shingles and cause water to build up and leak into the house. Ice dams form when warm air seeps through cracks and crevices into an unconditioned attic, causing snow to melt on the roof but refreeze at the cold eaves. Properly insulating and sealing the ceiling assembly, as specified in the energy code, is the solution.

ADDITIONAL BENEFITS

Energy codes may also help avoid additional cascading effects following a disaster. This is particularly true for provisions concerning the building envelope and ventilation. Wildfires and other disasters that generate airborne particulates could present health concerns for citizens still in the area. Controlled ventilation practices may reduce the level of air pollutants indoors, allowing for extended occupancy and reducing the potential incidents of illness like asthma in a health system already under stress.

Selected Code Topic	Relevant Sections (2018 IECC)	Supported Resilience Strategy	Relevant Hazards
Insulation	C402.2, R402.2	<ul style="list-style-type: none"> ▪ Passive survivability ▪ Reduced energy burden ▪ Reduced grid impact ▪ Reduced ice-dams ▪ Reduced condensation, limiting mold and mildew 	<ul style="list-style-type: none"> ▪ Extreme heat ▪ Extreme cold ▪ Snow storms ▪ Social resilience ▪ Secondary impacts to all hazards
Walk-In Coolers and Freezers	C403.10	<ul style="list-style-type: none"> ▪ Food safety/preservation 	<ul style="list-style-type: none"> ▪ Extreme heat ▪ Secondary impacts to all hazards
Daylighting	C402.4.1	<ul style="list-style-type: none"> ▪ Passive survivability ▪ Reduced grid impact 	<ul style="list-style-type: none"> ▪ Extreme heat ▪ Secondary impacts to all hazards
Window-to-Wall Ratios	C402.4.1, R402.3	<ul style="list-style-type: none"> ▪ Passive survivability ▪ Impact vulnerabilities 	<ul style="list-style-type: none"> ▪ Extreme heat ▪ Extreme cold ▪ Hurricanes ▪ Tornadoes
Solar Heat Gain Coefficient	C402.4.3, R402.3.2	<ul style="list-style-type: none"> ▪ Passive survivability ▪ Reduced grid impacts 	<ul style="list-style-type: none"> ▪ Extreme heat ▪ Secondary impacts to all hazards
Solar Reflectance of Roof	C402.3	<ul style="list-style-type: none"> ▪ Urban heat island ▪ Passive survivability 	<ul style="list-style-type: none"> ▪ Extreme heat ▪ Secondary impacts to all hazards
Air Leakage	C402.5, R402.4	<ul style="list-style-type: none"> ▪ Contaminants (secondary to wild-fire, earthquake, etc.) ▪ Mold and mildew (secondary to flooding, hurricane, extreme cold, etc.) 	<ul style="list-style-type: none"> ▪ Secondary impacts to all hazards
Pipe Insulation	C404.4, R403.4	<ul style="list-style-type: none"> ▪ Passive survivability ▪ Reduced energy burden 	<ul style="list-style-type: none"> ▪ Extreme cold ▪ Drought ▪ Social resilience
On-Site Renewable Energy	C406.5, Appendix CA, Appendix RA	<ul style="list-style-type: none"> ▪ Contribute to distributed generation ▪ Facilitates islandability 	<ul style="list-style-type: none"> ▪ Secondary impacts to all hazards

Table 1. Select Energy Code Provisions Contributing to Resilience

POTENTIAL FUTURE CODE-BASED SOLUTIONS, RESEARCH NEEDS AND POLICY PLANNING

While today's energy codes clearly contribute to community resilience, opportunities remain to further enhance these provisions and leverage future research to support increased linkages.

Discussion is emerging around the development of immediate occupancy codes or functional recovery standards that focus on keeping buildings occupiable and operational following a hazard event (rather than just immediate life-safety). As the conversation advances, participants should be cognizant of the important role energy plays in the functionality of buildings. As outlined above, energy efficiency and strategies contained in energy codes can contribute to keeping a building functional.

While today's energy codes contribute significantly to the achievement of passive survivability, they have not specifically been developed with such a result in mind. Such strategies should examine the role of operable windows, passive ventilation and other technologies. Targeted research along with the development of metrics focused specifically on human needs (not just comfort) and methodologies for testing the performance and achievement of passive survivability strategies will allow development of criteria that actively support the long-term occupation of buildings post-disaster.

Existing technology incorporated into energy codes can be further leveraged to enhance resilience. Occupancy and other sensors that help control things like lighting or ventilation could be enhanced to include features that help locate victims following a disaster event. The flexibility provided by solid-state lighting technology and the internet of things (IOT) could support enhanced communication methods before, during and after a disaster event.

The evolving electrical grid with the addition of distributed generation resources and smart meters can enhance community resilience. This evolution will certainly impact and be impacted by how buildings interact with the grid. Effectively managing distributed generation and capitalizing on the resilience such generation could provide requires increased focus on the connections between buildings and the grid. Buildings will need to be able to synthesize information they receive from the grid and respond. Building professionals will need education and training to understand these new dynamics. Codes and standards will need updating to address these changes (ASHRAE 2018).

Microgrids and islanding of facilities with on-site generation present a significant opportunity to enhance resilience that is not yet widely applied. As their use increases, codes and standards must develop to ensure that they effectively address resilience, energy efficiency and safety concerns and opportunities.

Expanding on the role energy efficiency serves in extending the supply or productivity of on-site power generation, the use of direct current (DC) from renewable generation may avoid energy losses associated with inverters. This allows more generated energy to be put to its intended use, allowing more essential needs to be filled when the grid goes down. To capture this benefit, DC-native products must be available. Again, codes and standards have an important role in this transition.

As federal, state and local governments look to advance resilience, strong, regularly adopted and properly administered building codes are fundamental (ANCR and ICC 2018). Energy codes are a key component of building codes and firmly contribute to individual and community-level resilience as demonstrated by the discussion above. Therefore, ICC makes the following recommendations to assure that these benefits are effectively captured:

- Any policies, guidance or criteria that includes building codes as a strategy should explicitly incorporate energy codes as a fundamental resilience strategy. This is particularly relevant as FEMA develops criteria in support of implementation of the Disaster Recovery and Reform Act (DRRA).
- Grant programs funding mitigation should look to include energy-related measures and where possible reward mitigation projects that include co-benefits of reduced energy use and enhanced resilience. These include high-performance building enclosures, combined heat and power, microgrids, energy storage, and islandable renewables.
- All federal agencies engaged in code-related initiatives should coordinate their activities and messaging to support a holistic approach on the importance of building codes.

CONCLUSION

From their initial creation through today, building energy codes have played a major role in reducing the impacts of adverse events. Before, during and after disasters building energy codes influence both individual and community capacity to withstand and bounce back from such events. As policymakers consider approaches that enhance resilience, energy codes should be a cornerstone.

BIBLIOGRAPHY

- (AEE) Advanced Energy Economy. *Peak Demand Reduction Strategy*. October 2015. <https://info.aee.net/hubfs/PDF/aee-peak-demand-reduction-strategy.pdf>.
- (ANCR and ICC) Alliance for National & Community Resilience and International Code Council. *Building Community Resilience through Modern Model Building Codes*. December 2018.
- (AIA) American Institute of Architects. Building industry statement on resilience. <https://www.aia.org/resources/9336-building-industry-statement-on-resilience:56>. Accessed January 28, 2019.
- (ASE) Alliance to Save Energy. *The History of Energy Efficiency*. https://www.ase.org/sites/ase.org/files/resources/Media%20browser/ee_commission_history_report_2-1-13.pdf. January 2013.
- ASHRAE. *Building Our New Energy Future: What Building Professionals Need to Know about Changes Coming to the Electricity Sector*. https://www.ashrae.org/File%20Library/About/Leadership/new_energy_future_web_061518.pdf. June 2018.
- Baker, W. "Fuel Poverty and Ill Health—A Review." *Age and Aging*. Volume 15. 2013.
- Brinker, C.H. "Energy Codes are Life Safety Codes" *Builder Magazine*. September 1, 2017. https://www.builderonline.com/building/building-science/energy-codes-are-life-safety-codes_o.
- (DOE) Department of Energy. *U.S. Energy Sector Vulnerabilities to Climate Change and Extreme Weather*. 2013
- Drehobl, A., and L. Ross. *Lifting the High Energy Burden in America's Largest Cities: How Energy Efficiency Can Improve Low-Income and Underserved Communities*. Washington, DC: ACEEE. 2016. aceee.org/research-report/u1602.
- (EISA) U.S. Congress. *Energy Independence and Security Act of 2007*. Pub.L. 110-140.
- Federal Emergency Management Agency. *Mitigation Ideas: A Resource for Reducing Risk to Natural Hazards*. January 2013.
- Hayes, S. and C. Kubes. *Saving Energy, Saving Lives: The Health Impacts of Avoiding Power Plant Pollution with Energy Efficiency*. ACEEE. February 2018. <https://aceee.org/research-report/h1801>.
- Iowa Public Health Preparedness Program. *Emergency Planning for People with Disability*. November 2008.
- International Code Council. *2018 International Energy Conservation Code*.
- International Code Council. *Resilience Contributions of the International Building Code 2019*.
- Klineberg, E. *Heat Wave: A Social Autopsy of Disaster in Chicago*. University of Chicago Press. 2002.
- Leigh, R., J. Kleinberg, C. Scheib, R. Unger, N. Kienzl, M. Esposito, E. Hagen, and M. Tillou. *Leaks and Lives: Better Envelopes Make Blackouts Less Dangerous*. ACEEE Summer Study on Energy Efficiency in Buildings. 2014.
- Linnean Solutions, The Built Environment Coalition and The Resilient Design Institute. *Building Resilience in Boston*. July 2013.
- Masters, J. Summary of the Great Southwest U.S. Heat Wave of 2017. *Weather Underground*. <https://www.wunderground.com/cat6/summary-great-southwest-us-heat-wave-2017>. June 23, 2017.
- Meres, R., E. Makela. *Building Energy Codes: Creating Safe, Resilient and Energy-Efficient Homes*. July 2013.

- NASEO. *Resiliency through Energy Efficiency: Disaster Mitigation and Residential Rebuilding Strategies for and by State Energy Offices*. March 2015.
- National Academies. *Disaster Resilience: A National Imperative*. National Academies Press. 2012.
- (NIH) National Institutes of Health. “Hypothermia: Too Hot for Your Health.” 2012. <https://www.nih.gov/news-events/news-releases/hyperthermia-too-hot-your-health-1>.
- NOAA National Centers for Environmental Information (NCEI) U.S. Billion-Dollar Weather and Climate Disasters. <https://www.ncdc.noaa.gov/billions/>. Accessed January 28, 2019.
- O’Matz, M..Inside the nursing home where 12 died during Hurricane Irma: 99 degrees. <https://www.sun-sentinel.com/news/hollywood-nursing-home-hurricane-deaths/fl-reg-nursing-home-dehydration-20171227-story.html>. December 28, 2017.
- Pydynowski, K. Polar vortex to bring prolonged, life-threatening cold outbreak to midwestern US this week. Accuweather. <https://www.accuweather.com/en/weather-news/polar-vortex-to-bring-prolonged-life-threatening-cold-outbreak-to-midwestern-us-this-week/70007262>. January 28, 2019.
- Ribeiro, D., E. Mackres, B. Baatz, R. Cluett, M. Jarrett, M. Kelly and S. Vaidyanathan. *Enhancing Community Resilience through Energy Efficiency*. American Council for an Energy Efficient Economy. October 2015.
- Ribeiro, D. and T. Bailey. *Indicators for Local Energy Resilience*. American Council for an Energy Efficiency Economy. June 2017.
- Urban Green Council. *Baby It’s Cold Inside*. February 2014.
- Wisely, J. and C. Hall. “How Consumers Energy Customers Helped Avert a Michigan Gas Crisis.” *Detroit Free Press*. January 31, 2019. <https://www.freep.com/story/news/local/michigan/2019/01/31/consumers-lower-heat-emergency-alert/2732252002/>.

ACKNOWLEDGMENTS

Thank you to the following individuals and organizations that provided feedback to this publication:

- American Institute of Architects
- Kimberly Cheslak, Institute for Market Transformation
- Amy Schmidt, DuPont
- Lowell Ungar, American Council for an Energy Efficient Economy

PRESENTED BY THE ICC FAMILY OF SOLUTIONS

Virginia's Energy Codes

Energy related provisions of the Virginia codes were a topic of many discussions during the recent 2018 code update process, and in fact continue to attract opinion and discussion. In an effort to provide a comprehensive overview of energy code improvements in Virginia, the following information is being provided.

- Background on the evolution of Virginia's energy codes,
- Comparison of Virginia to surrounding states; and
- Update on efforts to improve implementation of the energy provisions of the codes:

Virginia Energy Amendments: This report includes a list of all of the Virginia amendments to the I-Codes (the International Energy Conservation Code, the International Residential Code, and the International Existing Building Code), related to energy efficiency. All of the existing amendments from previous cycles are included as well as all of the amendments recently approved for the 2018 codes. The three color-coded columns on the left of the sheet compare the Virginia requirement to the International Energy Conservation Code (IECC) requirement for that same edition of the codes. The two color coded columns on the right compare each edition of the Virginia Energy Conservation Code (VECC) to the previous edition of the VECC. Shades of green show the progression of the various amendments from the 2012 cycle through the 2018 cycle and yellow indicates a weakening amendment. This report shows that there has been continual improvement. There are no weakening amendments to the commercial energy provisions and only two requirements (wall insulation and maximum air changes per hour) in 2018 Virginia codes for residential energy efficiency that are less stringent than the national model code. The following changes, approved for the 2018 Virginia codes, related to residential energy efficiency, remove existing weakening amendments in the 2015 codes and brings the Virginia requirements in line with the 2018 model codes:

- Energy Certificates
- Ceiling Insulation and Ceiling U-Factor
- Blower Door Testing
- Replacement Fenestration

2020 ACEEE State Energy Efficiency Scorecard: The American Council for an Energy-Efficient Economy's (ACEEE) publishes an annual State Energy Efficiency Scorecard and recently published "The 2020 State Energy Efficiency Scorecard". This document highlights some information from that report related to Virginia's energy codes and energy related policies, including:

- **Virginia ranked 1st in the South**
- **Virginia scored 5 out of 6 for Energy Code Stringency and Compliance**

Virginia's energy codes are currently ranked (ACEEE and US DOE) equal to or better than all surrounding states, with the exception of Washington D.C. and Maryland.

Energy Code Implementation

Over the last several years, DHCD has collaborated and supported Viridian and the Southeast Energy Efficiency Alliance (SEAA) in their efforts to evaluate and improve on the effectiveness of energy code implementation throughout Virginia. These efforts have included field studies, curriculum development of training to enhance deficiencies found in the field, mandatory training of all certified inspectors for this curriculum, follow-up circuit rider analysis and the development of resources for building departments to aid in implementation of residential energy codes.

VIRGINIA ENERGY AMENDMENT ANALYSIS

2012 VECC Compared to 2012 IECC	2015 VECC Compared to 2015 IECC	2018 VECC Compared to 2018 IECC	Virginia Amended Code Section	2015 VECC Compared to 2012 VECC	2018 VECC Compared to 2015 VECC
COMMERCIAL					
EQ	EQ	>	Sections: C402.1.4.2; C402.1.4.2.1; C402.1.4.2.2; C402.1.4.2.3; C402.2.1; C402.2.1.1; C402.2.1.2; C402.2.1.3; C402.2.1.4 and C402.2.1.5 - amended during the 2018 USBC Code Development Cycle via code change proposal E402.1.4.2-18 (Clarifies roof insulation requirements): The amendment clarifies several code requirements, such as the allowance for U-factor compliance method for roof/ceiling assemblies; how to calculate the U-factor contribution of tapered roof insulation; the existing requirements in Section C402.2; etc. The proposal is modeled after the 2021 IECC and is an improvement from the 2015 VECC/2018 IECC.	EQ	>
EQ	EQ	EQ	Sections: C402.4.1.2; C402.4.2 and C402.4.2.2 - amended during the 2018 USBC Code Development Cycle via code change proposal E402.4.2-18 (Deletion of 2018 IECC requirements for minimum skylight fenestration area): while the IECC requirements for minimum skylight fenestration area would appear to increase energy efficiency by requiring more daylight, in fact, it could have somewhat of a negative impact on energy by limiting the capacity of energy producing systems such as photovoltaic (PV) systems that could be installed on the roof of buildings. The roof real estate is already limited given the various items normally located on the roof. Items such as HVAC equipment, roof access hatches, penthouses, shafts extensions, etc. are commonly found on today's building roofs. Further limiting the area that could otherwise be utilized for the installation of PV systems, could deem the installation of such systems unworthy. When comparing the potential in energy savings from skylights vs. PV systems, while there are similarities between the two, there are some distinct differences. One evident similarity between the two is that both save/produce energy during daytime. One distinct difference is exemplified below. The energy savings from skylights are "in the moment", while the sun is shining brightly. The potential for energy savings increases and/or decreases throughout the day based on the location of the sun on the horizon. Additionally, during times the building is unoccupied; or, occupied at reduced levels, the potential for energy savings is very limited or non-existent. The PV systems, however, have the capability of storing energy and using it during peak demand and/or for other types of power utilization equipment (i.e. space conditioning; emergency lighting, etc.) during off hours such as night and/or weekends. Additionally, the PV technology is ever evolving. Unlike skylights, through the use of power optimizers, sun trackers and other similar technologies, PV systems are capable to fully harness the sun's energy anytime during daylight.	EQ	EQ
EQ	EQ	>	Table C402.4, C402.4.3 and Table C402.4.3 (Fenestration, SHGC and Projection Factors): Fenestration and SHGC adjustment multipliers table remain separate in the 2015 VECC (IECC tables combined). The 2015 VECC SEW values conform to the 2018 IECC values. Cardinal orientation and projection factor multiplier for SHGC are addressed in Table C402.4.3. The Virginia amendments to these sections result in equivalent efficiency at worst or increased efficiency at best, compared to the IECC. Table C402.4.3 - amended during the 2018 USBC Code Development Cycle via code change proposal E402.4-18 (SHGC reduction from 0.40 to 0.36): The change lowers the SHGC to a U-factor of 0.36 which coincides with the U-factor for SEW orientation in the 2018 IECC. This is an improvement from the 2015 VECC and provides for more efficient buildings than those complying with the 2018 IECC, particularly buildings facing N.	EQ	>
			C403.2.4.3 (Grease Duct Dampers): Adds an exception, not requiring dampers on grease ducts serving kitchen hoods. This is a fire safety concern that should take precedence over the minimal amount of energy savings that might be realized (when the fan is not operating) if a damper was required in all instances.		
EQ	EQ	EQ	C403.2.6.3 (Dwelling Unit Mechanical Ventilation): This VECC amendment ensures compliance with the VMC requirement. The 2015 VMC Section 401.2 requires <u>mechanical</u> ventilation for all Group R dwelling units, whereas the IECC allows either natural or mechanical ventilation when air infiltration rate is above 5 ACH. This change is specific to dwelling units and ensures adequate ventilation and improves air quality in dwelling units, which is critical in CZ4 to prevent moisture issues. Mechanical ventilation provides more consistent and controlled air movement and should improve efficiency, over natural ventilation.	>	EQ
			Section C403.2.8 and Table C403.2.8 - amended during the 2018 USBC Code Development Cycle via code change proposal E403.2.8-18 (Deletes energy requirements associated with kitchen exhaust systems): This change is the result of safety concerns regarding kitchen hoods. The IECC's allowed ventilation rates conflict with the minimum required ventilation rates specified by the IMC which are necessary to exhaust airborne grease particles produced during kitchen operations. Reducing the maximum allowed ventilation could defeat the purpose of installing such exhaust systems; and could potentially expose the buildings and their occupants to dangerous environments. Fire safety should take precedence over energy savings.		
EQ	EQ	EQ	Section C404.5 (including subsections and table) - amended during the 2018 USBC Code Development Cycle via code change proposal E404.5-18 (Deletes certain requirements for heated water supply piping): In order to comply with the IECC provisions, additional equipment/fixtures that utilize electrical energy (i.e. recirculation pumps, heat trace systems, etc.) would be necessary. As such, although the deletion could appear to reduce energy efficiency, it could actually save energy in some instances by reducing the electrical energy otherwise consumed by the equipment. Thus, the VA amendment appears to have, at worst, a neutral impact on energy efficiency.	EQ	EQ
>	EQ	EQ	C405.5 (Exterior Lighting): The amendment removes an IECC loop hole for exterior lighting that is not served by the building electric service and ensure that <u>ALL</u> exterior lighting is accounted for in the total allowed exterior lighting. While the VECC amendment exempts low voltage landscape lighting from the total exterior lighting allowance, it still closes a loophole in the IECC that would allow an unlimited amount of lighting to be served by a separate electric service and not have to be included in the total allowance.	EQ	EQ

LEGEND:

NA	=	Administrative type changes (i.e. relocation of existing revisions, etc.)
	=	Fire safety concerns; energy efficiency rating not assigned
<	=	Lower energy efficiency levels
EQ	=	Similar energy efficiency levels
>	=	Higher energy efficiency levels

VIRGINIA ENERGY AMENDMENT ANALYSIS

2012 VECC Compared to 2012 IECC	2015 VECC Compared to 2015 IECC	2018 VECC Compared to 2018 IECC	Virginia Amended Code Section	2015 VECC Compared to 2012 VECC	2018 VECC Compared to 2015 VECC
RESIDENTIAL					
EQ	EQ	EQ	R401.2 (Compliance Paths and REScheck): The 2015 VECC amendments to this section allow for different methods of compliance. Although the VECC options are different, the changes in the methods do not result in decreased efficiency. The 2015 VECC allows the use of the REScheck compliance method, but includes a work around to allow the 2015 VECC reduced wall and ceiling R-Values. The 2018 VECC (Code change proposal RE401.2 -18) still allows the REScheck compliance method, but eliminates the R-Value work around resulting in full compliance with the 2018 IECC.	>	>
<	<				
<	<	EQ	Section R401.3 - modified via code change proposal RE401.3-18 (Restores the requirement for energy Certificate): The requirements for energy certificate were deleted in the 2015 VECC. This amendment restores said provisions which brings the 2018 VECC in line with the 2018 IECC in this regard.	EQ	>
<	<	EQ	Table R402.1.2 (Insulation Requirements): The 2015 VECC minimum wall and ceiling R-Values for CZ4 are lower than the 2015 IECC. The 2018 VECC ceiling insulation requirements for CZ4 are increased to R-49 [Code change proposal RE402.1.2(4)] which is the same as the 2018 IECC. The 2018 VECC wood frame wall minimum insulation requirement for CZ4 remains at R-15 or R-13+R-1.	EQ	EQ
<	<	<			>
<	<	EQ	Table R402.1.4 (U Factors): The 2015 VECC minimum wall and ceiling U-Factors for CZ4 are higher than the 2015 IECC. The 2018 VECC ceiling U-Factor for CZ4 is reduced to 0.26 [Code change proposal RE402.1.2(4)] which is the same as the 2018 IECC. The 2018 VECC wood frame wall U-Factor for CZ4 remains at U-0.079.	EQ	EQ
<	<	<			>
EQ	EQ	EQ	R402.2.4 (Attic Hatches): Attic hatches and scuttle hole covers must be insulated to a level equivalent to the insulation on the surrounding surfaces, similar to the IECC. For vertical access doors, the VECC results in increased efficiency (lower U-Factor) for these types of doors. This increase is offset by a slight reduction in VECC efficiency for pull down stairs.	EQ	>
EQ	EQ	EQ	R402.4 (Recessed Lighting): An IECC error in Section R402.4, later corrected by errata, only included Sections R402.4.1 through R402.4.4, and did not include R402.4.5 (Recessed lighting). The VECC was based on an early version of the IECC, so it included the incorrect reference. However, Table R402.4.1.1 includes the same requirements as Section R402.4.5 and is still applicable. This amendment does not result in a change in efficiency.	>	>
EQ	EQ	EQ	Table R402.4.1.1 (Air Barrier Details): The VECC amendment adds footnotes and additional details to ensure proper installation of air barriers behind tubs and at headers. This VECC amendment should provide increased efficiency.	>	>
<	<	EQ	R402.4.1.2 (Blower Door Testing): The 2015 VECC allows a visual inspection for air leakage. The 2018 VECC requires blower door testing. Sections R402.4.1.2; R402.4.1.2.1; R42.4.1.2.2 and R402.4.1.3 - amended during the 2018 USBC Code Development Cycle via code change proposal RE402.4.1.2-18 (Eliminates the thermal envelope Visual Inspection Option): Under the 2015 VECC, the thermal envelope tightness can be verified by means of Visual Inspection, or blower door test. The Visual Inspection Option will no longer be allowed by the 2018 VECC. Although the allowed air changes per our differ from those in the 2018 IECC, the amendment is an improvement over the 2015 VECC.	EQ	>
EQ	<	<	R402.4.1.3 (Envelope Air Leakage): The VECC amendment increases the maximum allowable air leakage from 3 ACH to 5 ACH, but the 2018 VECC will require blower door testing to verify compliance which will result in an overall increase in compliance and efficiency related to air leakage.	EQ	>
EQ	EQ	EQ	Section R403.3.5 - amended during the 2018 USBC Code Development Cycle via code change proposal RE403.3.5-18 (Allows building framing cavities to be used as air plenums): The amendment removes a conflict between the mechanical and energy provisions of the VRC. Although the 2018 IECC prohibits the use of framing cavities as air plenums, given the fact that wall cavities in outside walls are not allowed by the mechanical provisions of the VRC, there is no difference between the 2018 IECC and the 2018 VECC/VRC as it relates to energy efficiency.	EQ	EQ
EQ	EQ	EQ	R403.7 (High Efficiency HVAC Equipment Sizing): The Virginia amendment adds an exception to the prescriptive sizing requirements where HVAC systems that utilize special technology (multi-stage, variable refrigerant flow, etc.) are chosen to achieve increased efficiency.	EQ	EQ
EQ	EQ	EQ	Table R406.4 (ERI): The 2015 VECC ERI for CZ4 was higher than the 2015 IECC, to provide a reasonable and achievable number and encourage use of the ERI compliance path, ultimately resulting in increased efficiency compared to a building using another compliance path, as well as more buildings with such improvements. The 2015 VECC ERI for CZ4 was brought forward from the 2018 IECC.	>	>
<	<	EQ	R503.1.1.1 (Replacement Fenestration): The VECC deleted this requirement to align with the VEBC requirements in Section 102.2.2. Leaving this requirement in the VECC would not ensure compliance as the option still exists in the VEBC to replace fenestration with materials of similar efficiency. The 2018 VECC, however, reintroduces this requirement via code change proposal EB601.4(3) in Section "601.4.4 Fenestration." of the 2018 VEBC. As such the 2018 USBC is consistent with the 2018 IECC in this regard.	EQ	>

LEGEND:

NA	=	Administrative type changes (i.e. relocation of existing revisions, etc.)
	=	Fire safety concerns; energy efficiency rating not assigned
<	=	Lower energy efficiency levels
EQ	=	Similar energy efficiency levels
>	=	Higher energy efficiency levels

VIRGINIA ENERGY AMENDMENT ANALYSIS

2018 VEBC Compared to 2018 IECC	EXISTING BUILDINGS	2015 VEBC Compared to 2012 VEBC	2018 VEBC Compared to 2015 VEBC
EQ	VEBC Section 601.4: Code change proposal EB601.4(3)-18 (Increases the energy efficiency requirements applicable to existing buildings): The 2015 VEBC provisions dealing with the energy efficiency are enhanced by this proposal "by providing important details about efficiency requirements that apply to common alterations to existing buildings" (excerpt from the proponent's reason statement). The proposal covers requirements applicable to the alteration of several different building component types such as wall; ceiling; floor; fenestration; roof replacement. When directly comparing the 2018 VEBC requirements with the 2018 IECC provisions, the former are in most cases as or more stringent than the latter. The only VEBC item that could be perceived as being less stringent than the 2018 IECC is the threshold set on the roof area replacement. However, unlike the IECC, the VEBC roof replacement provisions also require compliance with Section C402.2.1 which has been substantially augmented by code change proposal E402.1.4.2-18. The overall result of the proposal is an increase in energy efficiency levels of existing buildings being altered.	EQ	>
NA	Code change proposal E501.1-18 (Deletes energy provisions applicable to existing buildings from the VECC and refers the reader to the VEBC): given that buildings under the purview of the VRC can currently comply with either the VECC or the VEBC, the proposed change has no impact on energy efficiency.	NA	NA
NA	Code change proposal E502-18 (Relocates energy provisions, related to existing buildings, from the VECC to VEBC): this is an administrative type change and there are no reductions in energy efficiency when compared with the 2018 IECC.	NA	NA
NA	Code change proposal E503-18 (Relocates energy provisions, related to existing buildings, from the VECC to the VEBC): VECC alteration provisions are deleted and a reference to Chapter 6 of the VEBC has been added. Section 601.4 of the VEBC requires compliance with the VECC/VRC as it relates to new construction. No reduction in energy efficiency appears to occur as a result of this amendment.	NA	NA
NA	Code change proposal E504.1-18 (Relocates energy provisions, related to existing buildings, from the VECC to the VEBC): The "Repair" provisions are relocated from the VECC to the VEBC. This appears to be an administrative change with no impact on energy conservation.	NA	NA

LEGEND:

NA	=	Administrative type changes (i.e. relocation of existing revisions, etc.)
<	=	Fire safety concerns; energy efficiency rating not assigned
EQ	=	Lower energy efficiency levels
>	=	Similar energy efficiency levels
>	=	Higher energy efficiency levels

2020 ACEEE State Energy Efficiency Scorecard

BACKGROUND

The American Council for an Energy-Efficient Economy (ACEEE) produces an annual report that ranks U.S. states on their policy and program efforts to save energy and pursue efficiency as a cost-effective, critical tool for reducing emissions and meeting state clean energy goals. The report ranks states based on five categories: Utility and Public Benefits Programs & Policies (20 pts), Transportation Policies (12 pts), Building Energy Efficiency Policies (9 pts), State Government Initiatives (6pts), and Appliance Efficiency Standards (3 pts).

VIRGINIA'S RANKINGS

Of particular note is Virginia's ranking of lead state in the Southeastern region and was recognized in the report as one of the states to watch in future reports, primarily due to Virginia's designation as one of the most-improved states since the 2019 State Energy Efficiency Report Card. The report also praises Virginia as one of the "top energy stories of 2020" and declared the passage of the Virginia Clean Economy Act (VCEA) as "a major victory for efficiency in the Southeast." Virginia was also recognized as being the first southern state to join the Regional Greenhouse Gas Initiative (RGGI).

The report listed Virginia as a "Leading and Trending State" that has taken significant steps in recent years to strengthen efficiency offerings for low-income customers, citing the 2018 Grid Transformation & Security Act, the VCEA, and other environmental justice measures that consider low-income areas and historically disadvantaged communities.

VIRGINIA'S BUILDING ENERGY EFFICIENCY SCORES

Of further note is Virginia's performance in its Building Energy Efficiency Policies. With regard to Energy Code Stringency, Virginia scored 3.5 points out of a possible 4 points.

Note: The information used to evaluate Virginia's energy codes was based on the current (2015) edition of the Virginia codes and does not yet take into account the recent approval to adopt the 2018 energy codes. Once the 2018 codes become effective this year, the recent 2018 model code adoption, as well as all of the improvements to existing Virginia amendments should be reflected in the next ACEEE Scorecard.

The other category related to state residential and commercial energy codes, Code Compliance is based on the level of activity to support code compliance and Virginia scored 1.5 out of 2 possible points.

The Building Energy Efficiency Policies category provides an opportunity for a maximum of 9 points (Code Stringency 4 pts; Code Compliance 2 pts; and Building Energy Use Transparency 3 pts). In addition to the 5 energy code related points earned (3.5 points for Energy Code Stringency and 1.5 points for Code Compliance), Virginia added an additional .5 points for Building Energy Use Transparency, for 5.5 out of 9 points, placing them No. 1 in the Southern region.

Energy Code Implementation

The U.S. Department of Energy (DOE) conducts research studies on building energy code implementation to assist states in measuring energy code compliance and improving training initiatives. Southeast Energy Efficiency Alliance (SEEA) led the initiative in Virginia and provided funding for Viridiant to conduct a field study in 2017-2018 to assess residential energy code implementation in new construction single-family buildings. DHCD supported the grant and provided in-kind services to Viridiant. Follow-up grants were supported by DHCD and collaboration continues today through ongoing work to improve on the effectiveness of energy code implementation throughout Virginia.

FIELD STUDY

The field study identified that significant energy and cost savings potential existed through increased compliance with existing energy codes, and recommended focusing on energy code compliance-improvement programs including education, training, and outreach initiatives. Duct leakage and envelope air leakage measures showed the greatest potential for energy savings.

CODE ENFORCEMENT TRAINING

As a result of the field study, Viridiant identified specific areas to be addressed through training. Subsequently, DHCD partnered with Viridiant in the training development and implementation process to develop a four-hour training offered as an in-person classroom program as well as an online self-paced program to address the identified need areas.

The Board of Housing and Community Development, with the support of VA Building and Code Officials Association made this class mandatory for the following certificate holders:

- Building Code Official
- Residential Building Inspector
- Combination Residential Building Inspector
- Mechanical Inspector
- Residential Plan Reviewer
- Mechanical Plan Reviewer

Although the date to complete the training was December 2020, the online version remains available as a resource to all local code enforcement personnel with more than 720 people having completed the instructor led or online version to date. Additionally DHCD supported the development of a two-hour version of the training specifically designed for contractors. This online training is an ongoing available resource for contractors as well. It should be noted that this training is available and provided at no cost to anyone wishing to take it.

CIRCUIT RIDER PROGRAM

In 2019, Viridiant partnered with DHCD to secure SEEA grant funds with the intent to evaluate compliance of energy codes in new construction. Viridiant's grant proposal specifically focused on identifying the knowledge and application gaps related to enforcement of the energy codes in Virginia. Viridiant conducted grant supported surveys, questionnaires, and site research exploring both contractors and the code community's knowledge and understanding of the energy code. Based on these findings, a plethora of training materials and resources were developed by Viridiant.

CODE ENFORCEMENT RESOURCES

Viridiant worked with urban, rural, and suburban localities of varying population sizes to compile information to aid in the VA Residential Energy Code implementation and resource development. The following Virginia Residential Energy Code Resources were recently completed and will be available to all stakeholders soon:

- Manual J, D & S Brochures
- Residential Plans Examiner HVAC Form Cheat Sheet
- Understanding and Using the HVAC Design Review Form
- Recommended Best Practices for Remote Virtual Inspections
- HVAC Installation Tips for Meeting Virginia Residential Energy Code
- Insulation Installation Tips for Meeting Virginia Residential Energy Code
- Lighting Tips for Meeting Virginia Residential Energy Code
- Indoor Air Quality, Code & COVID Guide
- Duct Test Report Form
- Duct Blaster Test Training Video
- Insulation & Air Barrier Guide
- Insulation & Air Barrier Field Checklist
- Whole-House Fresh Air Ventilation Guide
- Slab Edge Insulation Guide
- Duct Sealing & Testing Guide
- Suggested Website Layout for Easy Navigating
- Accessing the Jack A. Proctor Virginia Building Code Academy

These resources are intended to support and provide deeper context and understanding of the implementation of the residential provisions of Virginia's Energy Codes.